


* 60" MIN OR AS SHOWN ON THE PLANS.

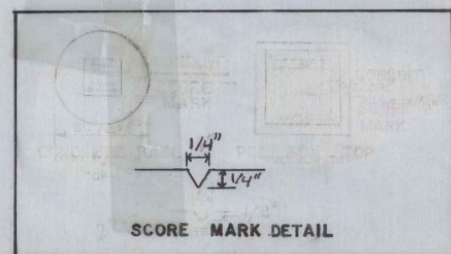

NOTES

ALL BASES AND PULL BOXES TO BE CONCRETE MEETING THE REQUIREMENTS FOR CONCRETE CLASS B

FOR PULLBOXES— PROVIDE SOFT PLUGS IN CONCRETE BELOW THREADED HOLES IN THE COVER FRAME TO PERMIT RETHRADING AT A FUTURE DATE.

ALL REINFORCING STEEL TO CONFORM TO THE REQUIREMENTS FOR "REINFORCING STEEL".

CONDUIT SIZE - AS SHOWN ON THE PLANS

TEMPLATE FOR ANCHOR BOLTS, ANCHOR BOLTS, NUTS AND WASHERS TO BE OBTAINED BY CONTRACTOR FROM POLE MANUFACTURER PRIOR TO CONSTRUCTION OF BASES.

SCORE TOP OF BASE OR PULLBOXES TO SHOW LOCATION OF CONDUIT(S)

REVISIONS AND CORRECTIONS

AUG. 6, 1981 CHANGED GROUND ROD FROM 1" X 10' TO 5/8" X 8'

JUNE 13, 1984 ADDED SCORE MARK DETAIL, CHANGED BRONZE TO STAINLESS STEEL, ADDED PULLBOX NOTE, ADDED MIN DEPTH AND RADIUS.

APPROVED

DATE Dec 29, 1971

R. H. Arnold
CHIEF ENGINEER

E. W. Steiner
ASST. CHIEF ENGINEER

G. M. Lane
HIGHWAY ENGINEER

TRACED: AJA

STREET LIGHTING
CONCRETE BASES AND PULL BOXES



STANDARD
E-37