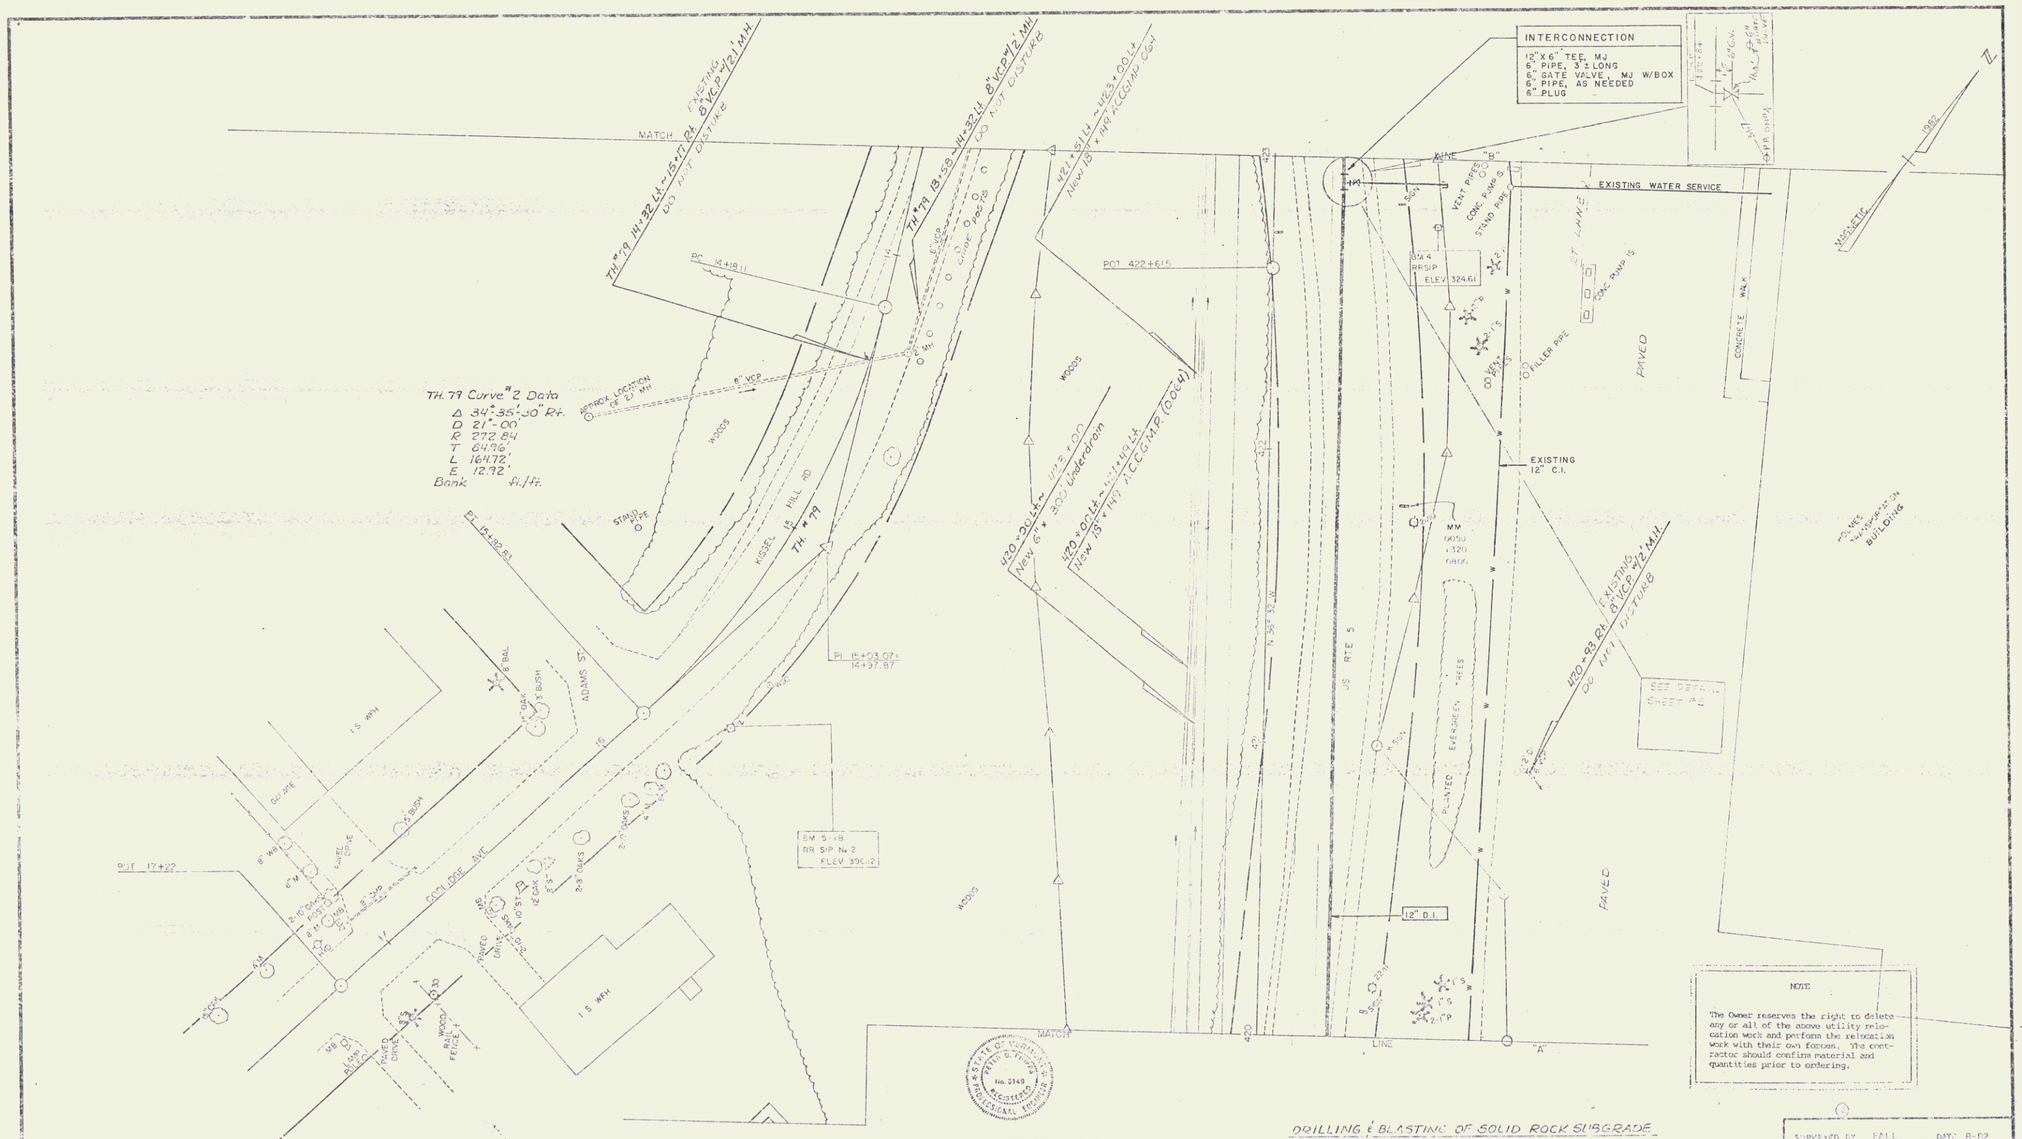
INTERCONNECTION
12" X 6" TEE, MJ
6" PIPE, 3' ± LONG
6" GATE VALVE, MJ W/BOX
6" PIPE, AS NEEDED
6" PLUG
EXISTING WATER SERVICE
MATCH LINE "B"
MATCH LINE "A"
TH. 79 Curve #2 Data
Δ 34°-35'-30" Rt.
D 21°-00'
R 272.84
T 84.76'
L 164.72'
E 12.92'
Bank ft./ft.
TH. #79 14+32 Lt. ~ 15+41 Rt. 8" VCP w/2 MH
DO NOT DISTURB
TH. #79 13+58 ~ 14+32 Lt. 8" VCP w/2 MH
DO NOT DISTURB
421+51 Lt. ~ 423+00 Lt.
New 15" x 140' ALCGMP CSP
POT 422+61.5
420+00 Lt. ~ 421+49 Lt.
New 6" x 300' Underdrain
420+00 Rt. ~ 421+49 Rt.
New 15" x 140' ALCGMP (GOOD)
420+93 Rt. 8" VCP w/2 MH
DO NOT DISTURB
EXISTING 12" C.I.
12" D.I.
PAVED
CONCRETE WALK
POWER TRANSMISSION BUILDING
MAGNETIC
WOODS
ADAMS ST
COLLEGE AVE
KISSEL HILL RD
TH. #79
US RTE 5
PLANTED EVERGREEN TREES
I.S. WFH
POT 17+22
PL 14+03.07± 14+37.87
EM 5-18
RR SIP No. 2
ELEV. 390.12
BM 4
RRSIP
ELEV. 324.61
SEE DETAIL SHEET #2
NOTE
The Owner reserves the right to delete any or all of the above utility relocation work and perform the relocation work with their own forces. The contractor should confirm material and quantities prior to ordering.
DATUM
VERTICAL NGVD 1929
HORIZONTAL N/A
ADDITIONAL GENERAL NOTE
LOCATION OF EXISTING AND NEW WATER MAINS AND APPURTENANCES PROVIDED BY D.C.P.B., INC., P.O. BOX 514, LEBANON, NEW HAMPSHIRE 03766 - JUNE, 1985
DRILLING & BLASTING OF SOLID ROCK SUBGRADE
421+00 ~ 423+00
EROSION MATTING
420+00 Lt. ~ 423+00
0 20 40
SCALE IN FEET
SURVEYED BY FALL DATE 8-82
DRAWN BY TOOLAN DATE 11-82
TRACED BY TOOLAN DATE 11-82
WESTMINSTER-ROCKINGHAM
PROJ. BRS NO. 0113(15)
SHEET 55 OF 202