



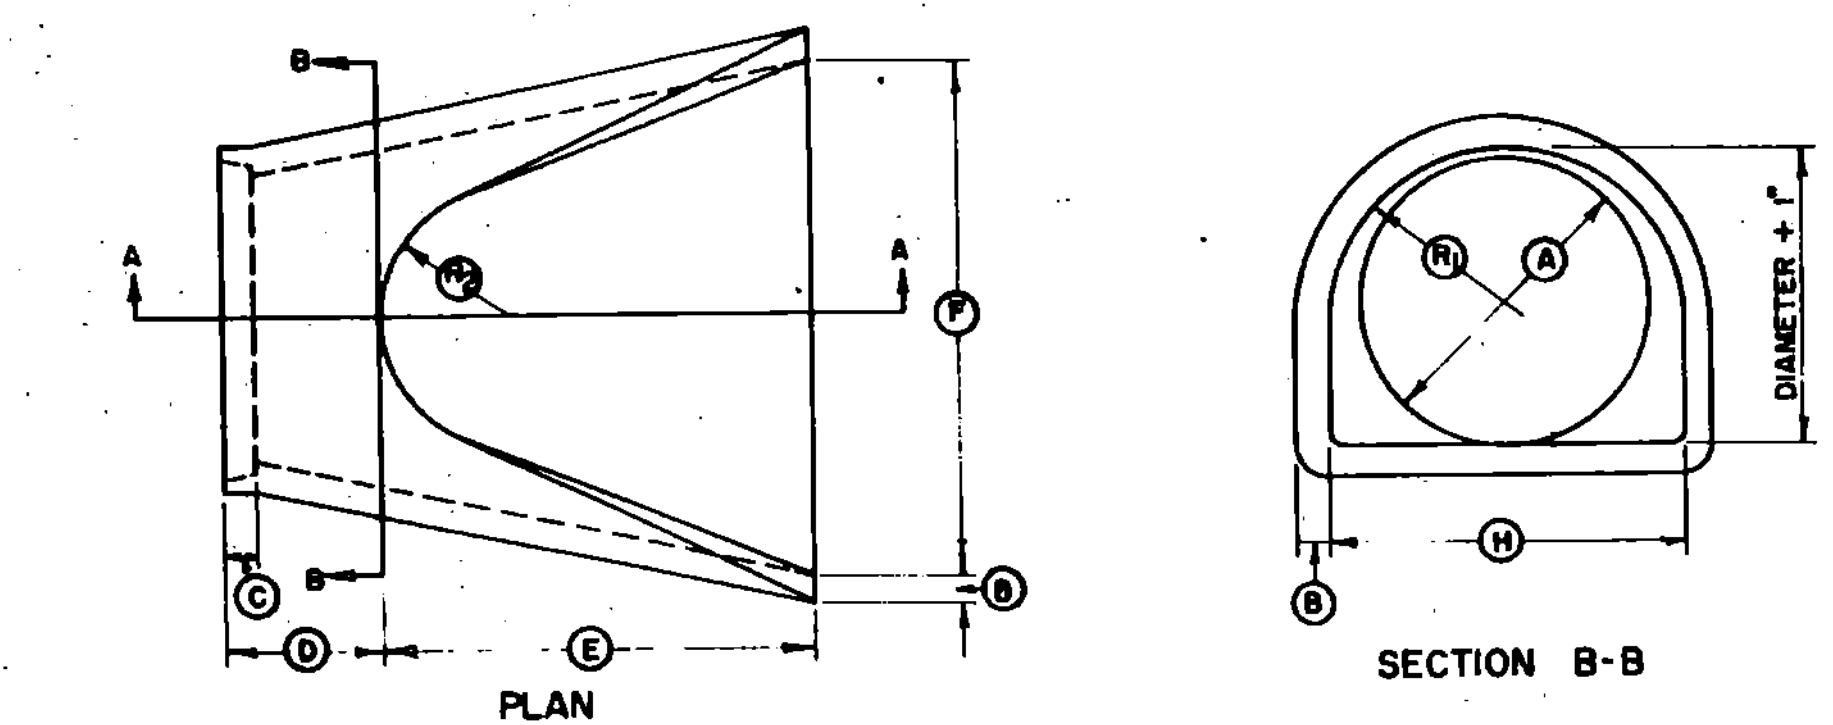


THE USE OF REINFORCED CONCRETE END SECTIONS HAVING VARIATIONS IN BASIC DIMENSIONS FROM THOSE SHOWN ON THIS SHEET SHALL BE SUBJECT TO THE APPROVAL OF THE ENGINEER.

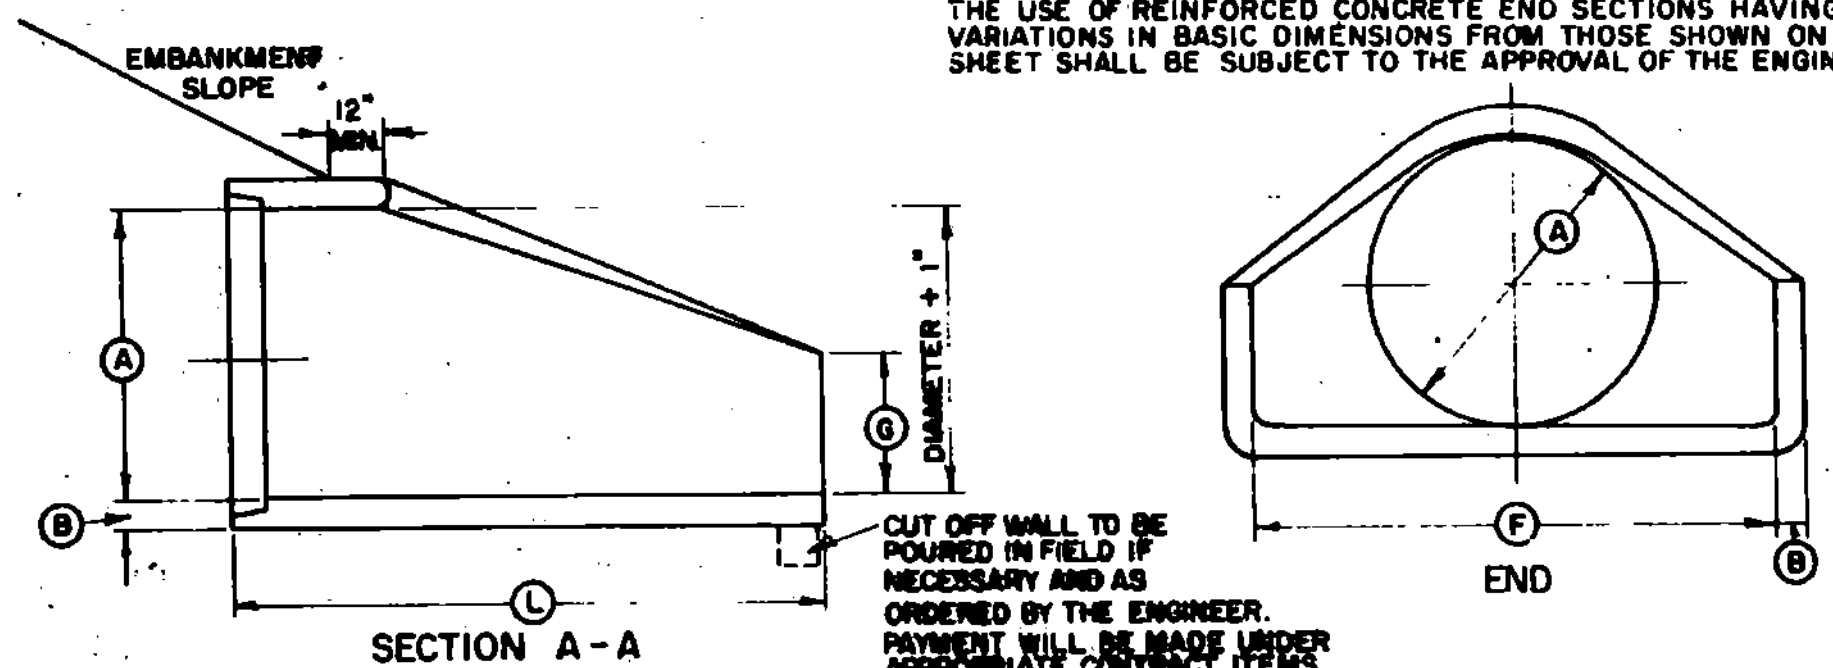


BASIC DIMENSIONS												
A	B	C	D	E	F	G	H	DIAM. + 1"	SLOPE	R ₁	R ₂	AREA - 1
12"	2"	SEE NOTE	48 3/8"	24"	24"	4"	18 15/16"	13"	2.7:1	10 1/8"	9"	1.92
18"	2 1/2"	SEE NOTE	46"	27"	36"	9"	20"	19"	2.7:1	15 1/2"	12"	1.88
24"	3"	SEE NOTE	30"	43 1/2"	48"	9 1/2"	33 3/8"	25"	2.8:1	16 13/16"	14"	1.58
30"	3 1/2"	SEE NOTE	19 3/4"	54"	60"	12"	37"	31"	2.8:1	18 1/2"	15"	1.41
36"	4"	SEE NOTE	34 3/4"	63"	72"	15"	47 13/16"	37"	2.9:1	24 5/16"	20"	1.80
42"	4 1/2"	SEE NOTE	35"	63"	78"	18"	53 7/8"	43"	2.9:1	27 1/2"	22"	1.46
48"	5"	SEE NOTE	26"	72"	87"	24"	66 1/2"	49"	2.9:1	30"	22"	1.40

REINFORCED CONCRETE PIPE END SECTION


* AREA - 1 = AREA OF NOMINAL DIAMETER
* AREA - 2 = AREA THRU SECTION B-B

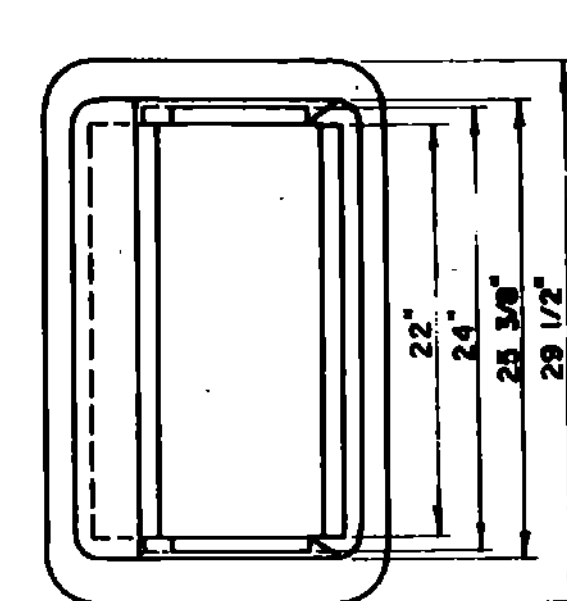

FRAME

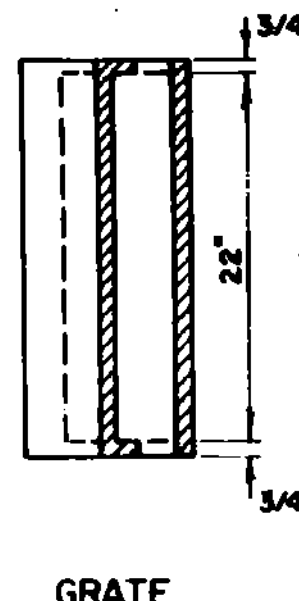


GRATE

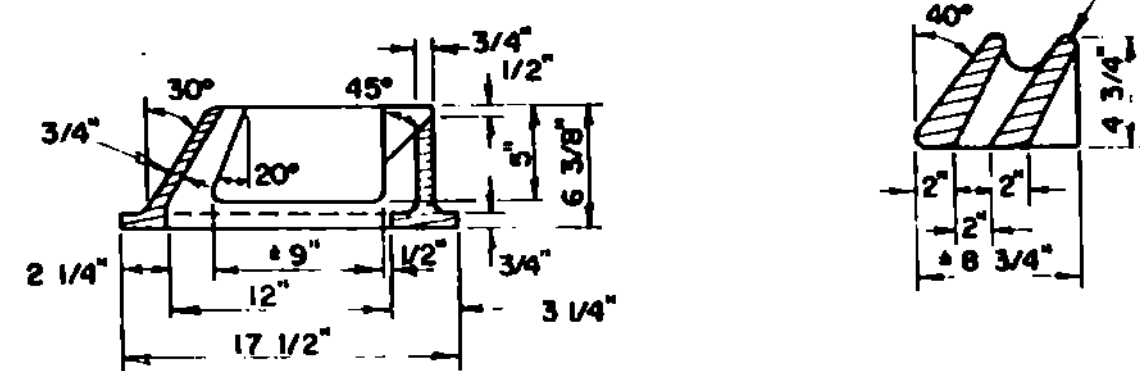


ALTERNATE GRATE AND FRAME

NOTE: JOINTS SHALL BE TONGUE AND GROOVE OR BELL AND SPIGOT AS REQUIRED AND DIMENSIONS SHALL CONFORM TO STANDARD REINFORCED CONCRETE PIPE SPECIFICATIONS.

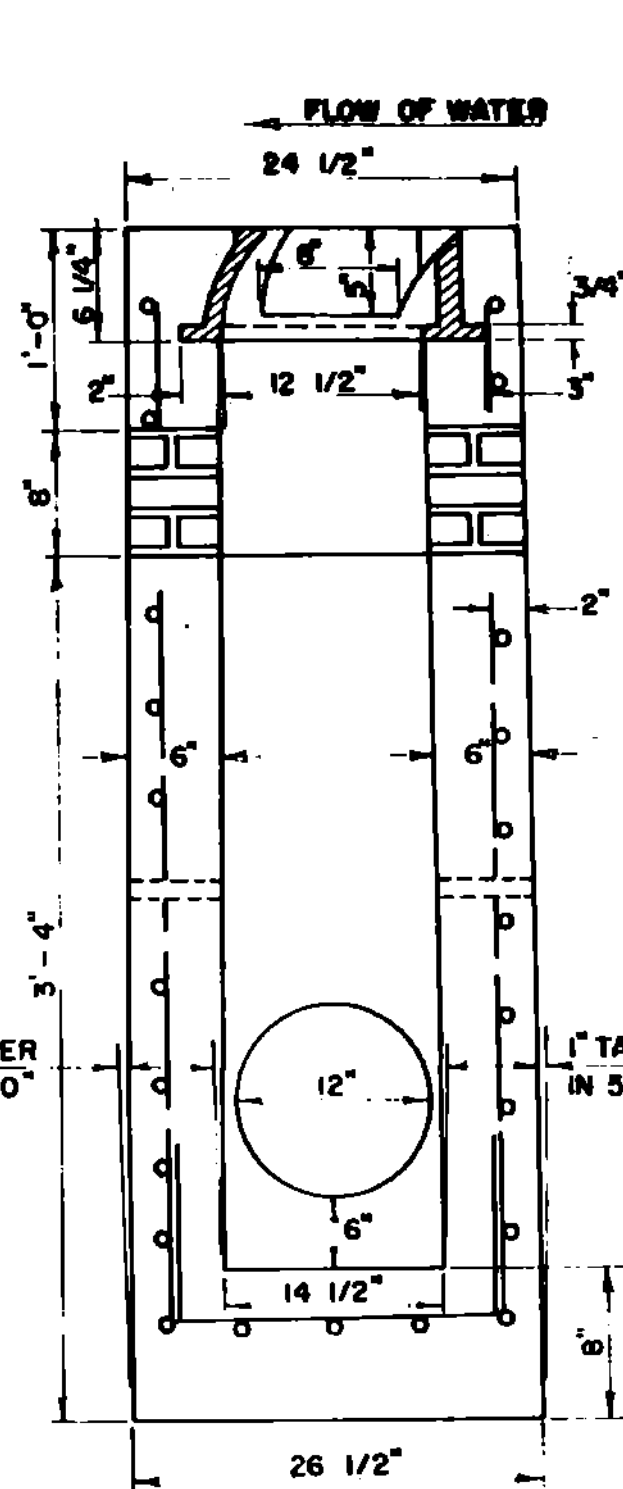


END ELEVATION

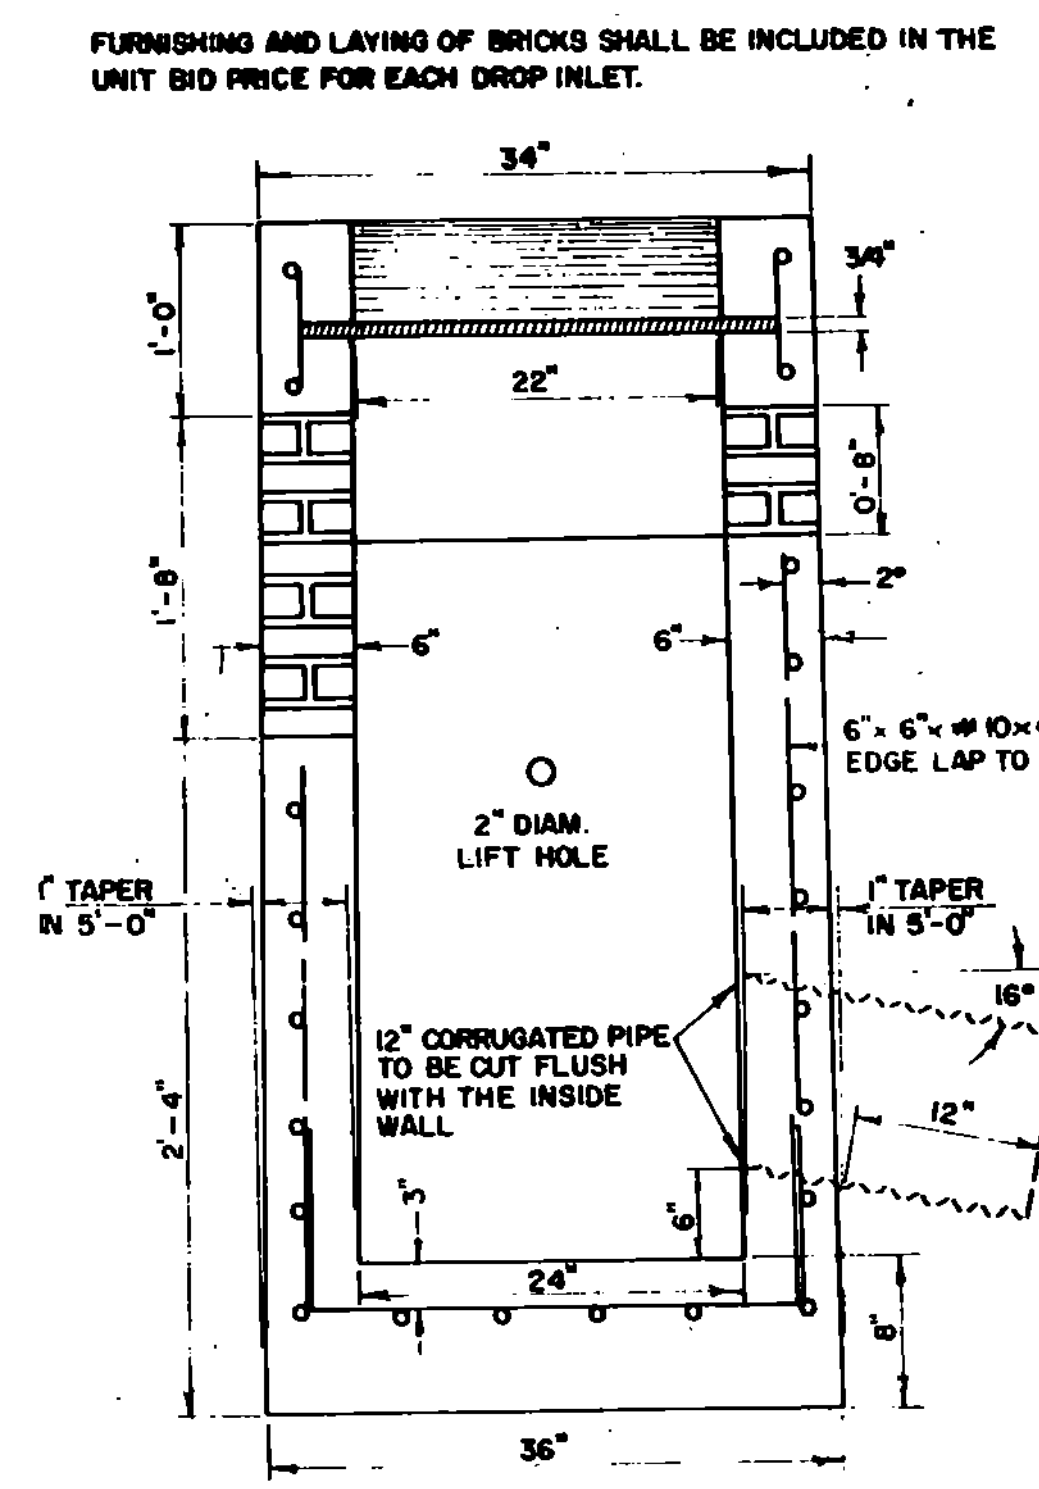


SIDE ELEVATION


ALLOW FOR 1"-8" OF BRICKS ON SIDE OPPOSITE OUTLET PIPE
0"-8" BRICKS ON OTHER 3 SIDES.
PRECAST REINFORCED CONCRETE CURB DROP INLET WITH CAST IRON GRATE

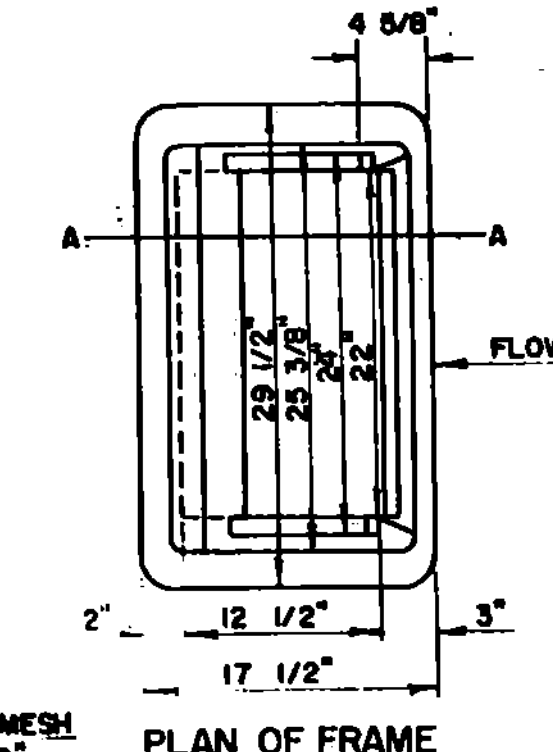


PLAN OF FRAME

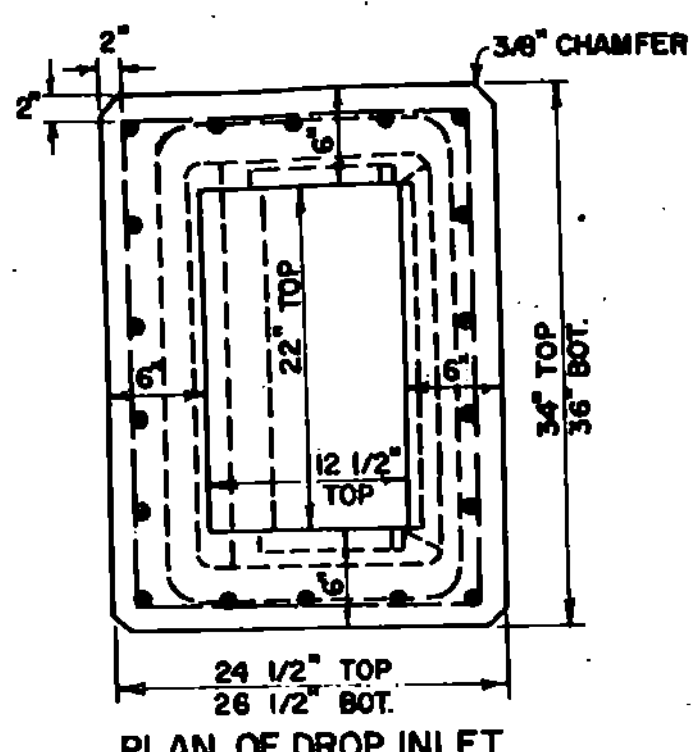


PLAN OF DROP INLET BARREL

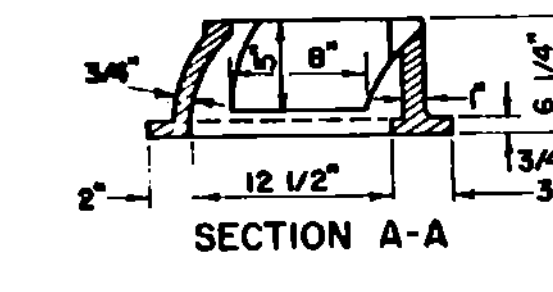


SECTION A-A

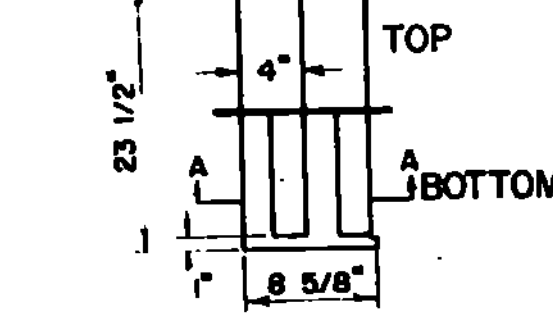


PLAN OF GRATE

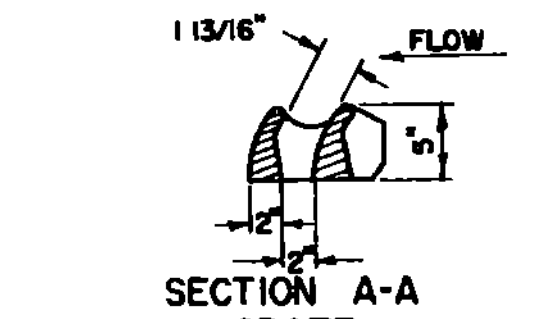

SECTION A-A GRATE

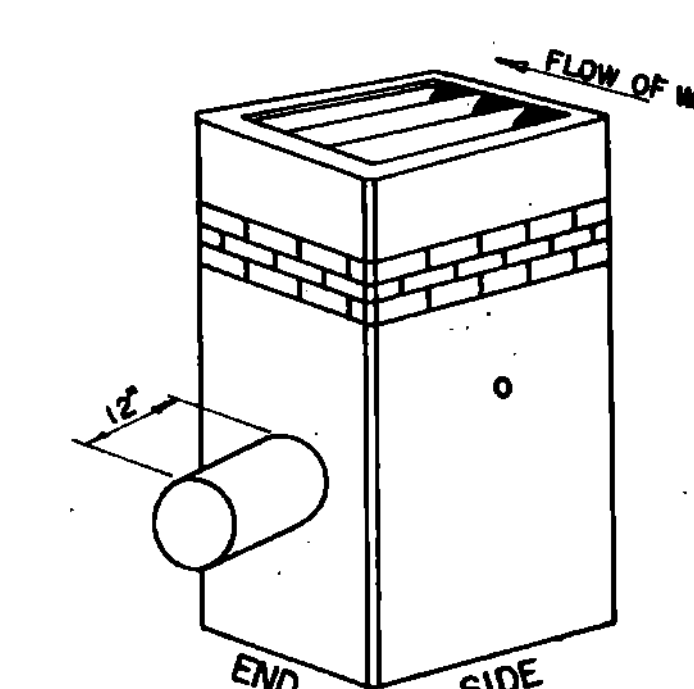


ISOMETRIC

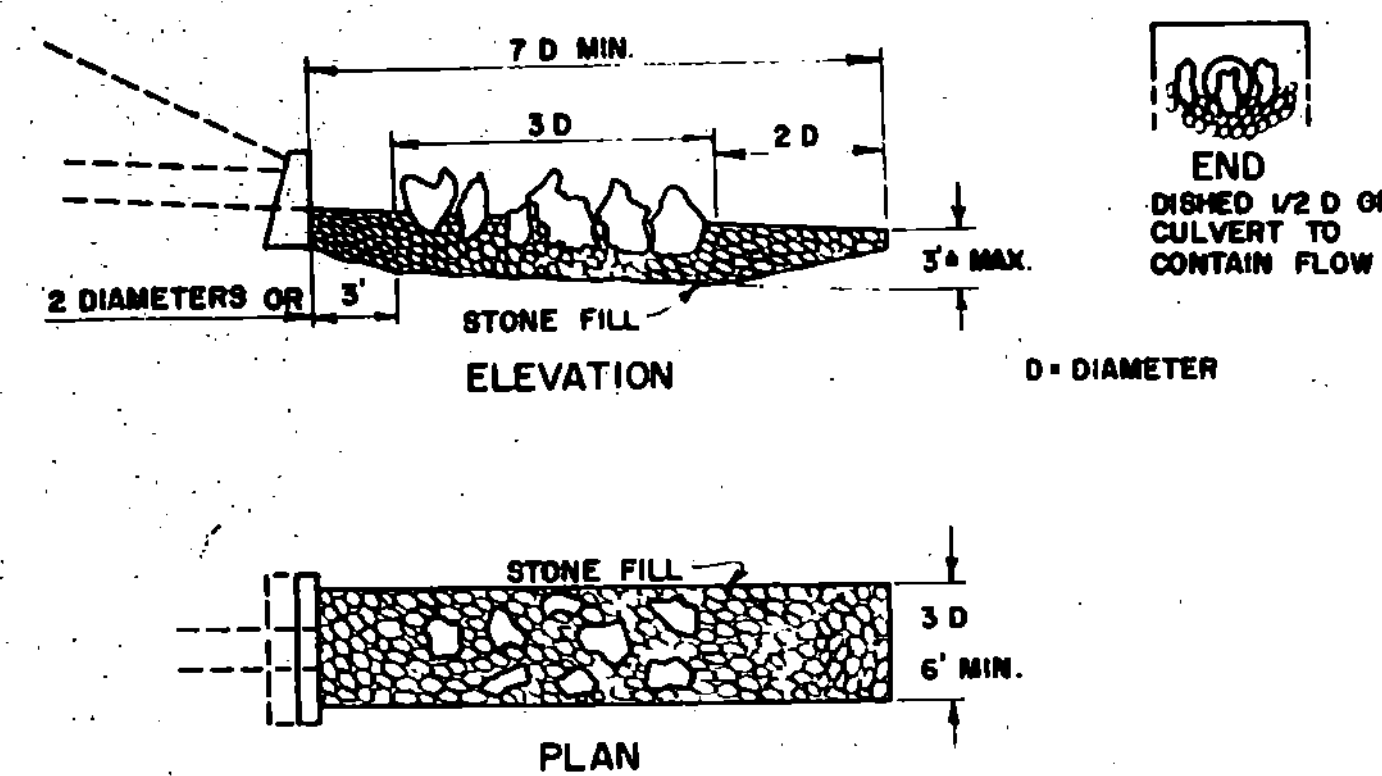


FOR USE ONLY AT LOCATIONS OF VERY HIGH DISCHARGE AND ERODABLE SOIL CONDITIONS.
IRREGULAR COBBLES APPROXIMATING THE MAXIMUM SIZE FOR TYPE OF SPECIFIED STONE FILL TO BE PLACED IN GENERAL PATTERN AS SHOWN. NO STONE TO BE CLOSER THAN 2D TO OUTLET OF PIPE. STONES SHOULD NOT BE PLACED TO DAM FLOW, BUT TO INDUCE TURBULENCE AND REDUCE VELOCITY. PLAN MAY BE ADAPTED TO FIELD CONDITIONS PREVAILING AT OUTLET. WHERE FLOW IS TO ULTIMATELY FOLLOW TOE OF SLOPE, DESIGN MAY BE SHORTENED OR WIDENED TO ACT AS A STILLING BASIN, AND DIRECT FLOW INTO DITCH.
STONES FORMING BREAK SHOULD PROJECT ABOVE AND BELOW SURFACE OF STONE FILL APPROXIMATELY 3/4 THE DIAMETER OF THE PIPE.
STONE FILL TYPE TO BE SPECIFIED ON PLANS.

ENERGY DISSIPATOR FOR CULVERTS


TOP AND BOTTOM COVERS TO BE .064" GALVANIZED IRON OR STEEL, OR .080" ALUMINUM ALLOY.
ALL FITTINGS TO BE SHOP WELDED INCLUDING COVERS.

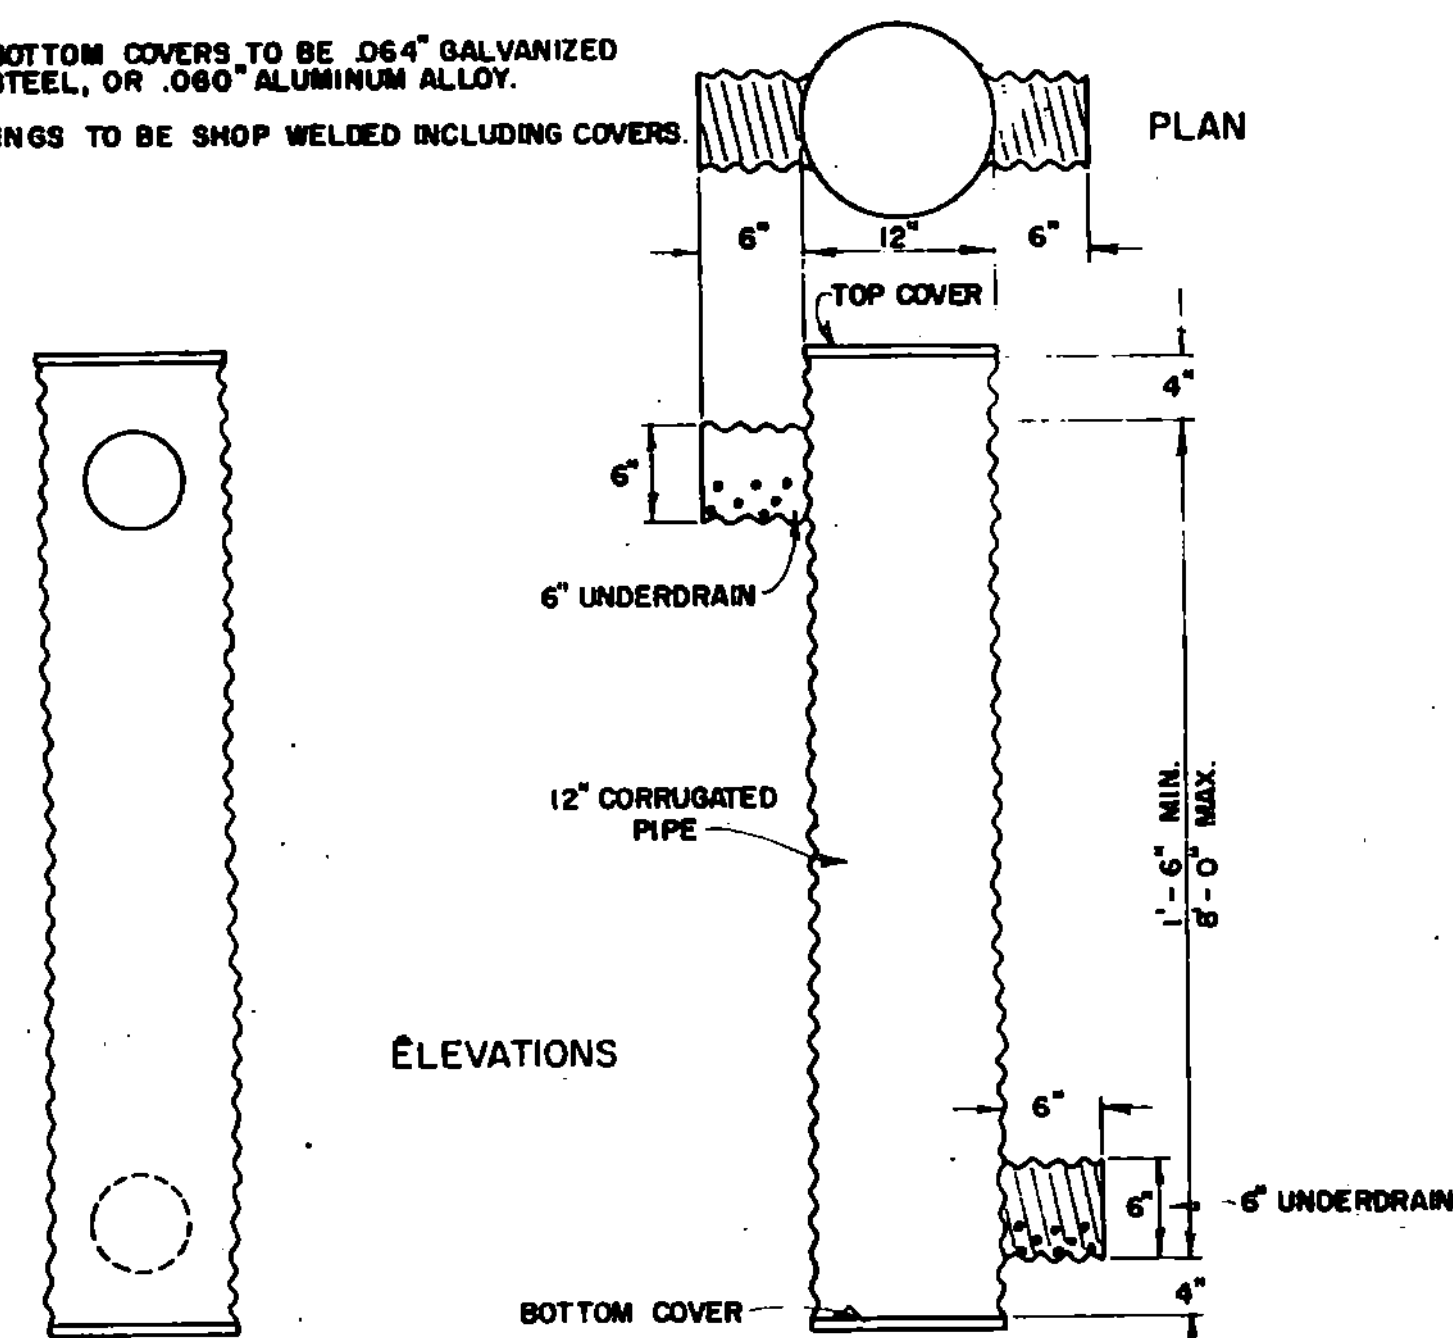

UNDERDRAIN RISER

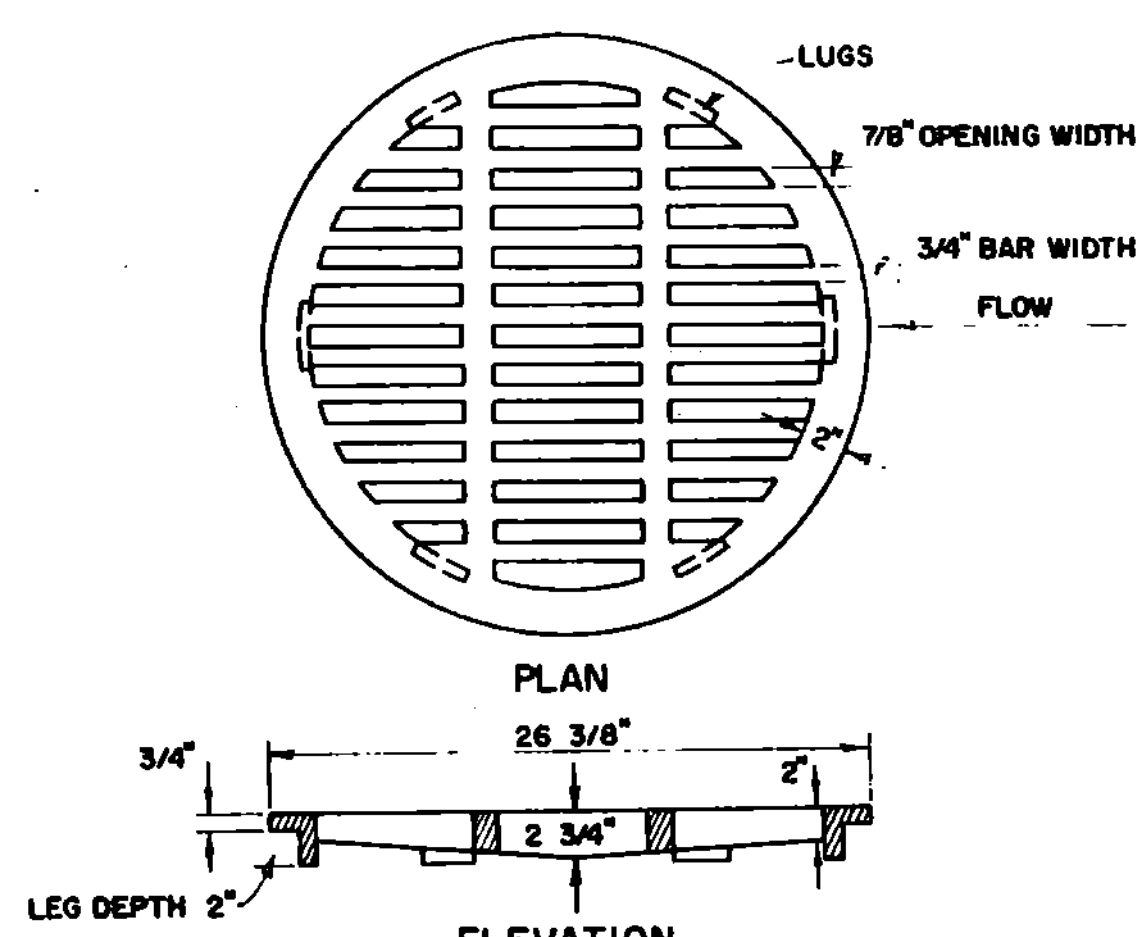

CAST IRON GRATE, TYPE C
TO BE USED IN CONJUNCTION WITH 24" CORRUGATED STEEL PIPE

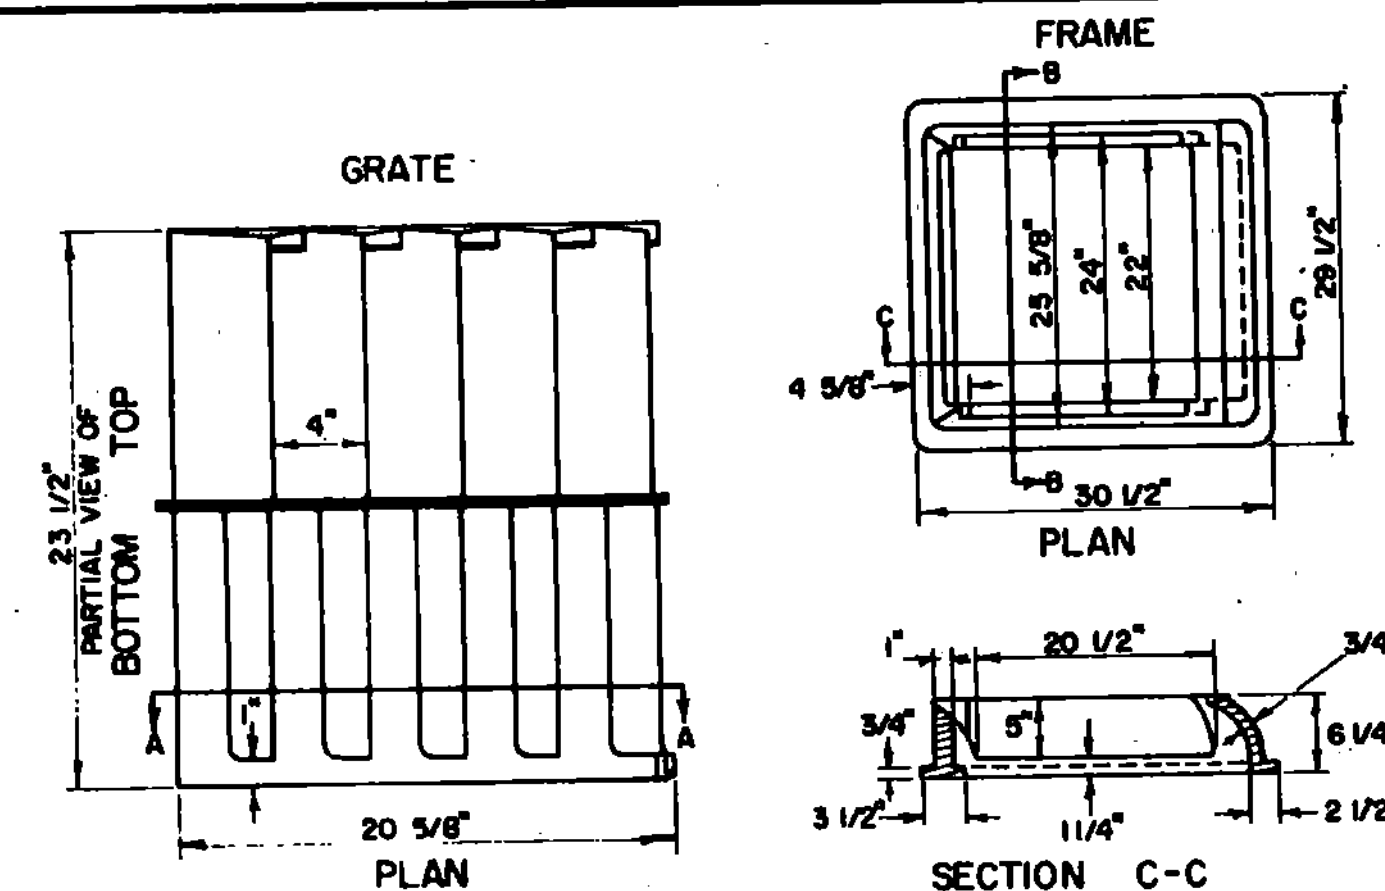

CAST IRON GRATE WITH FRAME, TYPE B

REVISIONS & CORRECTIONS
NOV. 14, 1972 - RCP END SECTION DIMENSION VARIANCE NOTE ADDED.
30 OCT 1983 - REVISED TO CONFORM WITH 1986 SPECIFICATIONS.

APPROVED
Dec. 8, 1971
R. H. Arnold
CHIEF ENGINEER
E. H. Stinchney
ASST. CHIEF ENGINEER
L. M. Lane
HIGHWAY ENGINEER

PRECAST REINFORCED CONCRETE CURB DROP INLET WITH CAST IRON GRATE
CAST IRON GRATE, TYPE B
CAST IRON GRATE, TYPE C
UNDERDRAIN RISER
REINFORCED CONCRETE PIPE END SECTION
ENERGY DISSIPATOR FOR CULVERT



STANDARD
D-16