


**SIDE ROAD
90° INTERSECTION**

**Centerline treatment shall consist of a minimum of 400 feet of solid line in advance of the intersection and shall be paired with either a solid or dashed line depending on sight distance availability in the opposing lane.*

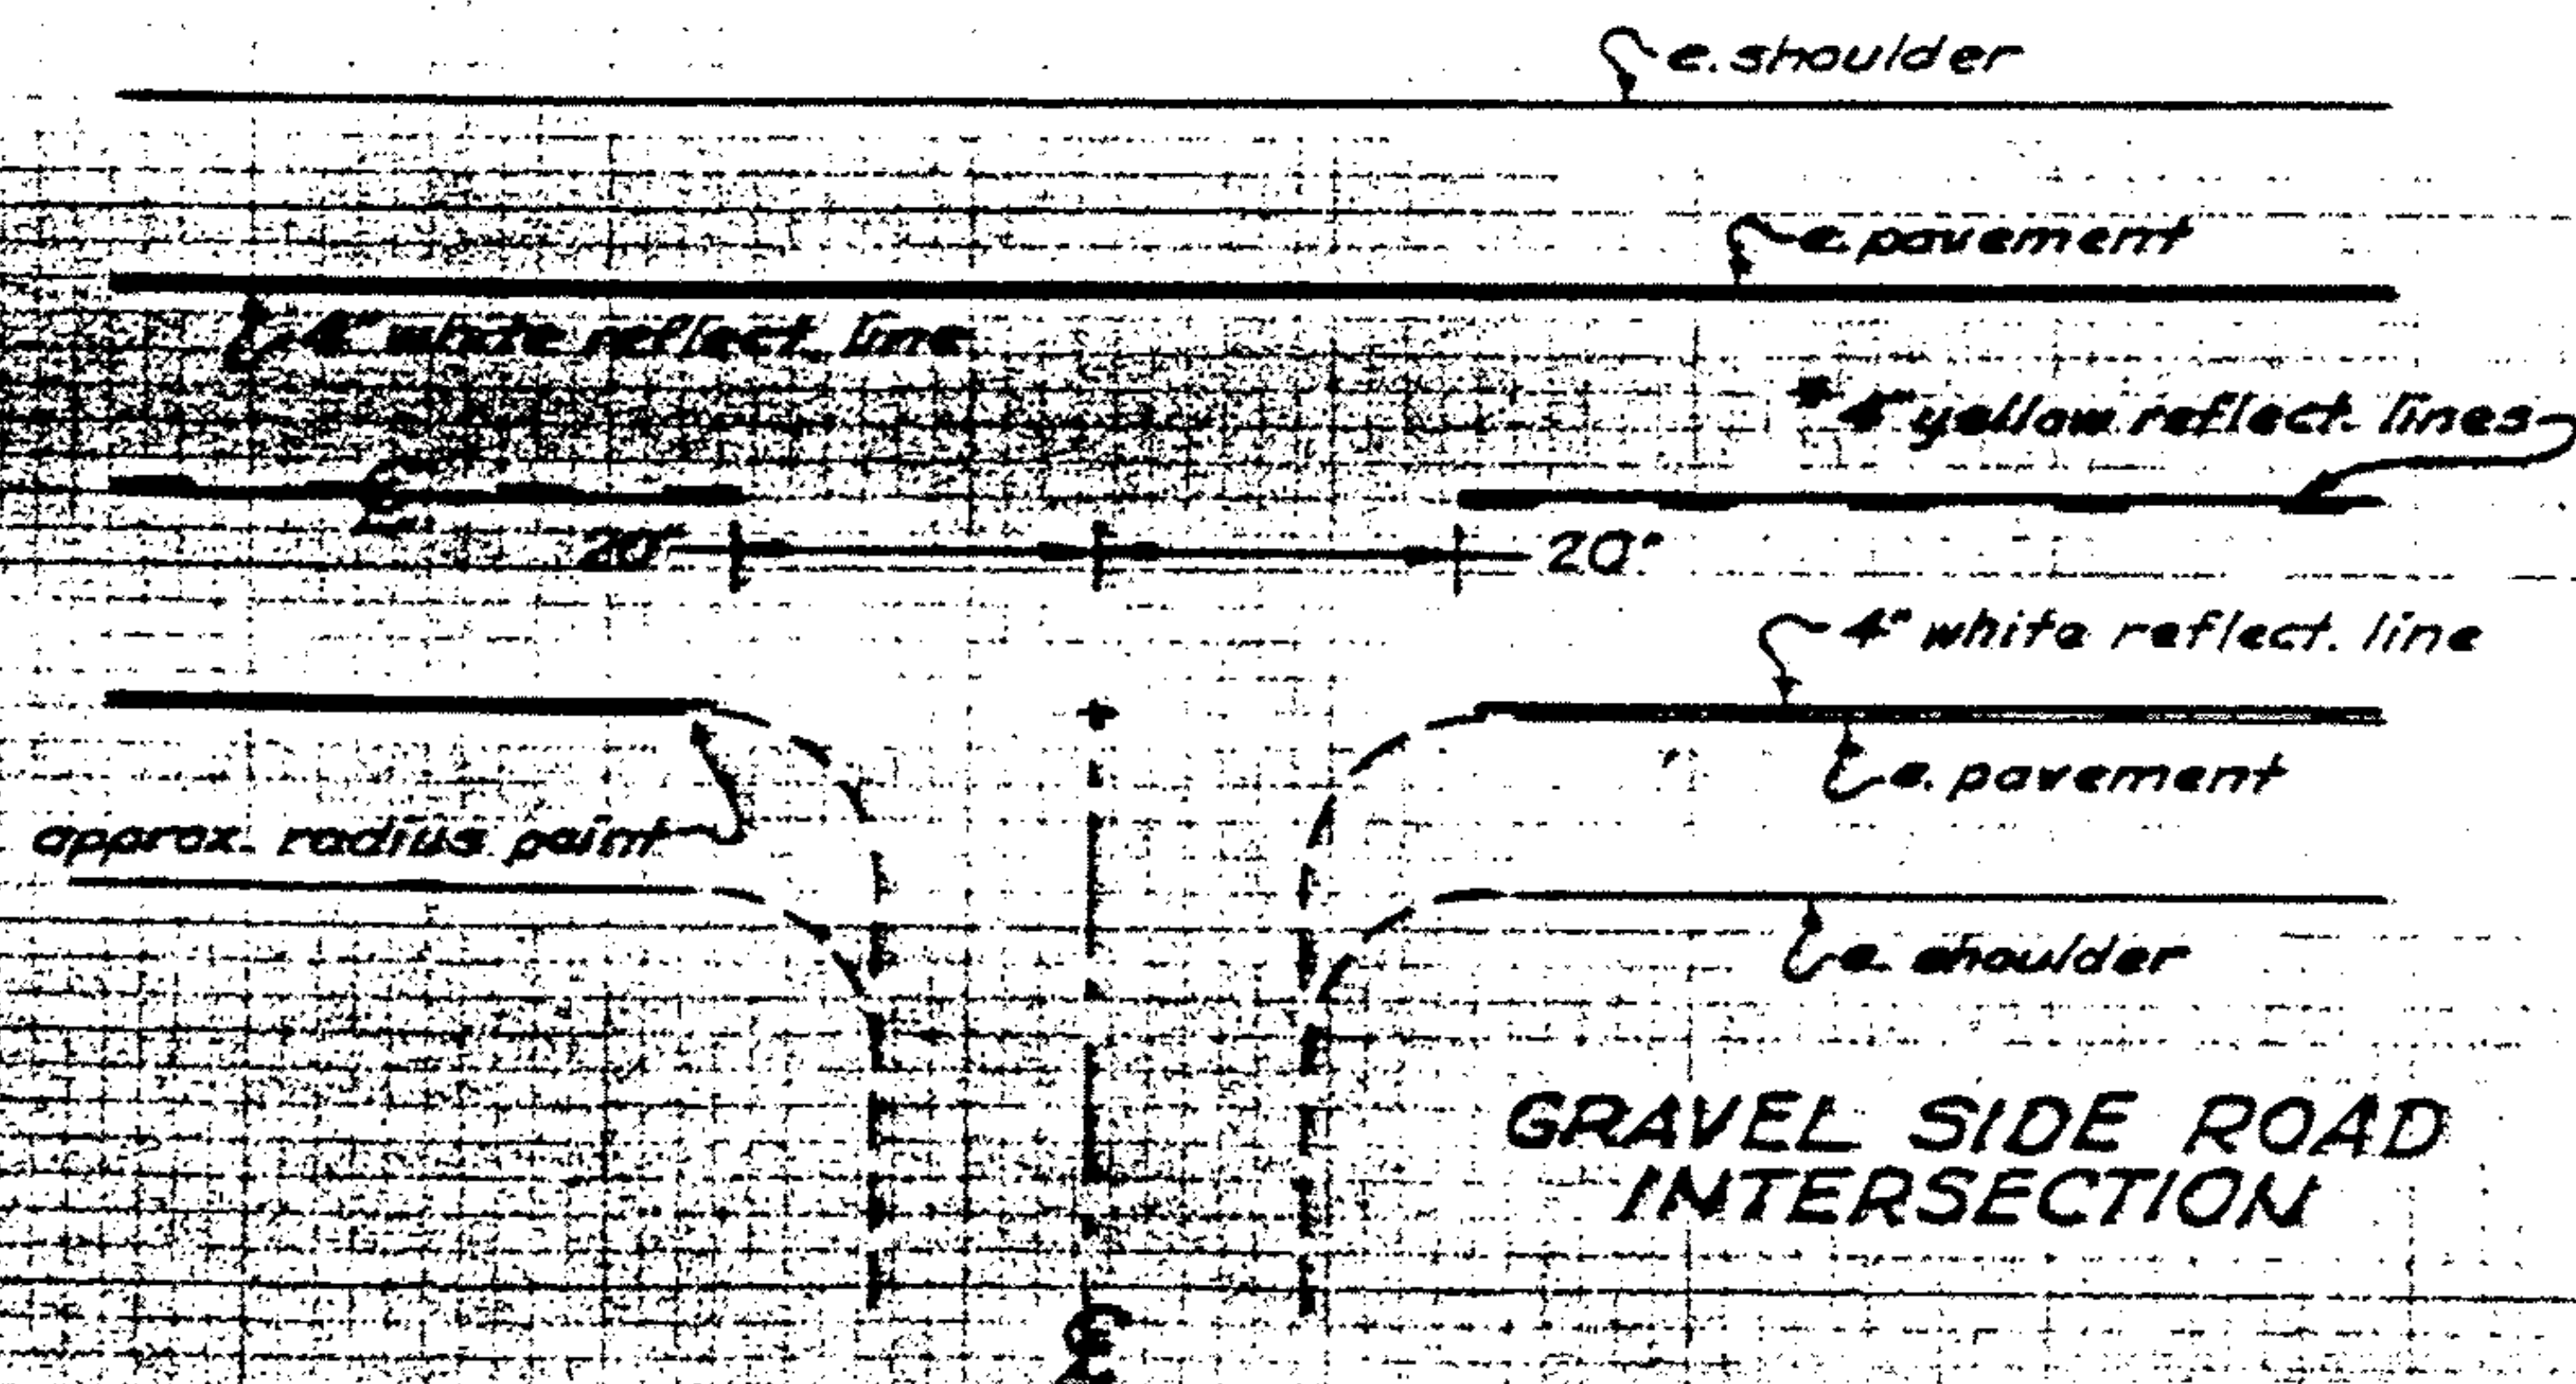

**GRAVEL SIDE ROAD
INTERSECTION**