


*PLEASE VERIFY PTFE SIZE TO BEARING LOADS.

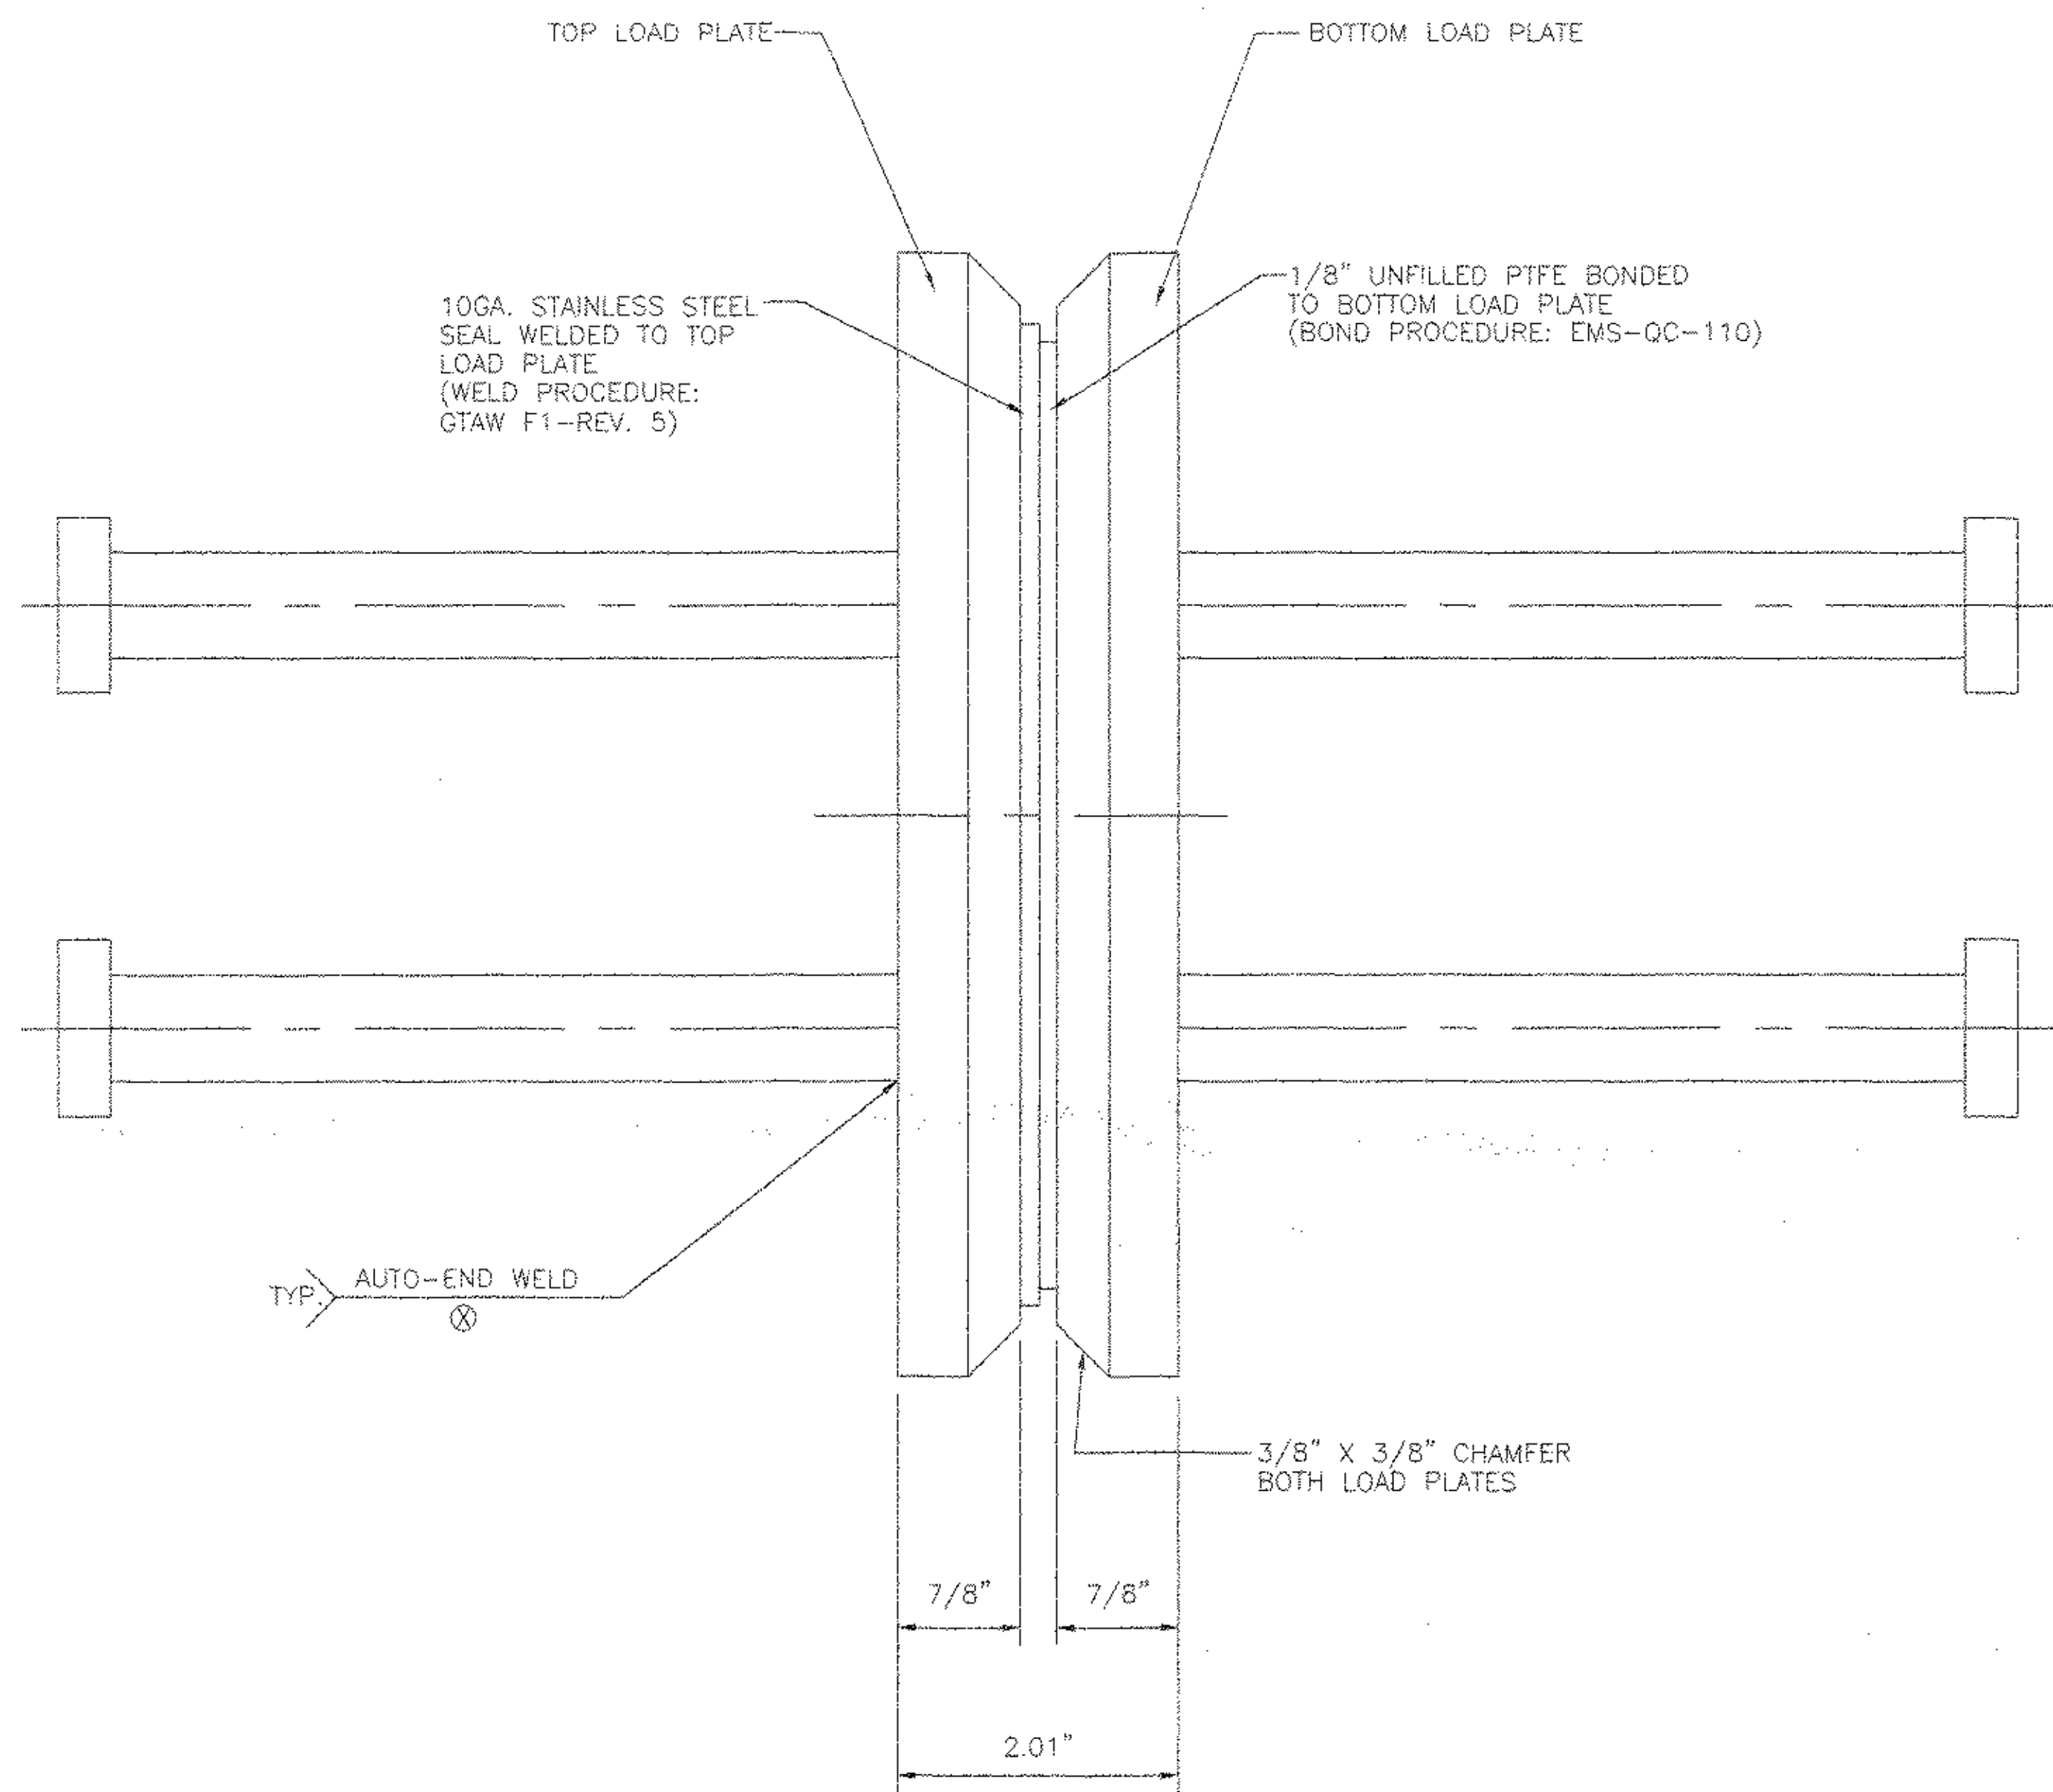

MATERIAL:
 STEEL - ASTM A709 GR. 50W ZINC METALIZED
 STAINLESS STEEL - ASTM A240 TYPE 304, 20 RMS FINISH OR LESS
 PTFE - ASTM D1457 VIRGIN UNFILLED

DECK BEARING DEVICE
 QUANTITY - 1
 *PLEASE VERIFY QUANTITY

- NOTES:**
1. BEARINGS MUST NOT BE DISASSEMBLED
 2. ALL BEARINGS SHALL BE METALIZED AS PER SECTION 531.04(b) & 506.15 (a) & (b). AREAS OF METALIZED DAMAGED BY FIELD WELDS OR HANDLING SHALL BE REPAIRED PER SUPPLEMENTAL SPECIFICATION 513.06(f).
 3. LOCATION OF FABRICATION PLANT - 70 SOUTH ST., WALPOLE, MA 02081
 4. COSMEC INC. REPRESENTATIVE - MR. MATT McANDREWS (508-668-6600)
 5. PROTECT PTFE & S.S. SURFACES FROM DIRT, WELD SPATTER, & ANY OTHER FOREIGN SUBSTANCES.

STATE OF VERMONT
 AGENCY OF TRANSPORTATION
 PROJ. NO. BRP 025-I(35)
 HIGHWAY VT 103
 VT 103 OVER THE WILLIAMS RIVER
 TOWN OF CHESTER

COSMEC, INC.		70 SOUTH STREET WALPOLE, MA 02081	
SCALE: 1"=1"	DRAWN BY: NH	CHECK BY: MCM	
SHEET: 3 OF 3	DATE: 8/23/03	DATE: 8/28/03	
COSMEC PTFE BEARING			
CUSTOMER: F.W. WHITCOMB	S.D. NUMBER: 59903	DRAWING NUMBER: 3923	REV.