


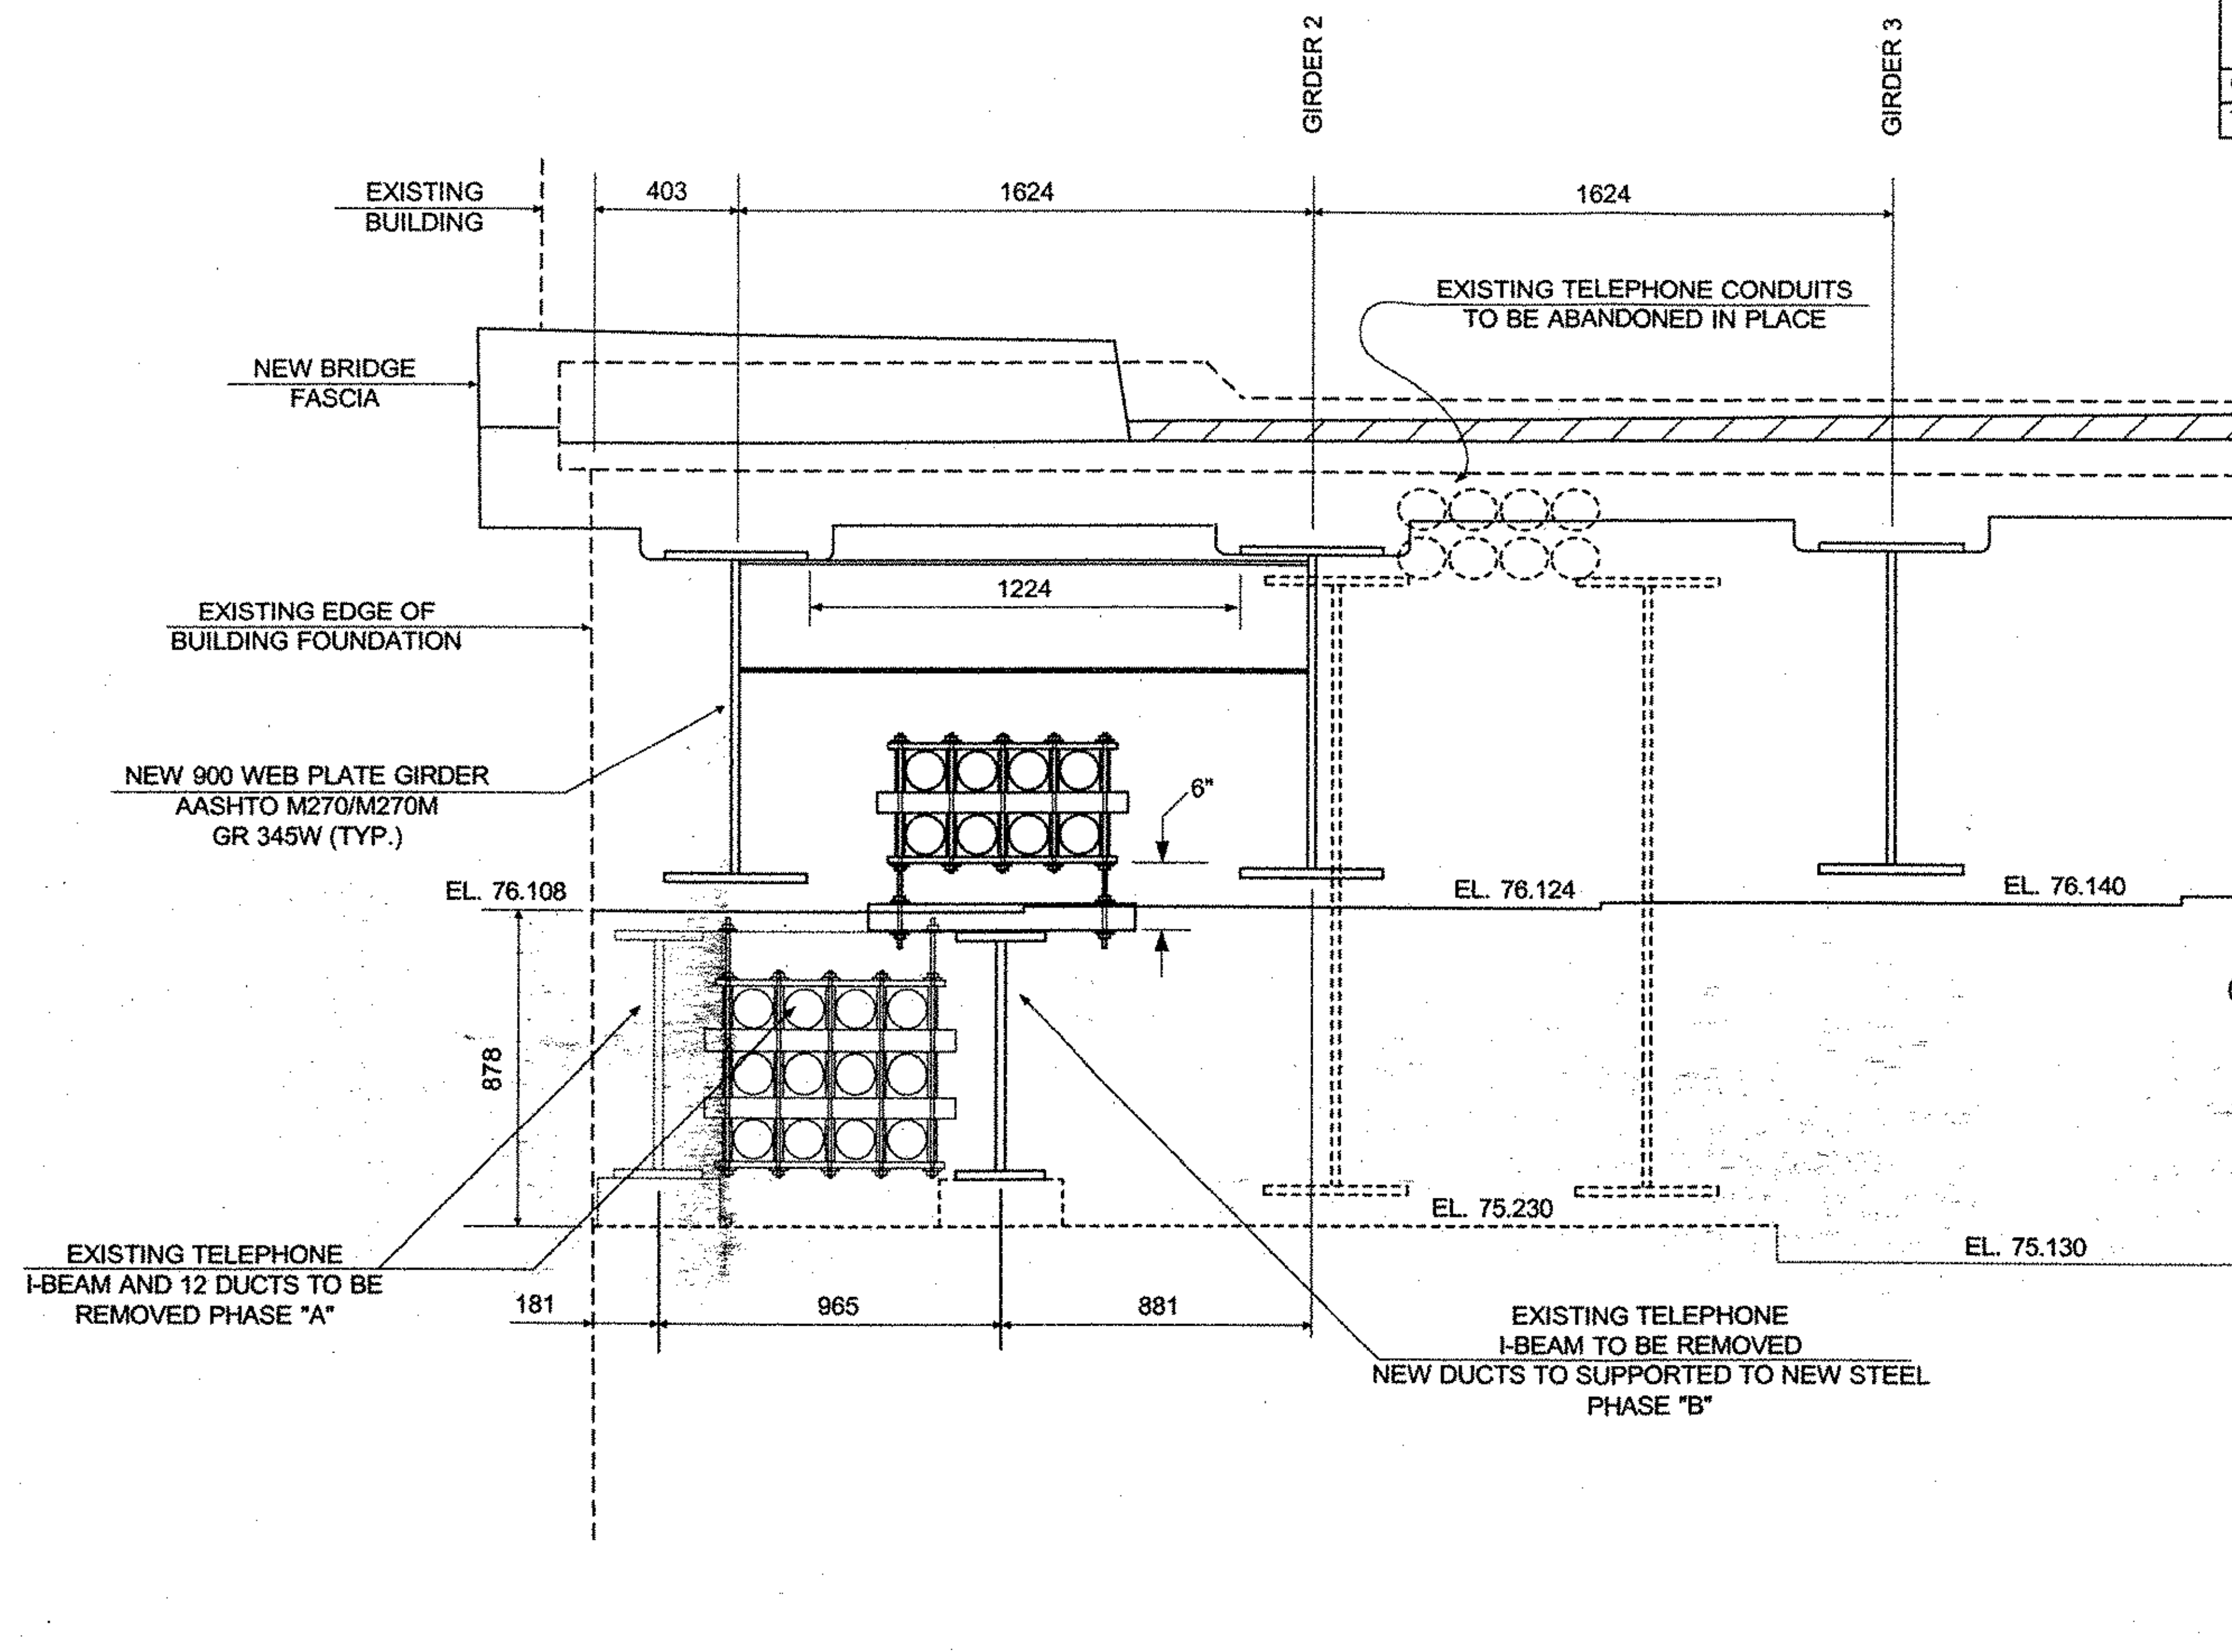
WORK ORDER

7AA01S


VERIZON

Notice: Not for Use/disclosure outside of VERIZON without written agreement

	SAFETY NOTES: INPUT	MOD/REV NO.	DATE	EWO NO. 7AA01S
				PRINT 14 OF
				PREPARED BY: NEIL E. SNYDER
	SIGNATURE	LT. NOTICE		C.O. /EXCHANGE NAME: BRATTLEBORO
DATE	TYPE	RECORD REF.	C.O. /EXCHANGE CODE:	
	INPUT	INPUT		
PRE CT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	AERIAL			4731
PRIMARY VOLTAGE TO GROUND	UNDERGROUND			MUNICIPALITY:
7.2 KV MGN SYSTEM	BLOCK (NYT)			BRATTLEBORO
	CONDUIT			
CABLE PRESS.	UNDER PRESS. YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	CONDUIT	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	MANHOLE LOCATION MH# NA
TRANSMISSION	26GA LIMIT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	AMT. BRIDGE TAP	-	KF



EXISTING AND PROPOSED TELEPHONE FACILITIES @ ABUTMENT NO. 2, LEFT SIDE PHASE "A"

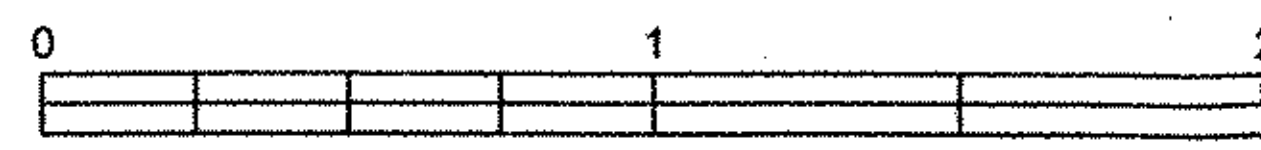

SCALE = 1 : 20

10/7/2002

107