
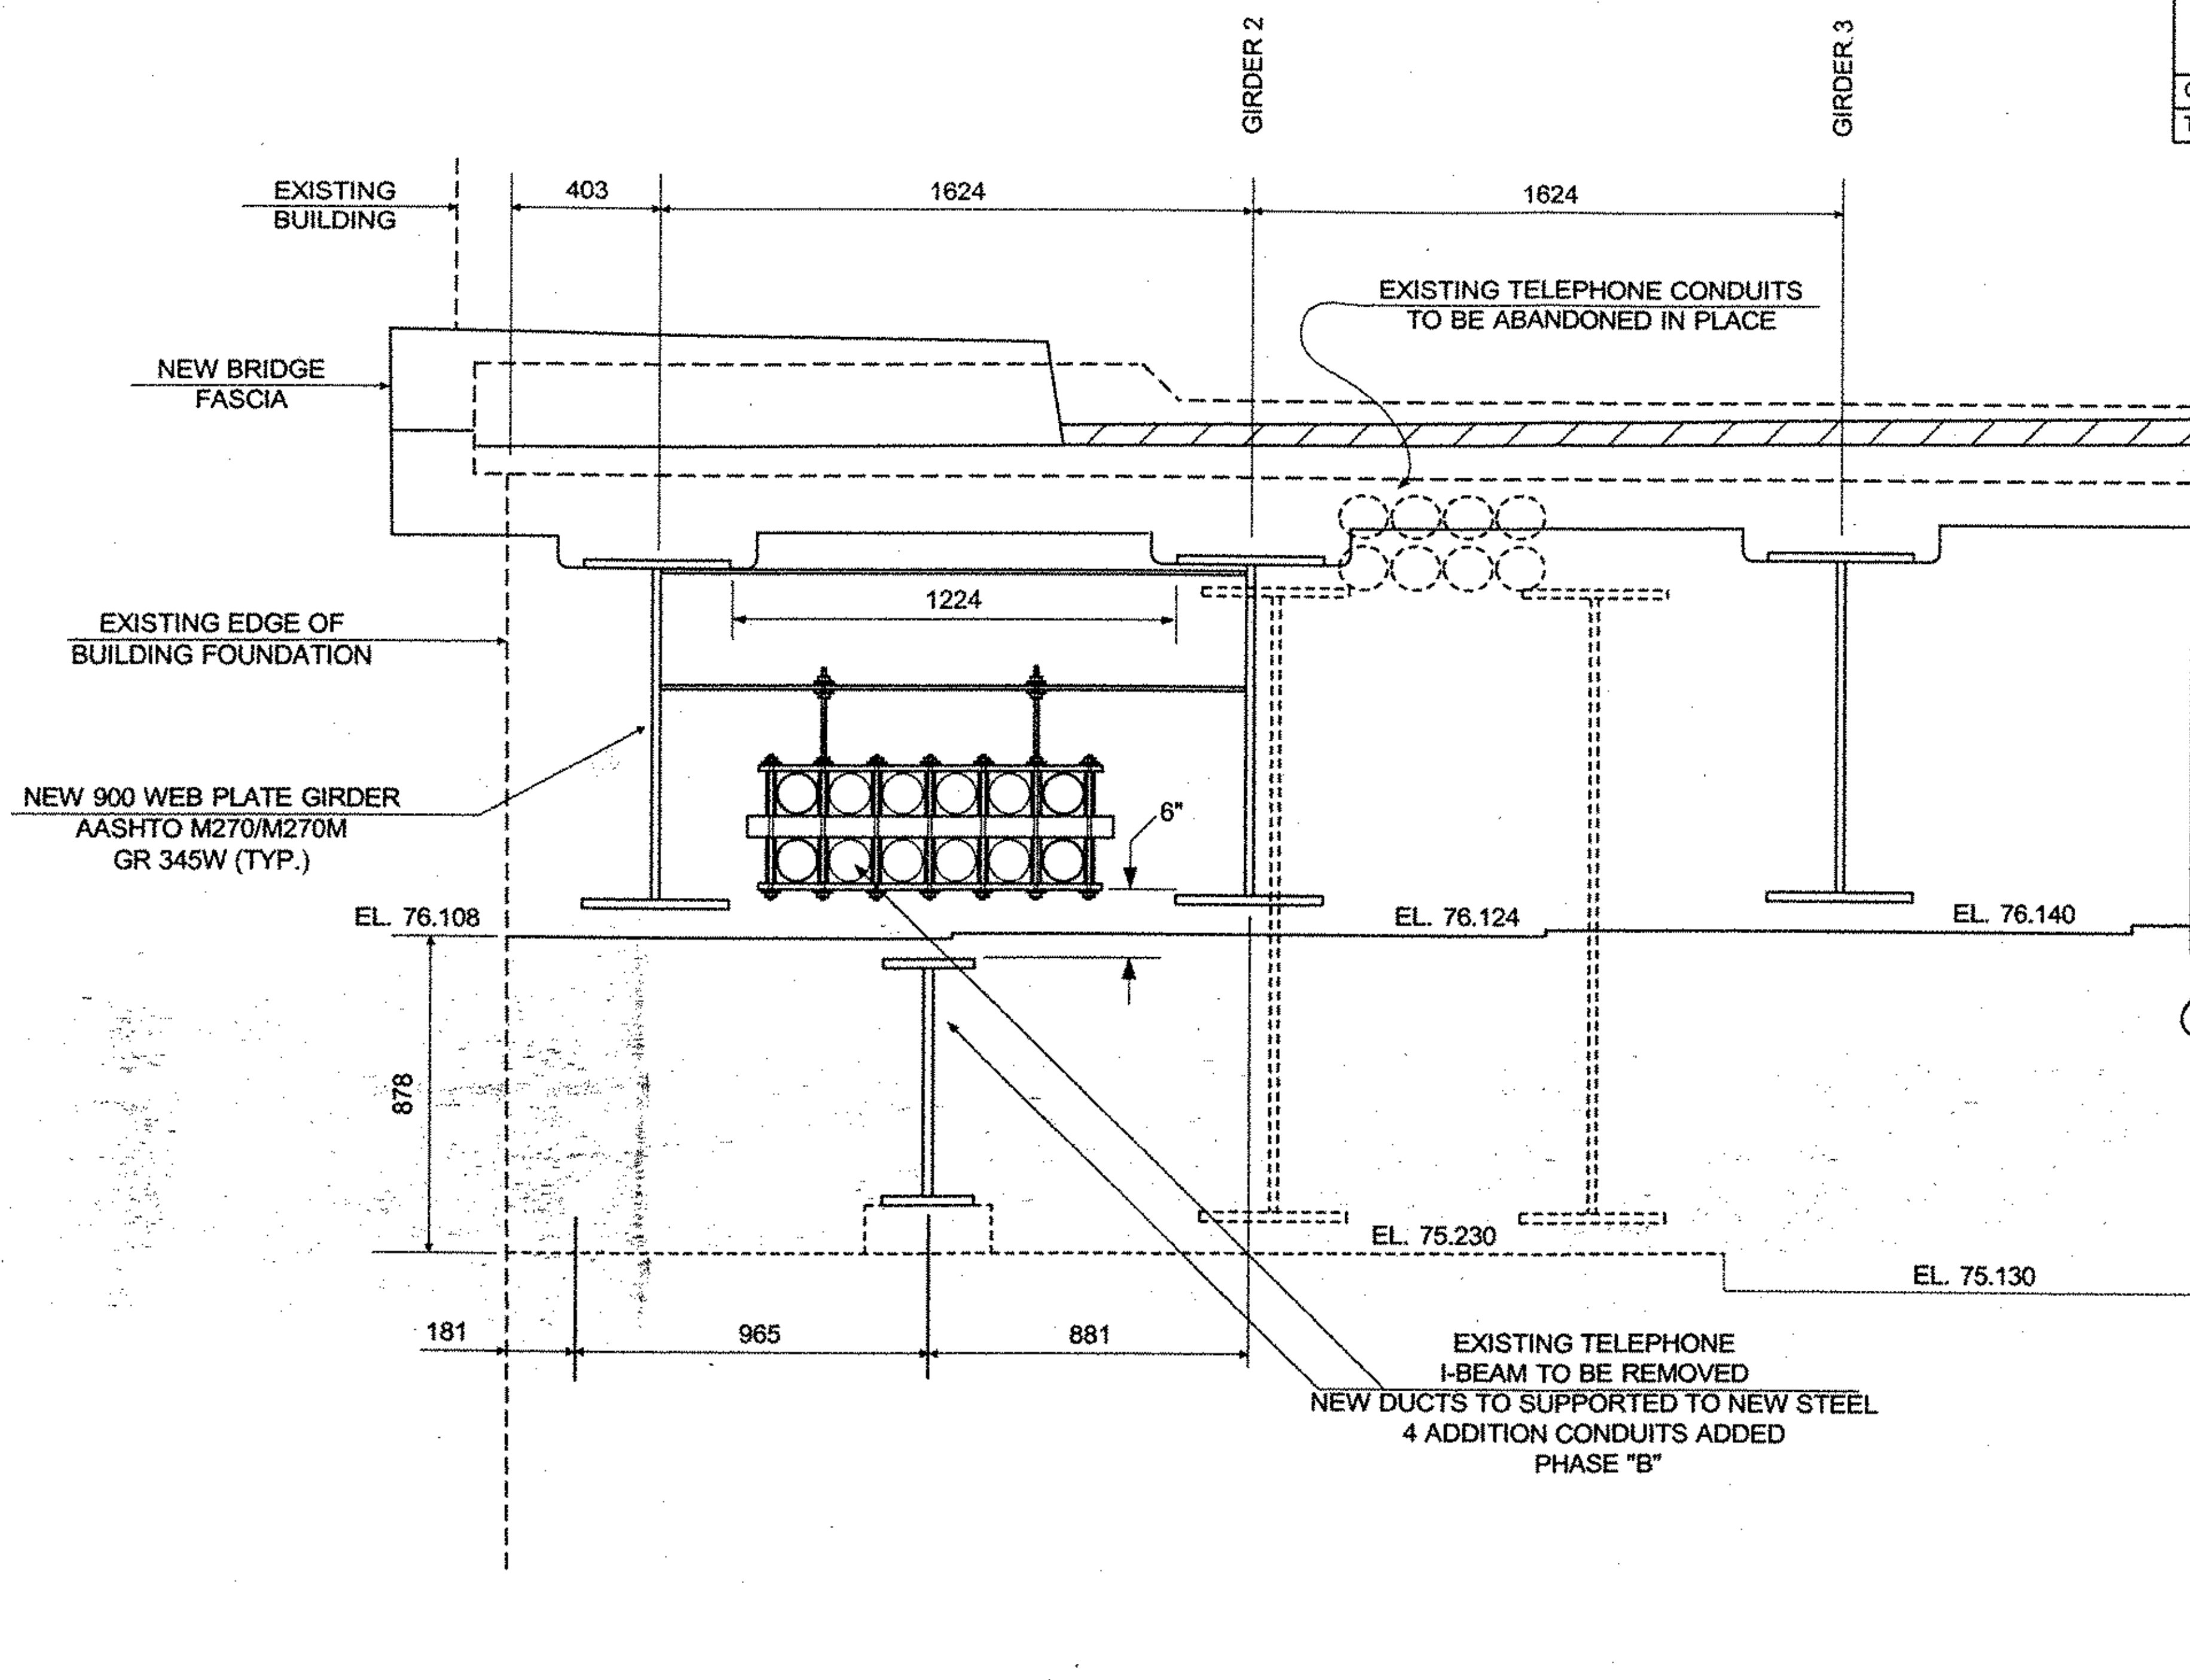



WORK ORDER

7AA01S  
 Notice: Not for Use/disclosure outside of VERIZON without written agreement  
**VERIZON**

 SAFETY NOTES: <b>INPUT</b>	MOD/REV NO.	DATE	EWO NO. <b>7AA01S</b>
			PRINT <b>15</b> OF
			PREPARED BY: NEIL E. SNYDER
			C.O. /EXCHANGE NAME: BRATTLEBORO
SIGNATURE	TYPE	RECORD REF.	C.O. /EXCHANGE CODE:
DATE	INPUT	AERIAL	INPUT
PRE CT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	UNDERGROUND	---	4731
PRIMARY VOLTAGE TO GROUND	BLOCK (NYT)	---	MUNICIPALITY:
7.2 KV MGN SYSTEM	CONDUIT	---	BRATTLEBORO
CABLE PRESS.	UNDER PRESS. YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	BUFFER YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	MANHOLE LOCATION MH# NA
TRANSMISSION	26GA LIMIT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	AMT. BRIDGE TAP -	KF



EXISTING AND PROPOSED TELEPHONE FACILITIES @ ABUTMENT NO. 2, LEFT SIDE  
 PHASE "B"

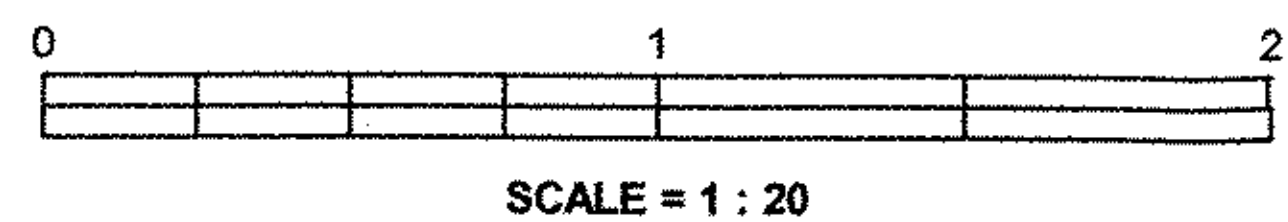

10/7/2002

108