


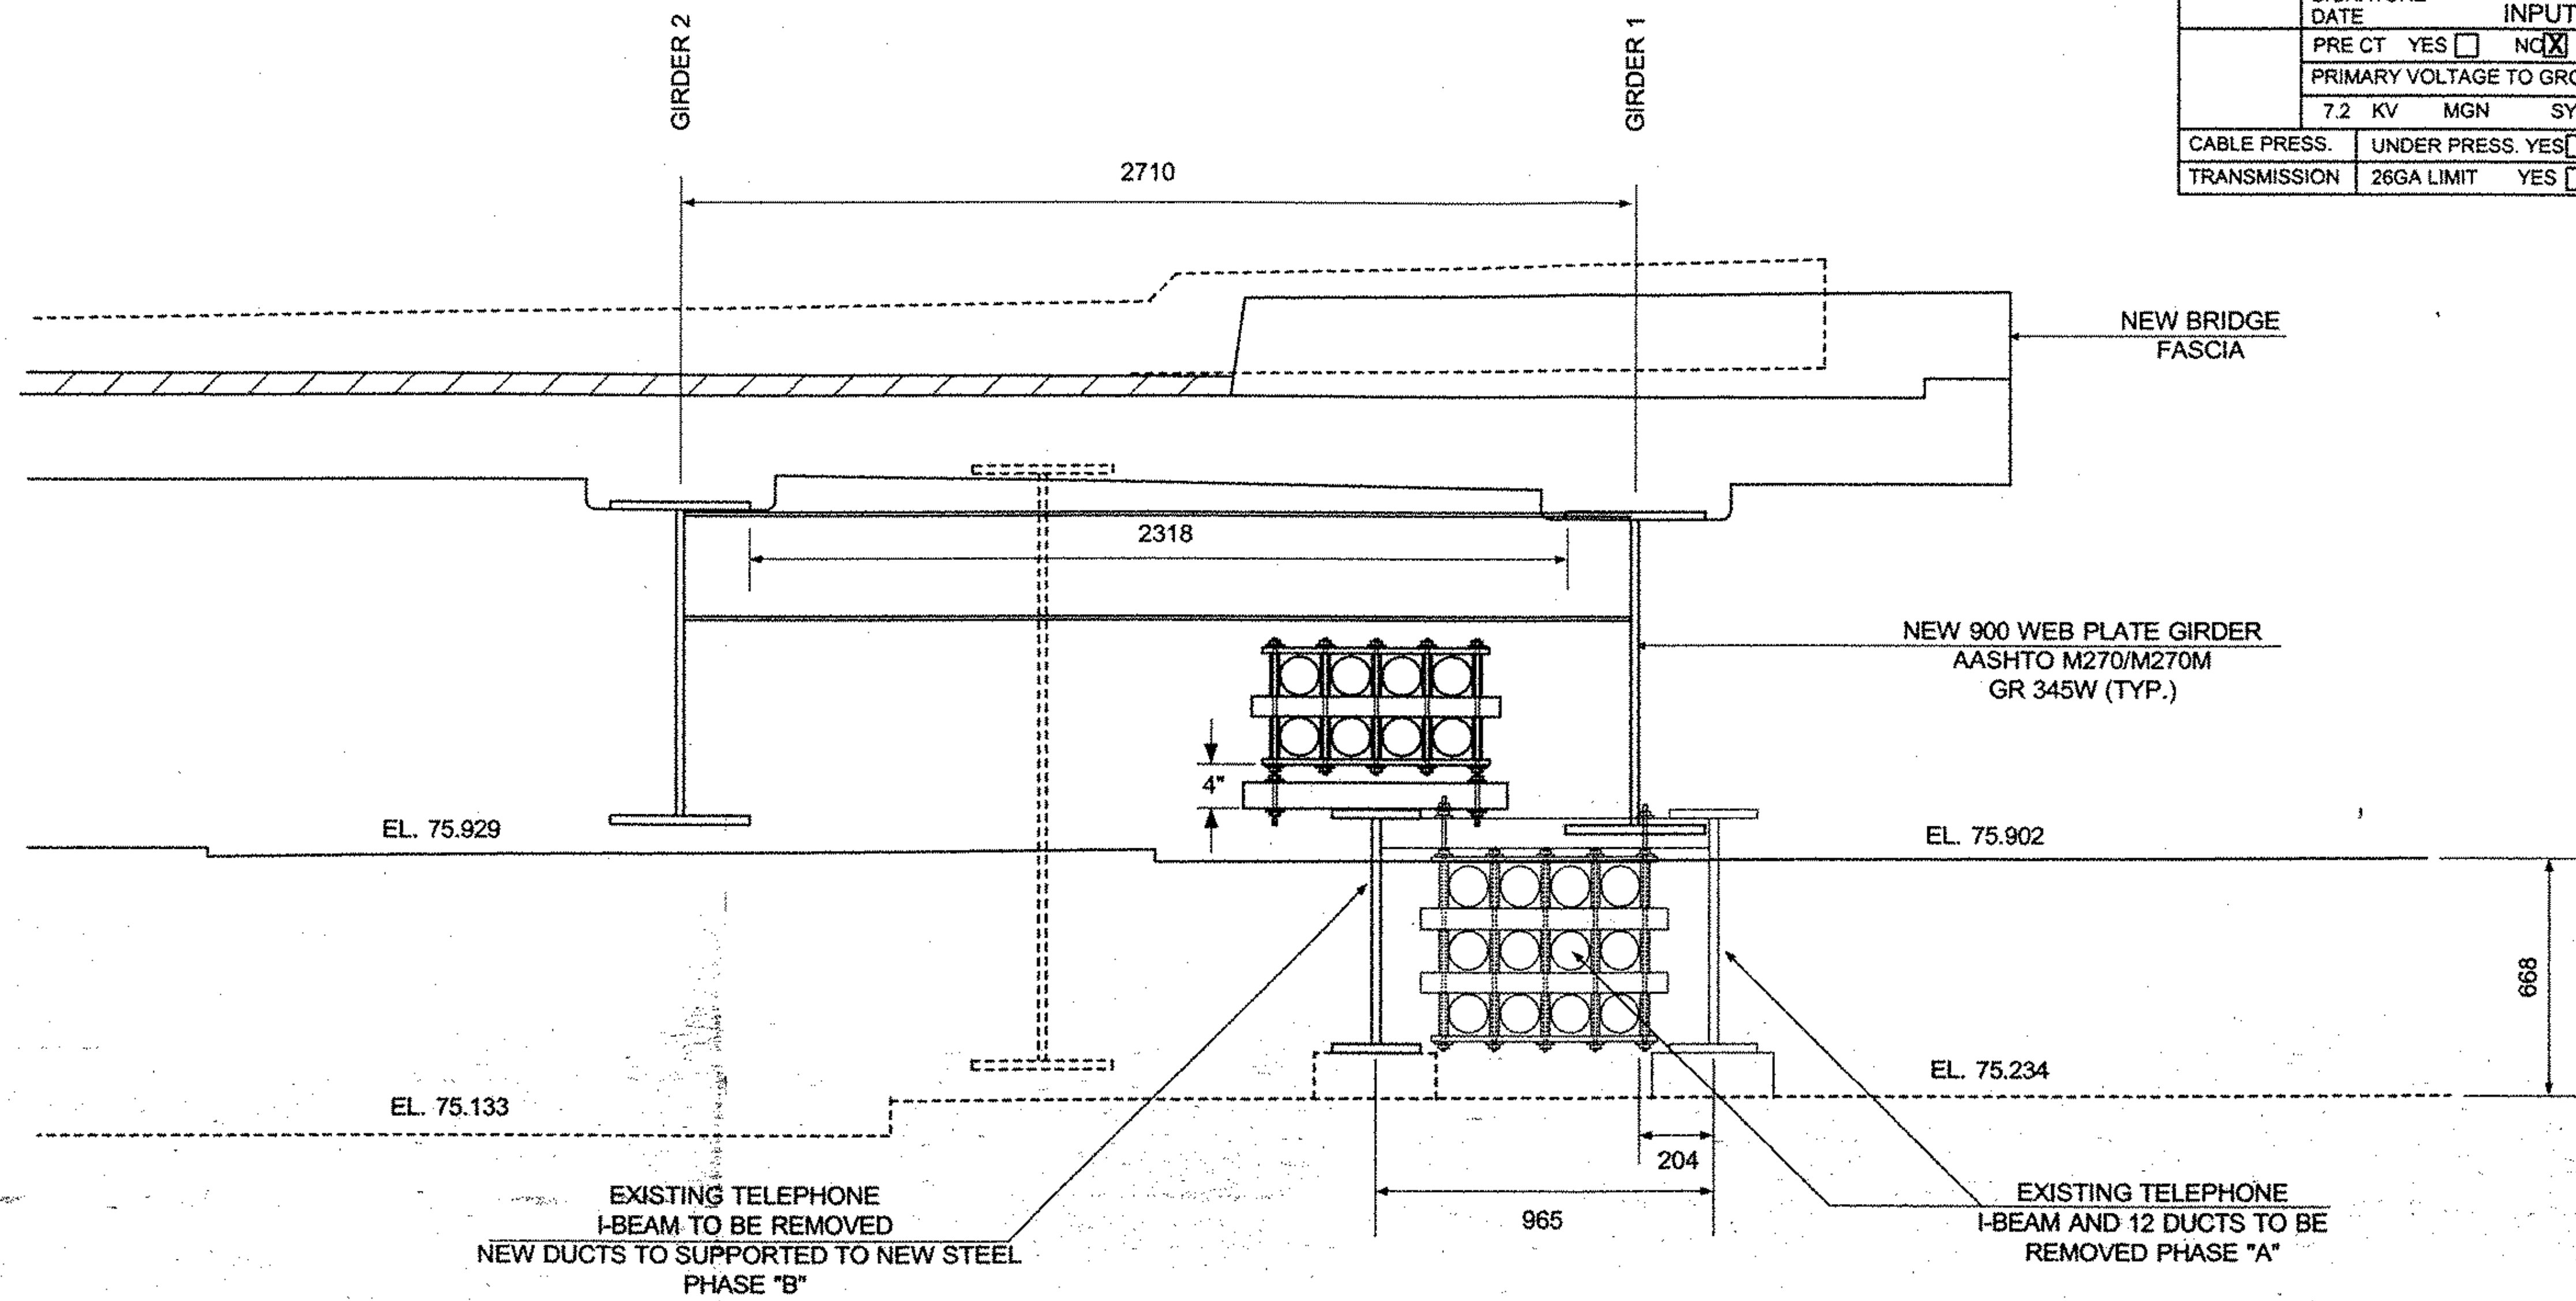
WORK ORDER

7AA01S


VERIZON

Notice: Not for Use/disclosure outside of VERIZON without written agreement

	SAFETY NOTES: INPUT	MOD/REV NO.	DATE	EWO NO. 7AA01S
	SIGNATURE			PRINT 16 OF
	DATE	INPUT		PREPARED BY: NEIL E. SNYDER
	PRE CT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	UNDERGROUND		RECORD REF: INPUT
PRIMARY VOLTAGE TO GROUND	BLOCK (NYT)		C.O. /EXCHANGE NAME: INPUT	
7.2 KV MGN SYSTEM	CONDUIT		C.O. /EXCHANGE CODE: INPUT	
CABLE PRESS. UNDER PRESS. YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	BUFFER YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		MANHOLE LOCATION MH# NA	
TRANSMISSION 26GA LIMIT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	AMT. BRIDGE TAP -		KF	



EXISTING AND PROPOSED TELEPHONE FACILITIES @ ABUTMENT NO. 1, LEFT SIDE PHASE "A"

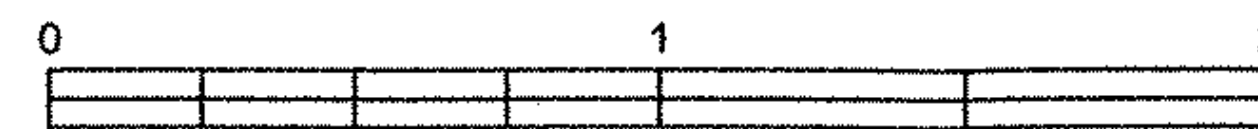

SCALE = 1 : 20