


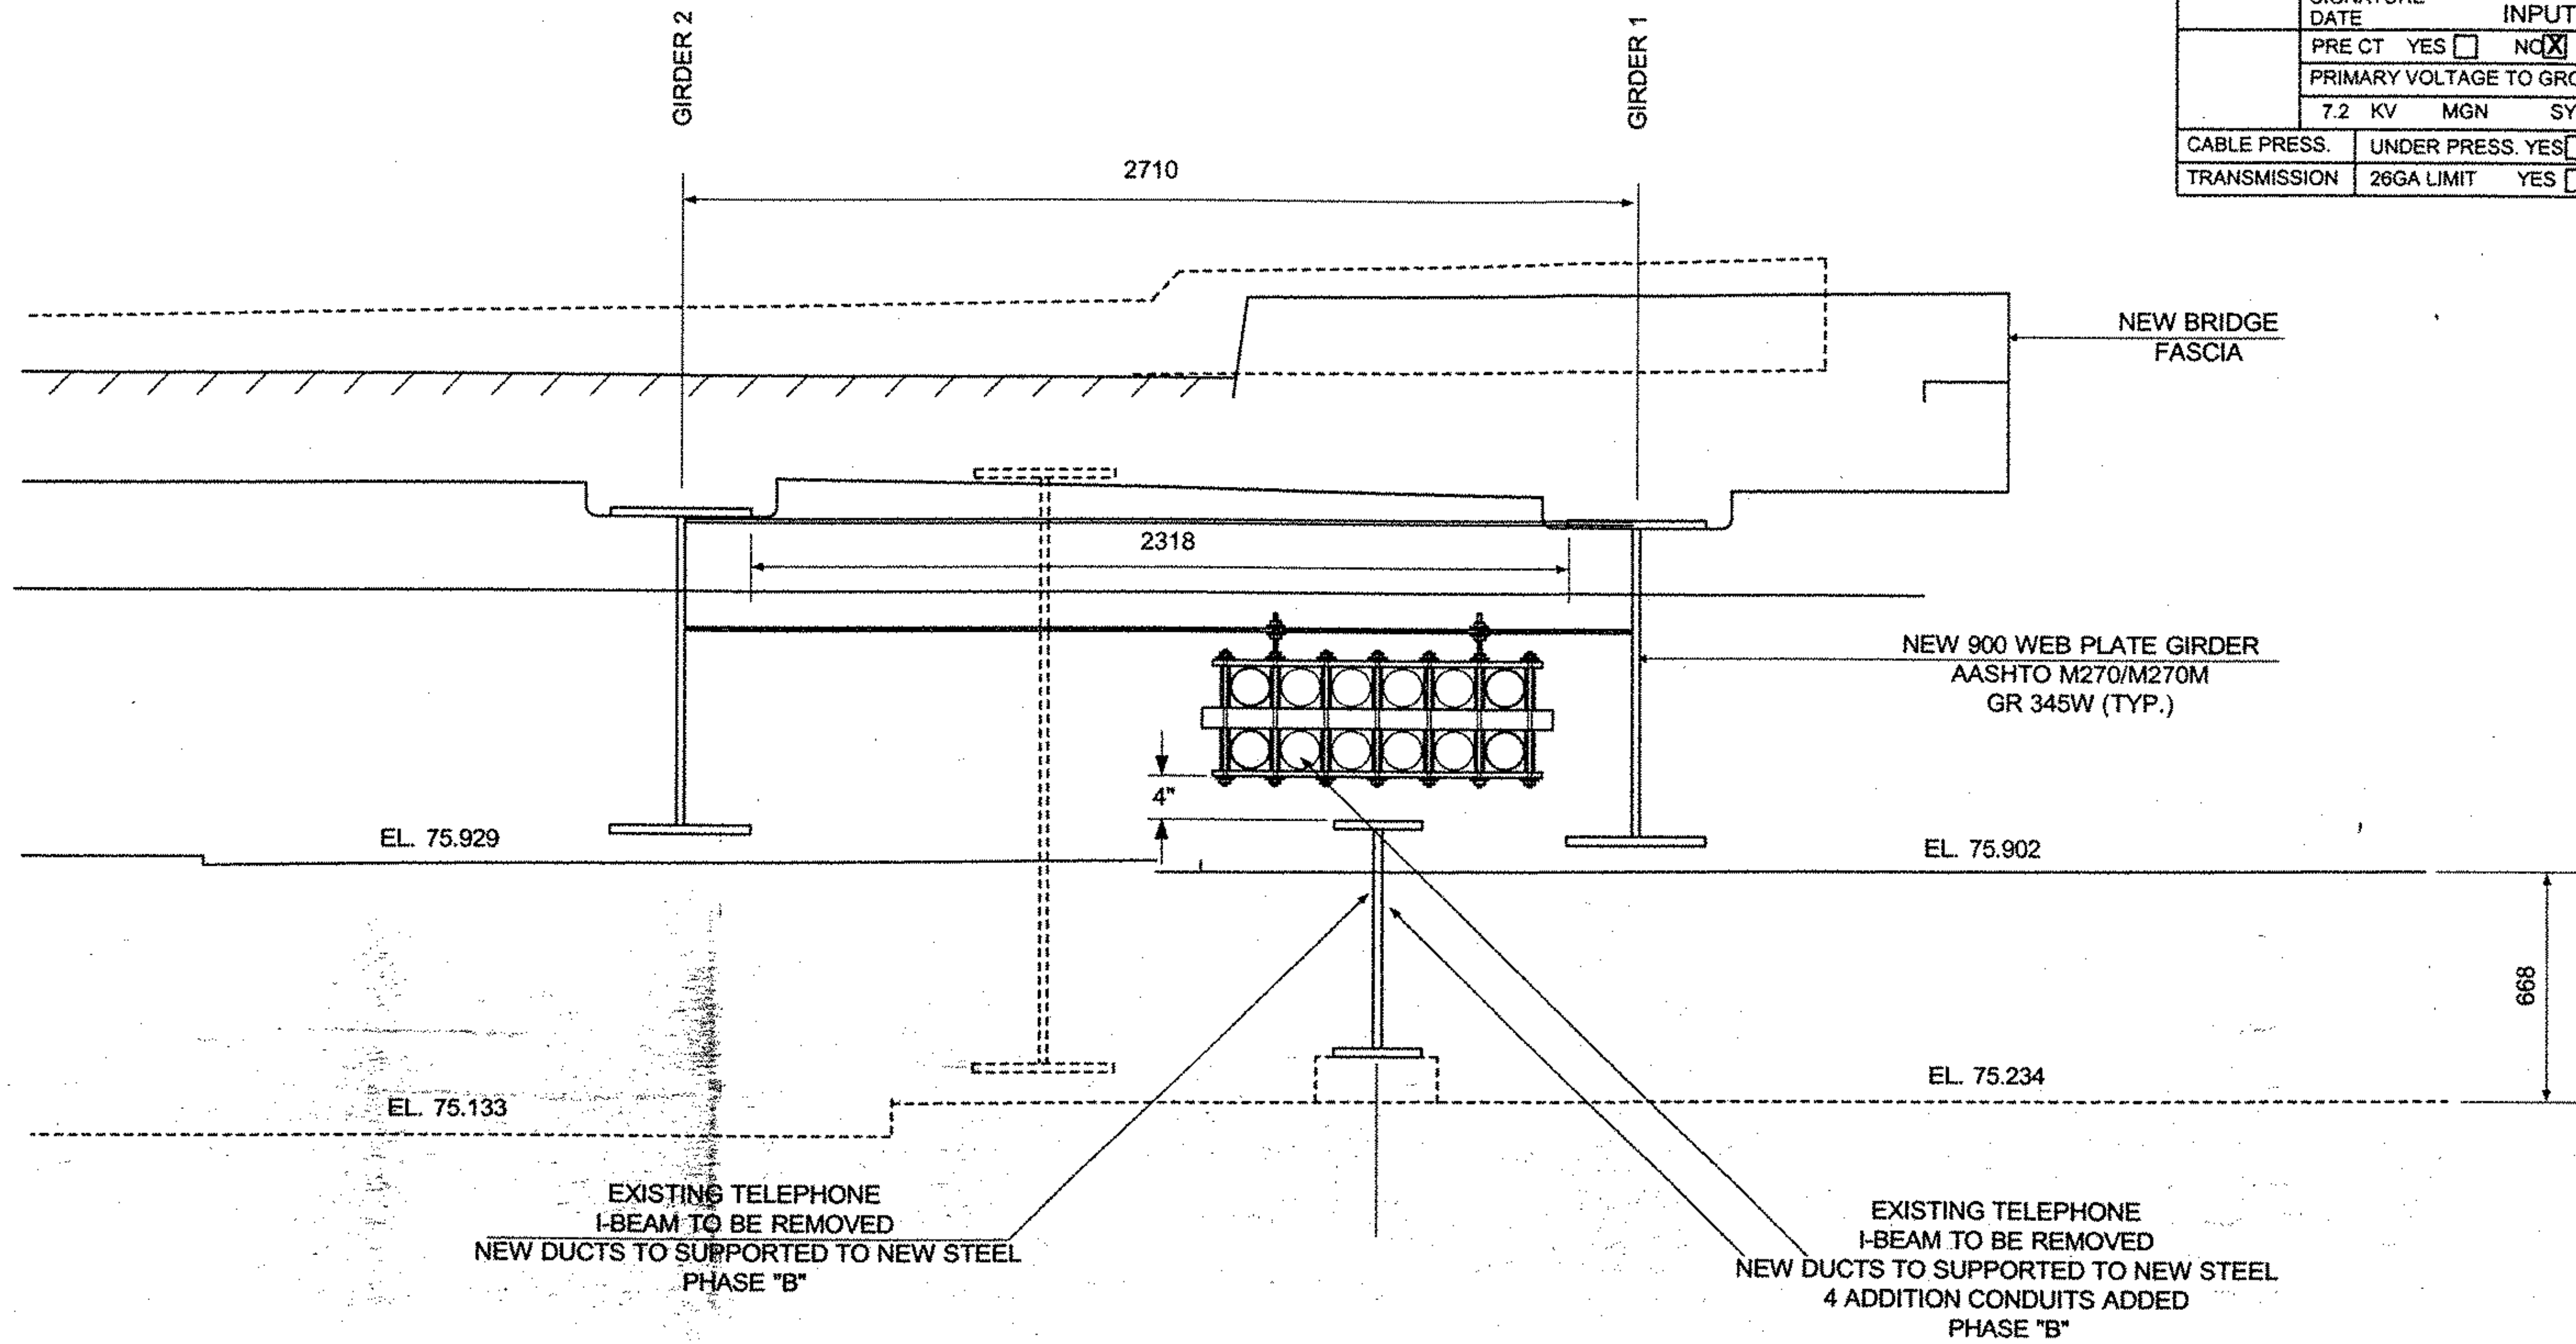
WORK ORDER

7AA01S

VERIZON

Notice: Not for Use/disclosure outside of VERIZON without written agreement

	SAFETY NOTES: INPUT		MOD/REV NO.	DATE	EWO NO. 7AA01S
	SIGNATURE				PRINT 17 OF
	DATE				PREPARED BY: NEIL E. SNYDER
	INPUT				C.O. /EXCHANGE NAME: INPUT
PRE CT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		UNDERGROUND			C.O. /EXCHANGE CODE: INPUT
PRIMARY VOLTAGE TO GROUND		BLOCK (NYT)			MUNICIPALITY: INPUT
7.2 KV MGN SYSTEM		CONDUIT			
CABLE PRESS.	UNDER PRESS. YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	BUFFER YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	MANHOLE LOCATION MH# NA		
TRANSMISSION	26GA LIMIT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	AMT. BRIDGE TAP -	KF		



EXISTING AND PROPOSED TELEPHONE FACILITIES @ ABUTMENT NO. 1, LEFT SIDE
PHASE "B"



SCALE = 1 : 20