
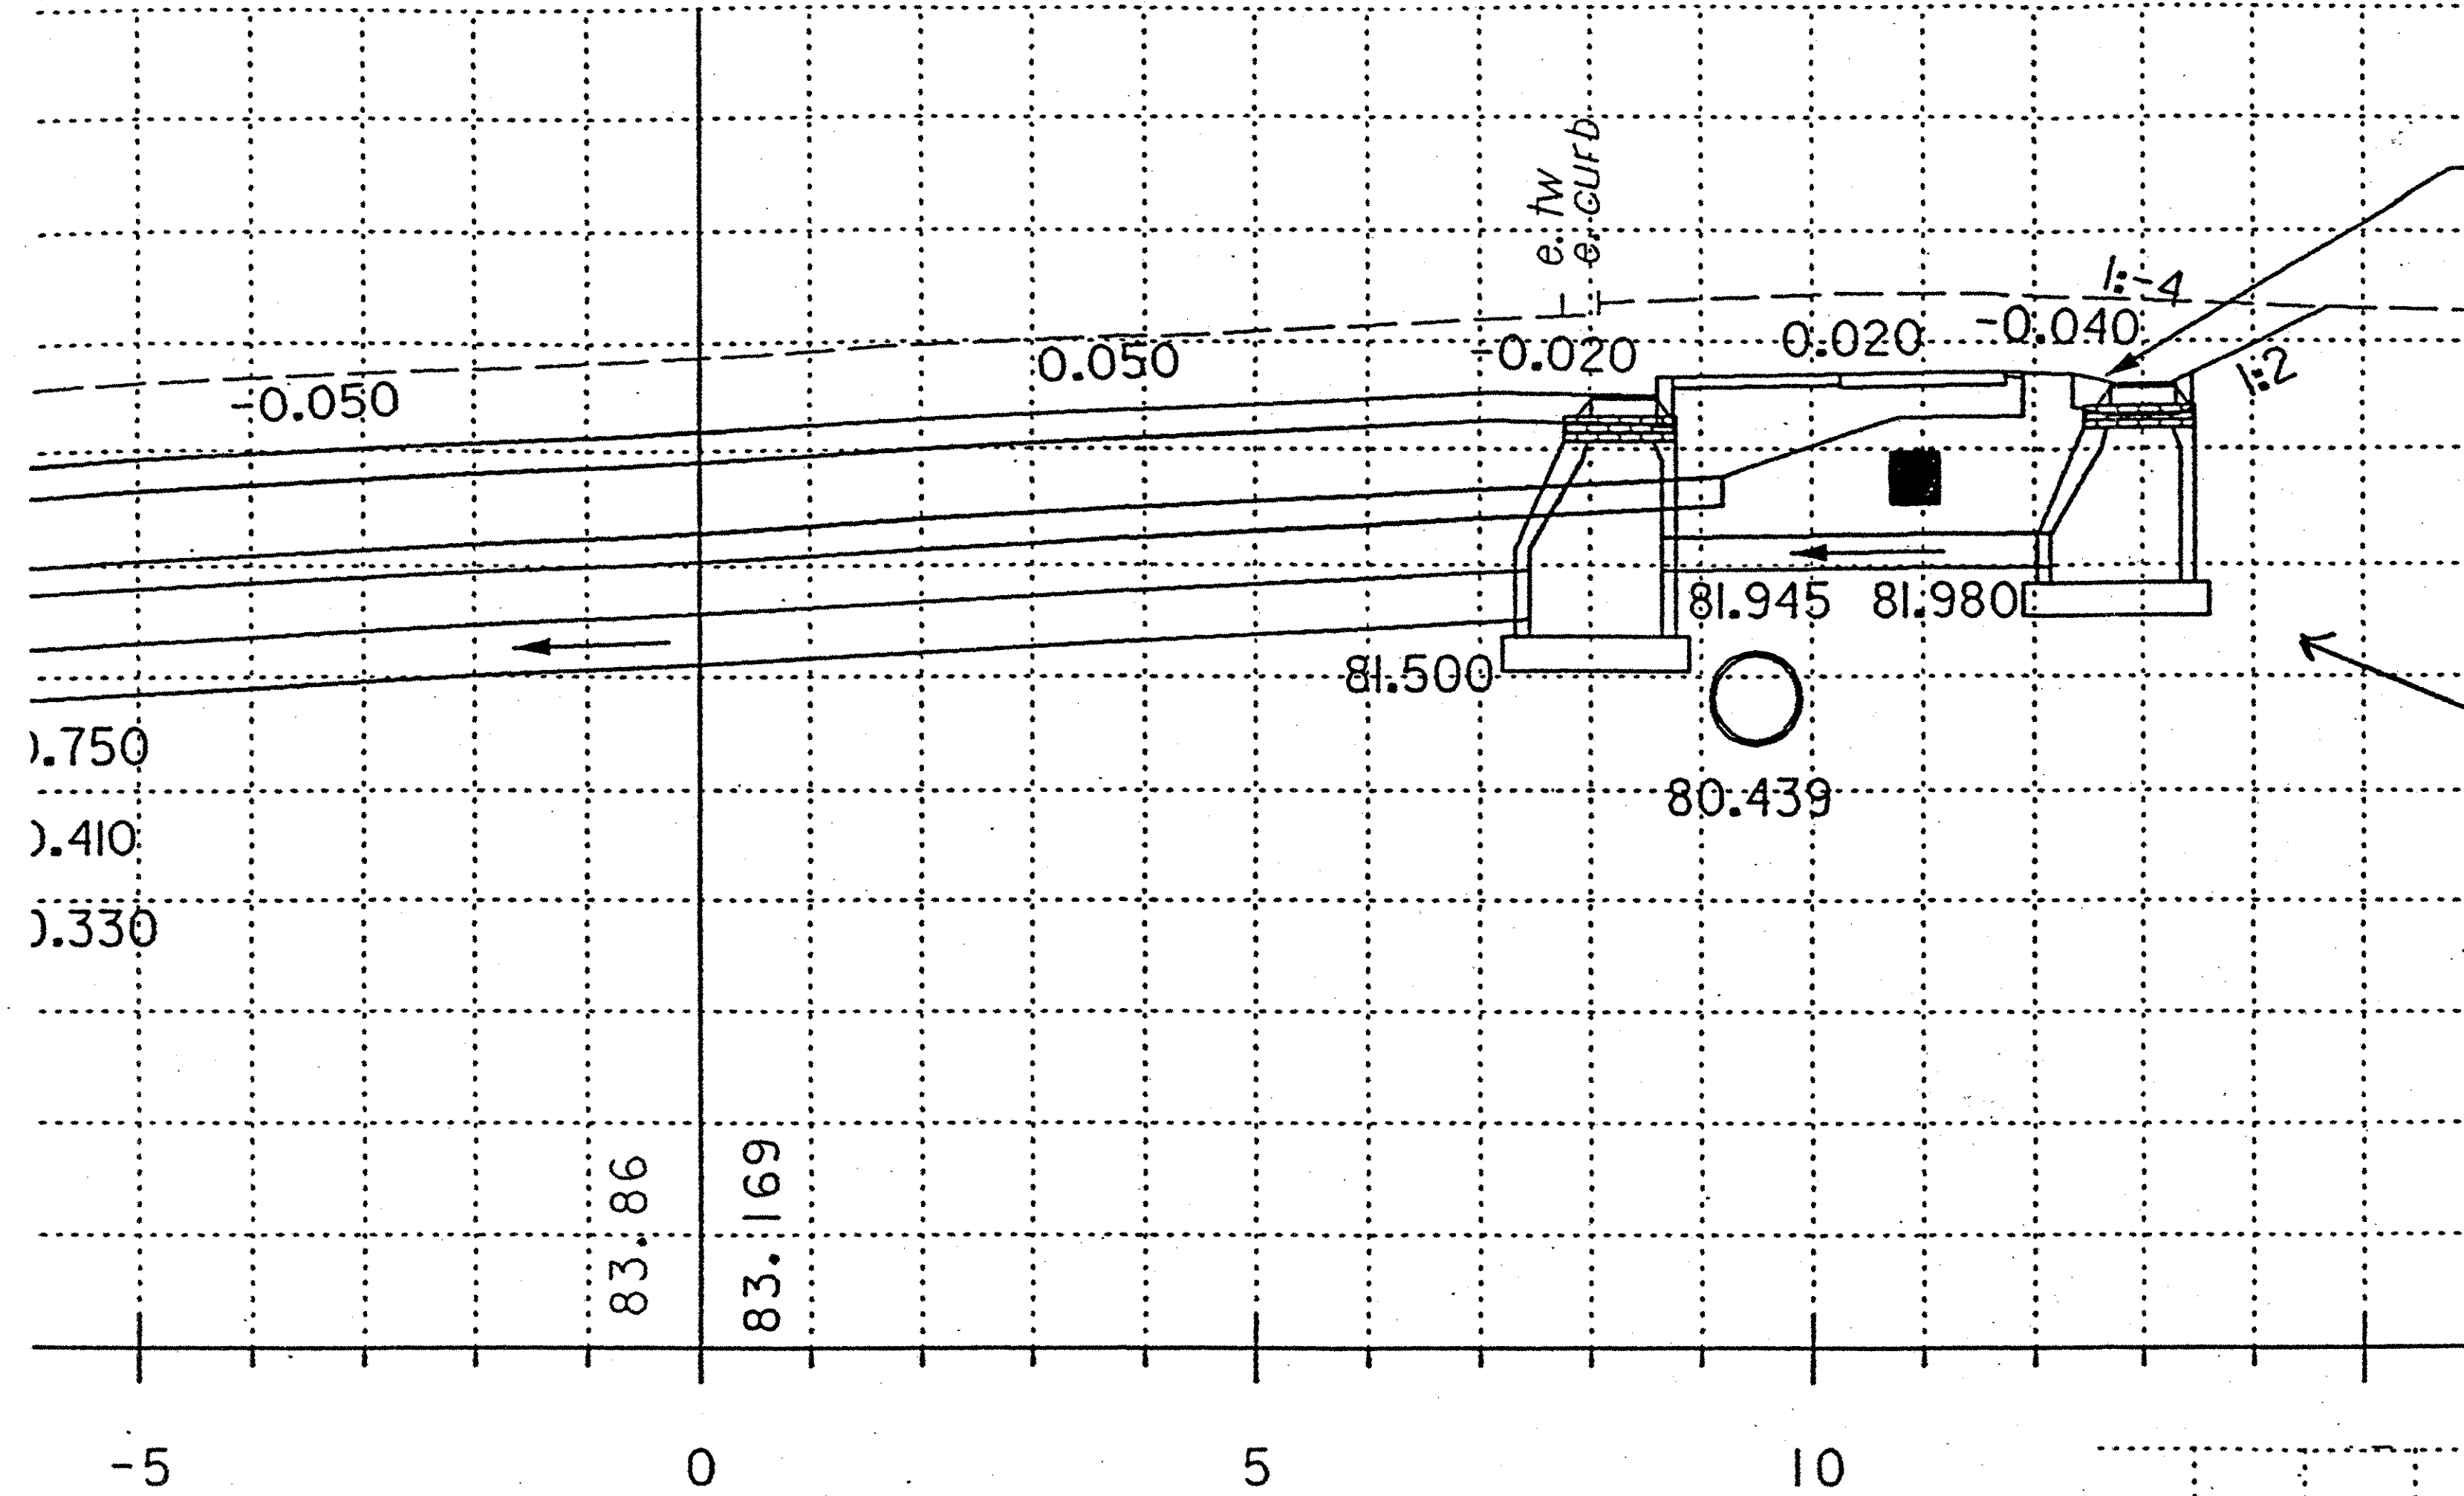


WORK ORDER

Notice: Not for Use/disclosure outside of VERIZON without written agreement

VERIZON

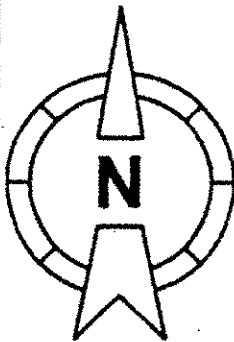


	SAFETY NOTES: TRAFFIC, ROAD CONSTRUCTION		MOD/REV NO.	DATE	EWO NO.
	SIGNATURE DATE 3/1/2001				PRINT 6 OF
PRE CT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		TYPE		C.O. /EXCHANGE NAME: BRATTLEBORO	
PRIMARY VOLTAGE TO GROUND 7.2 KV MGN SYSTEM		RECORD REF: 1-4E		C.O. /EXCHANGE CODE: 4731	
CABLE PRESS. UNDER PRESS. YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		CONDUIT		MUNICIPALITY: BRATTLEBORO	
TRANSMISSION 26GA LIMIT YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		AMT. BRIDGE TAP INPUT		MANHOLE LOCATION MH# NA	
		BUFFER YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		KF	

PROPOSED TELCO DUCTS

PROJECT #131104

30+180.000

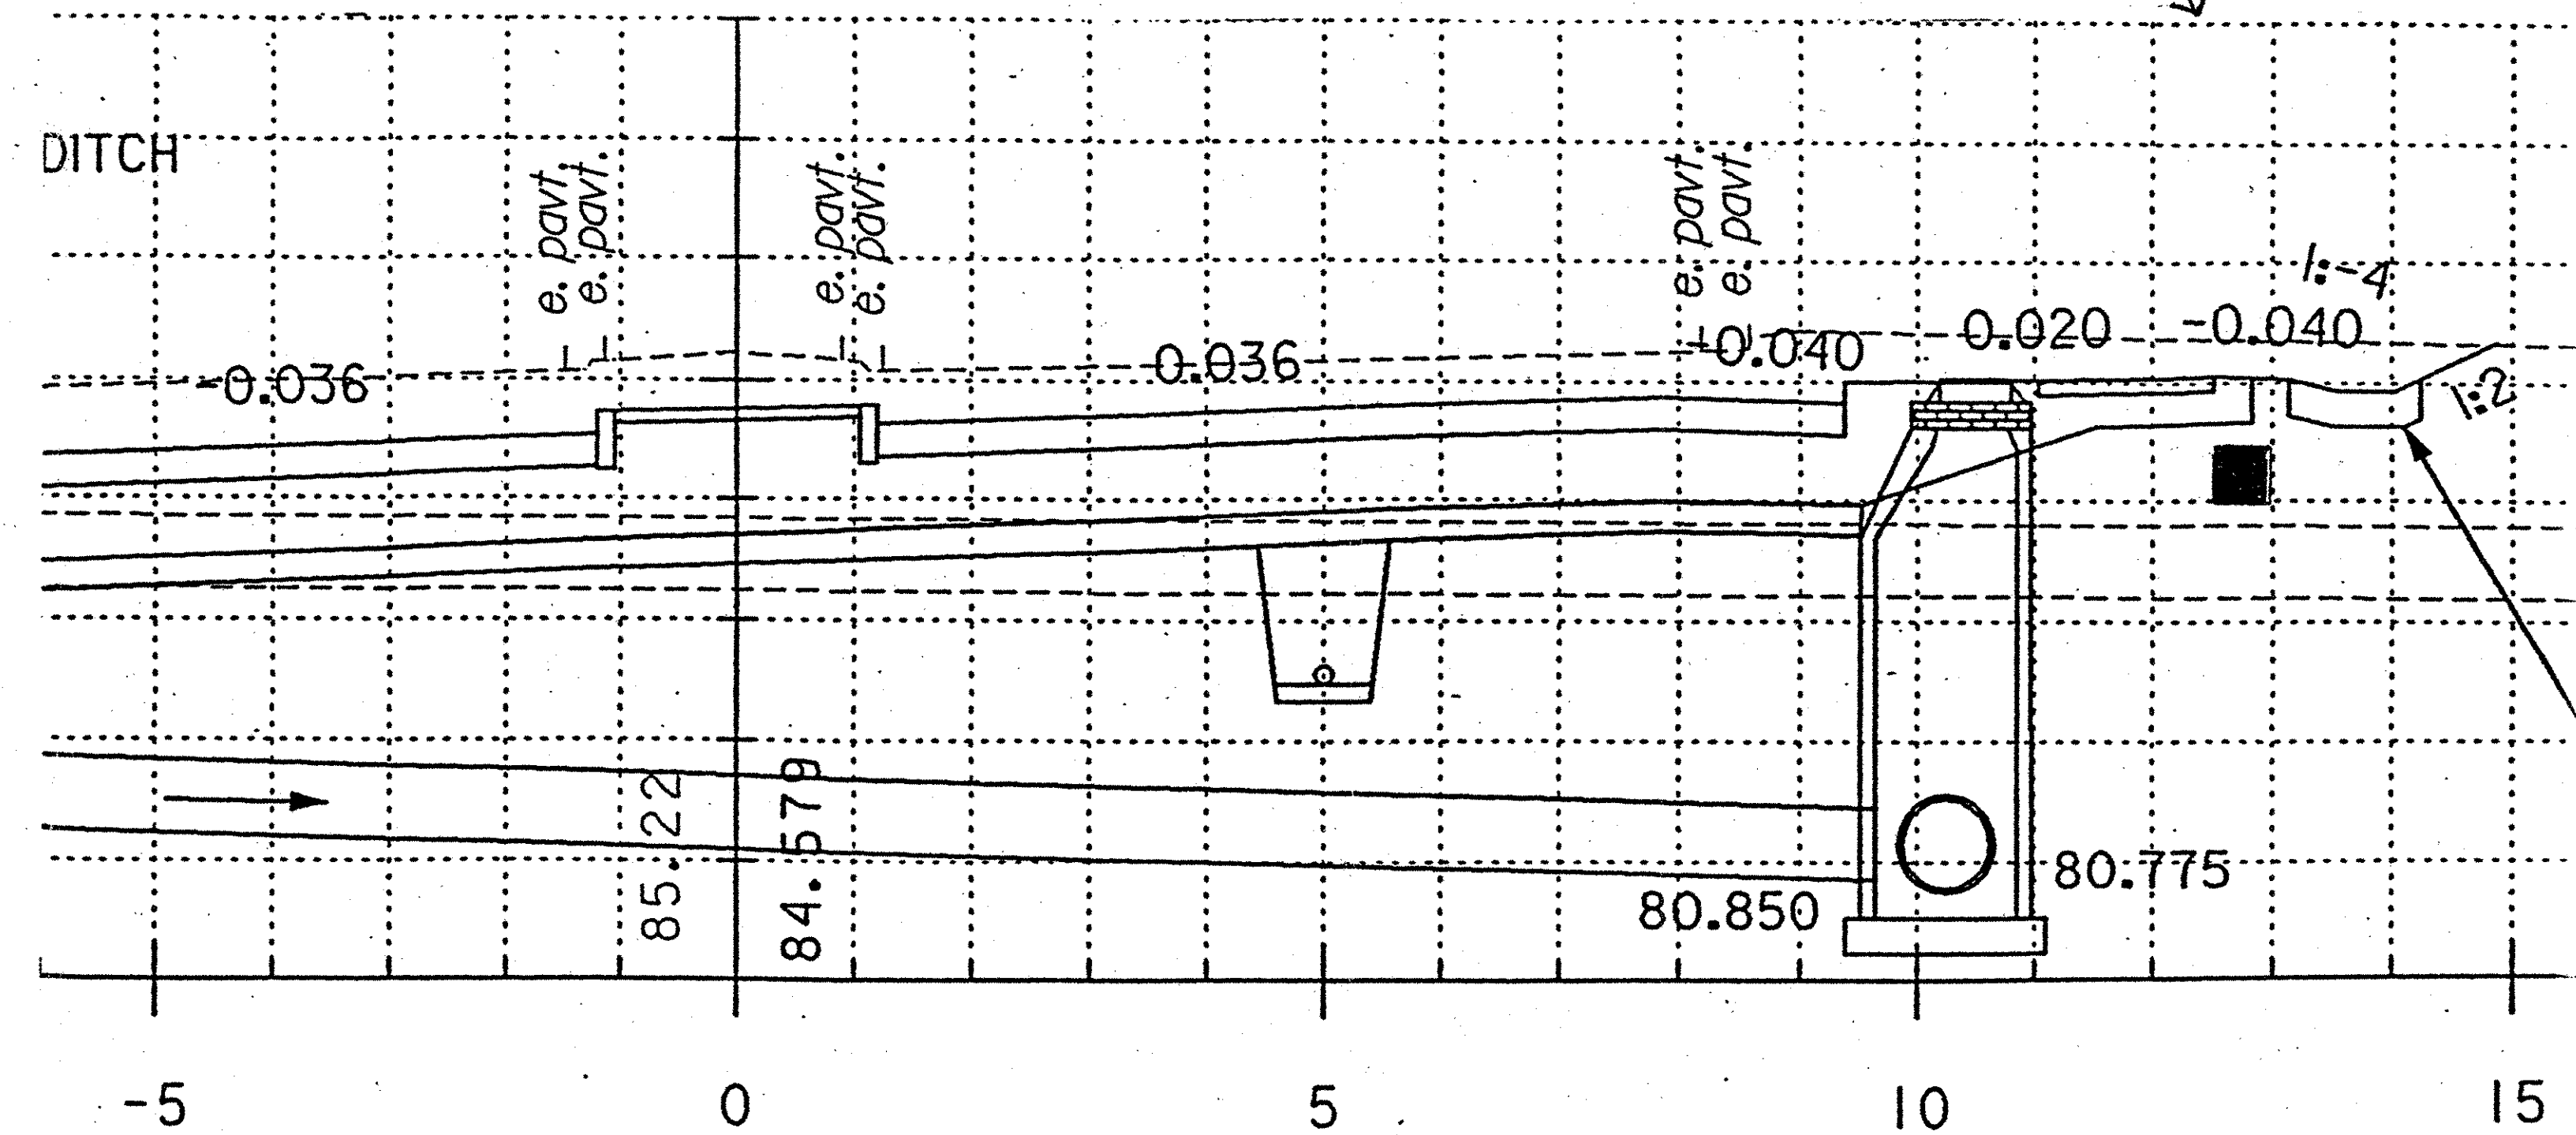

30+148.400

NOT TO SCALE

145F

3/2/2001