

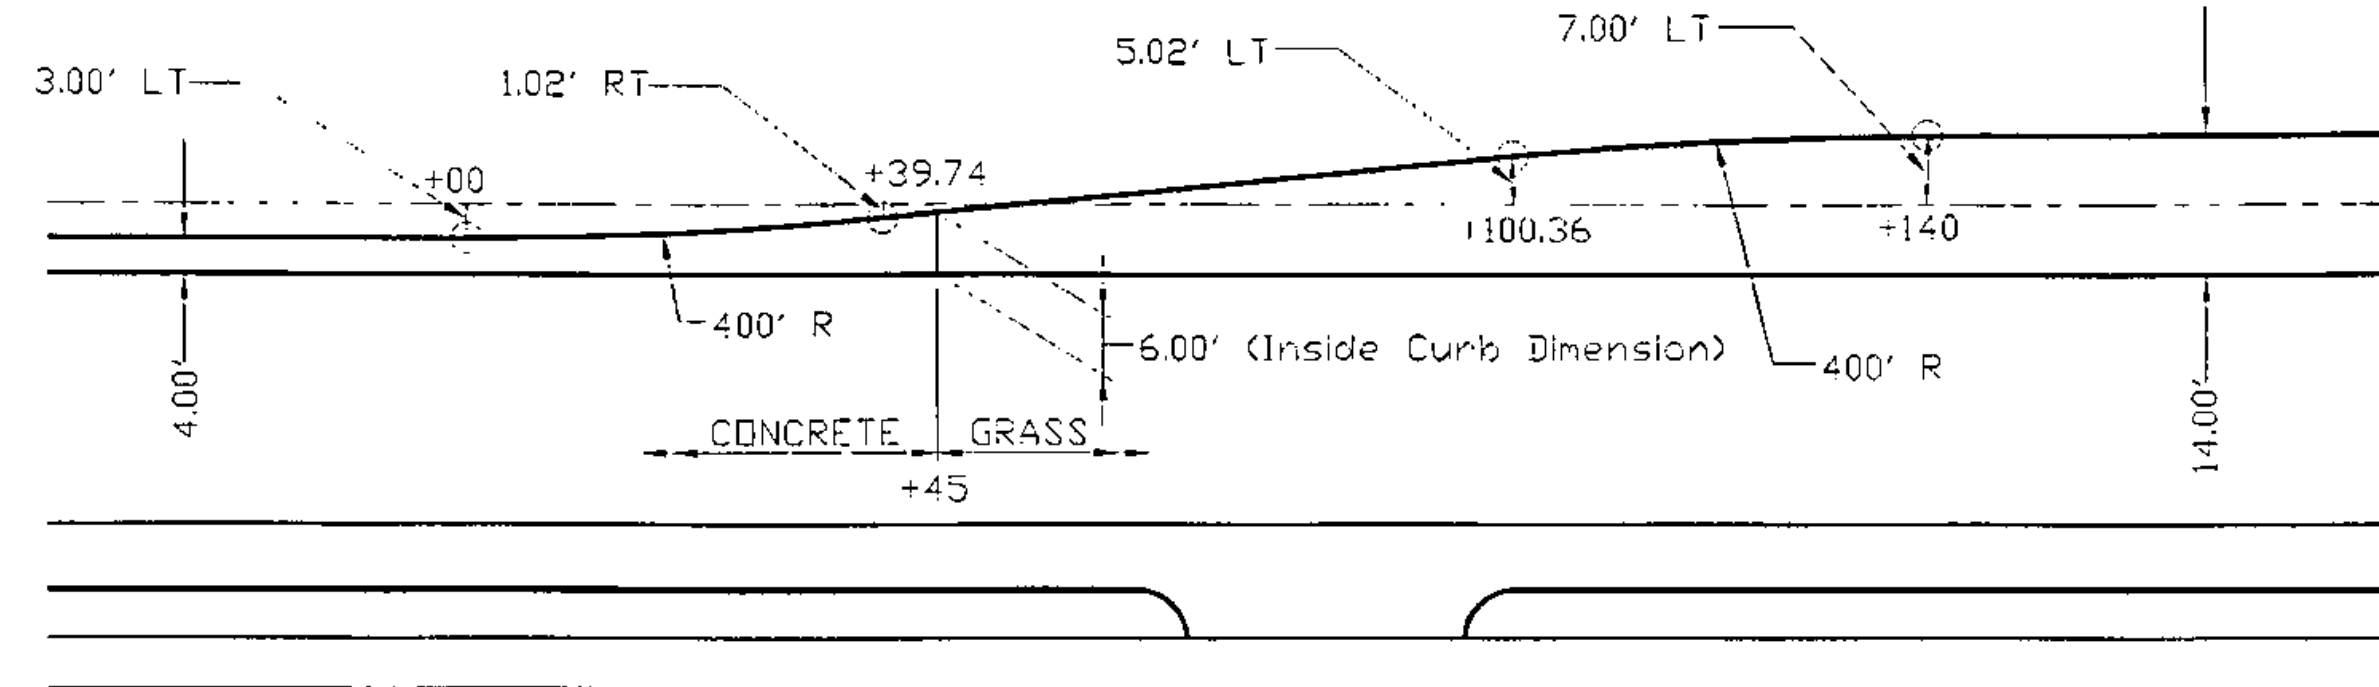


TYPICAL SECTIONS MISCELLANEOUS

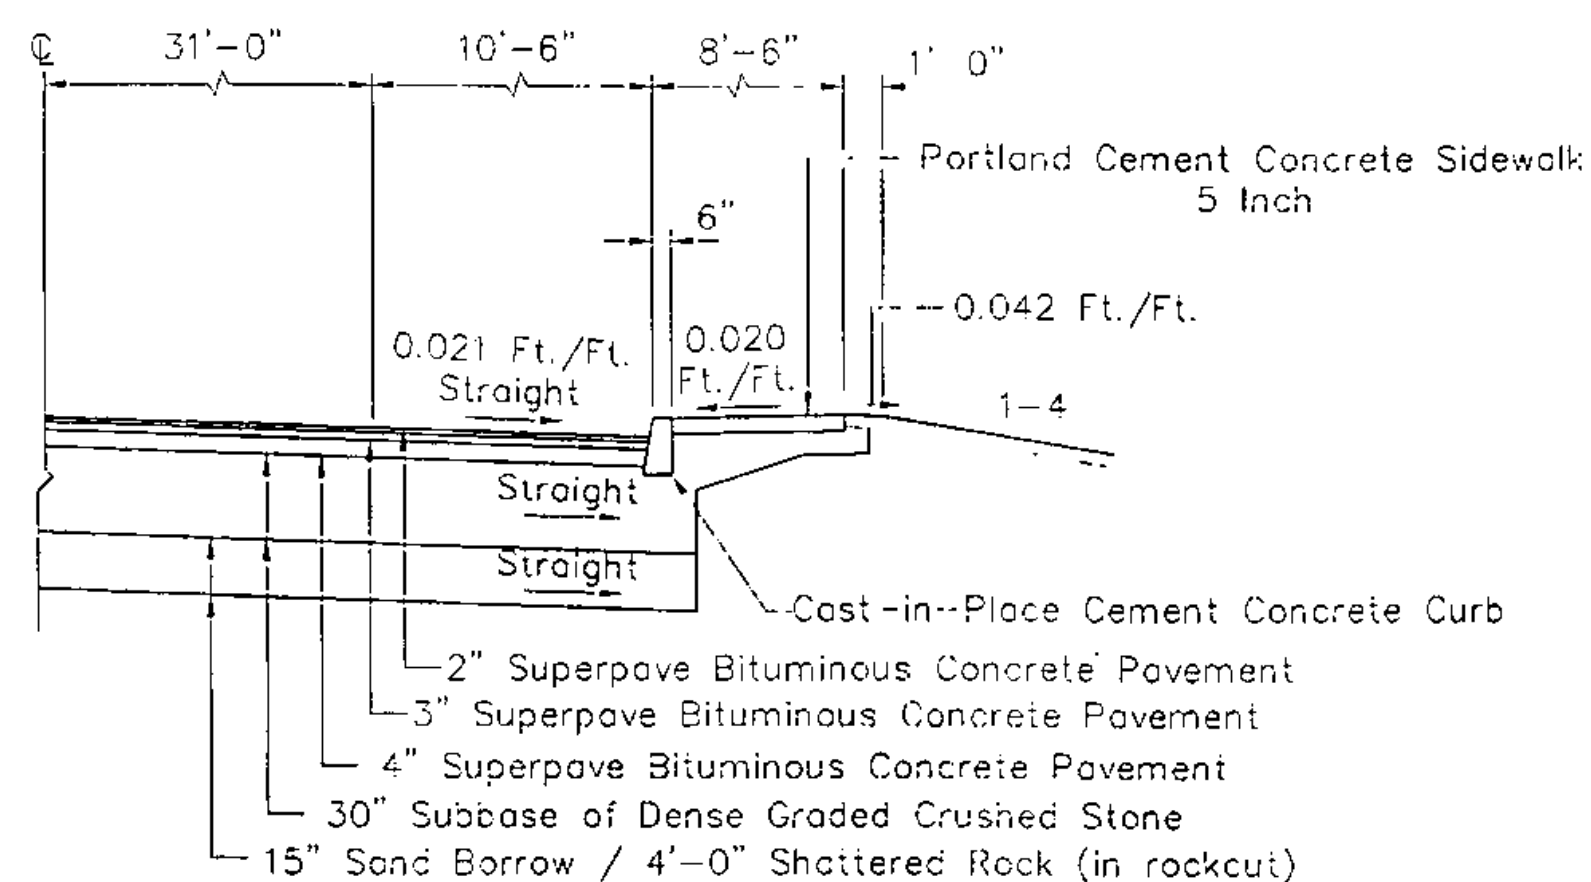


TYPICAL LEFT TURN LANE - MEDIAN LAYOUT
Dimensions shown are outside edge of curb otherwise note.


- STA. 284+97 LT. TO STA. 285+57 LT.
- **STA. 286+71 RT. TO STA. 287+31 RT.
- STA. 303+97 LT. TO STA. 304+69 LT.
- STA. 305+25 RT. TO STA. 306+17 RT.
- STA. 310+70 LT. TO STA. 311+31 LT.
- STA. 312+06 RT. TO STA. 312+91 RT.
- STA. 321+68 LT. TO STA. 322+37 LT.
- ** STA. 323+53 RT. TO STA. 324+14 RT.
- STA. 331+89 LT. TO STA. 332+54 LT.
- STA. 333+18 RT. TO STA. 334+09 RT.
- * STA. 345+05 LT. TO STA. 345+65 LT.
- ** STA. 346+69 RT. TO STA. 347+38 RT.
- STA. 351+23 RT. TO STA. 351+83 RT.
- STA. 349+69 LT. TO STA. 350+31 LT.
- STA. 362+90 LT. TO STA. 363+87 LT.
- ** STA. 364+59 RT. TO STA. 365+29 RT.
- STA. 370+83 LT. TO STA. 371+43 LT.
- STA. 372+31 RT. TO STA. 373+01 RT.

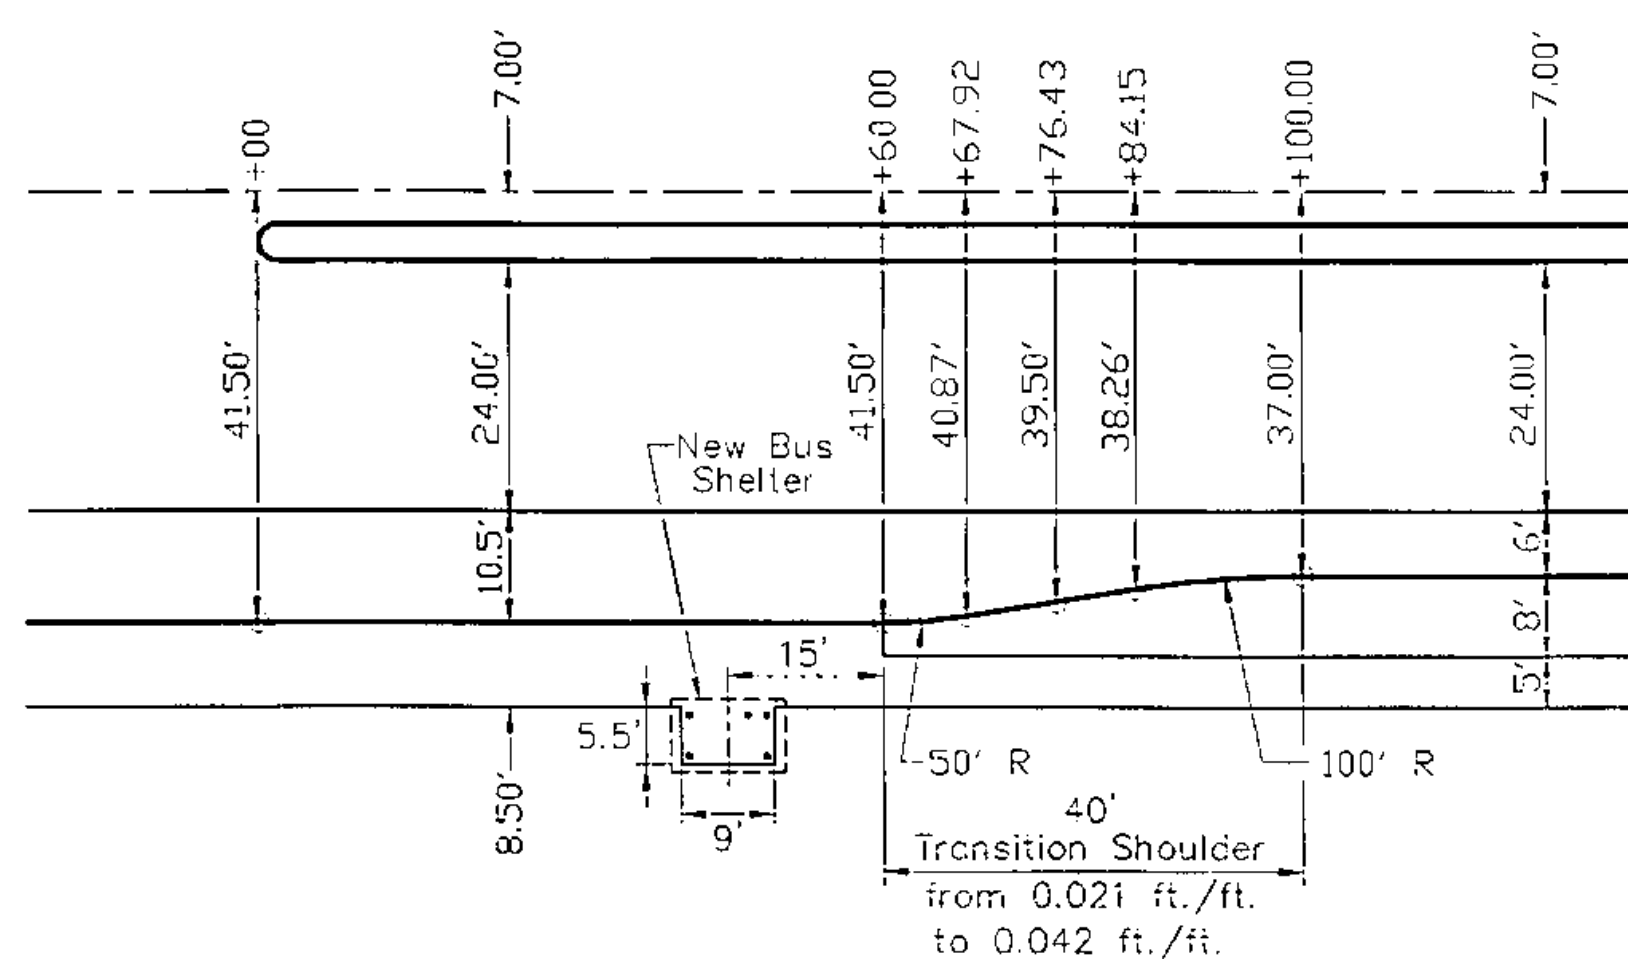

TYPICAL BUS STOP LAYOUT

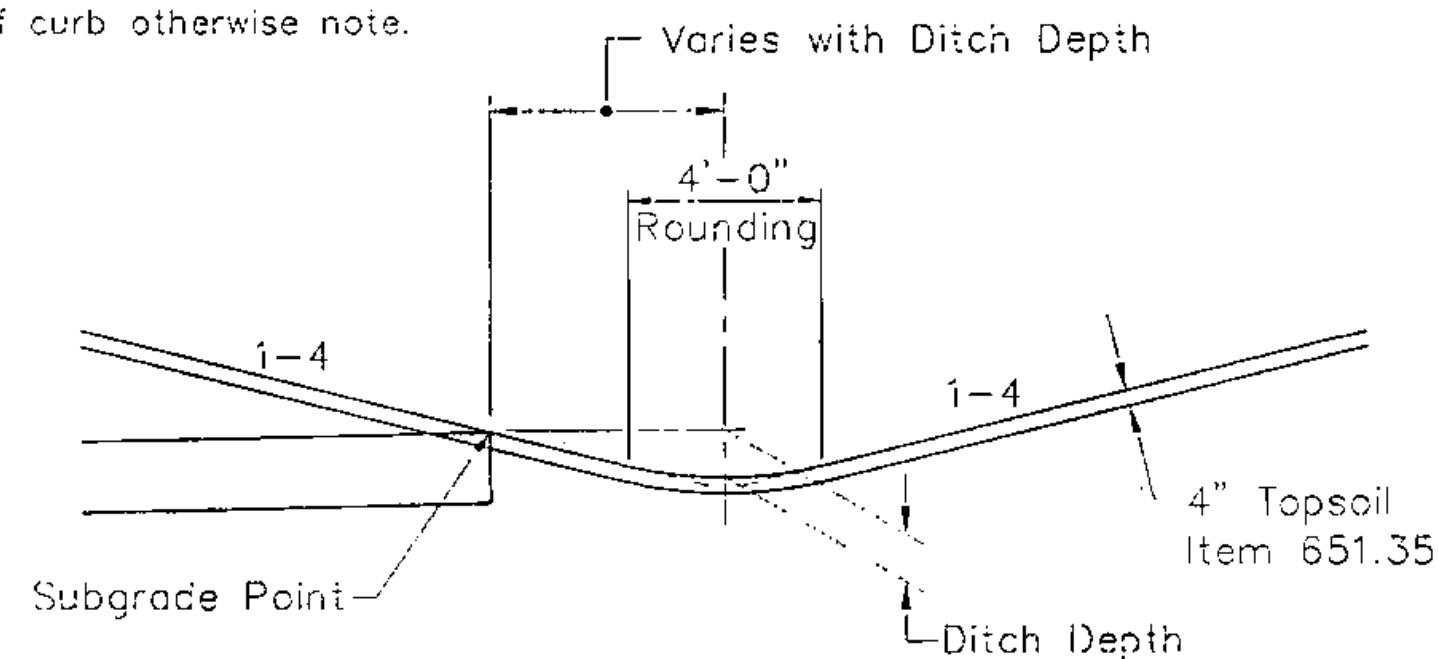

DITCH DETAILS
(1-4 Back Slope)

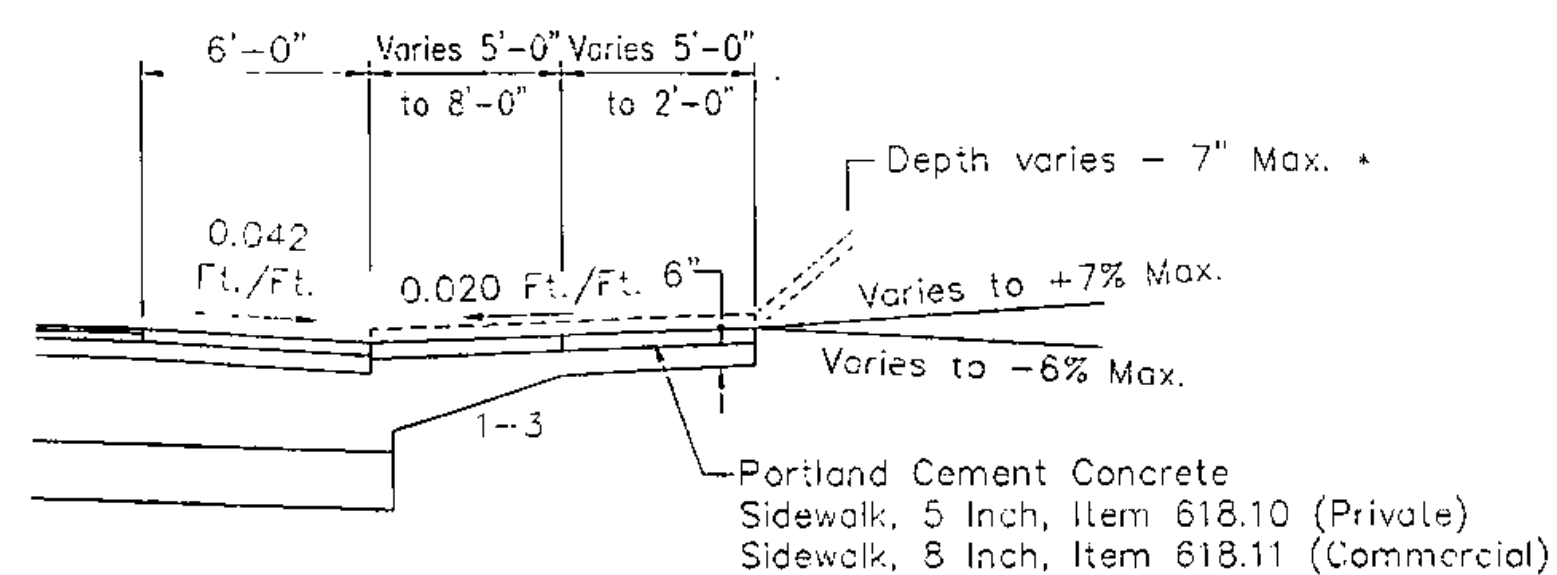


DRIVEWAY DETAIL


- * - Sidewalk shall be lowered to match the driveway. Elevation varies with the driveway. Sidewalk taper begins 7 feet before end of curb.

BUS STOP TYPICAL

- * - Driveway locations do not allow construction of a 60' bay length
- ** - New Bus Shelter shall be installed. See Bus Shelter Detail Drawing 1 & 2 for details.

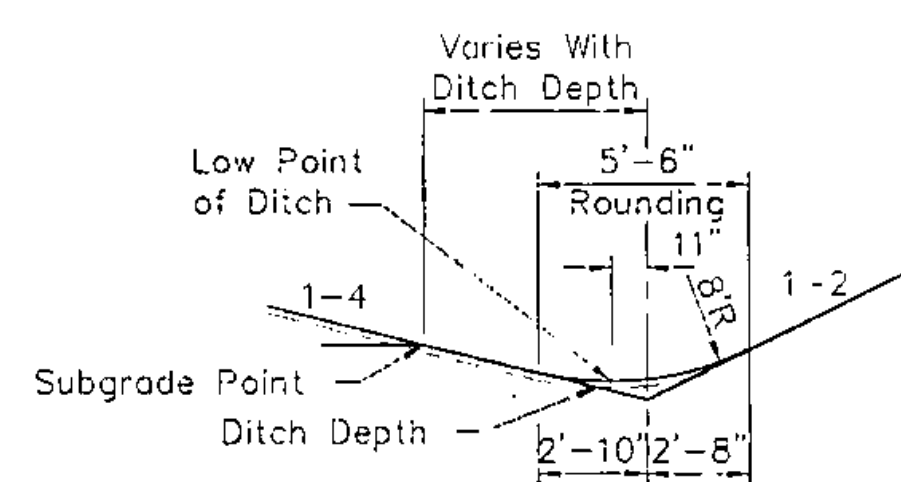


DITCH DETAILS
(1-2 Back Slope)

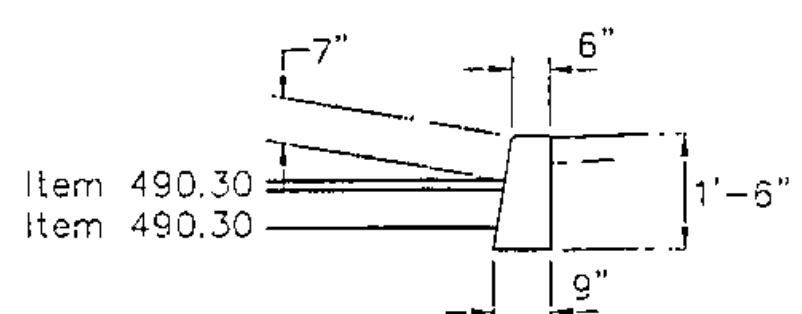

CEMENT CONCRETE CURB DETAILS


For Entrances with Cement Concrete Curb, Type B, See Standard Sheet C 2a

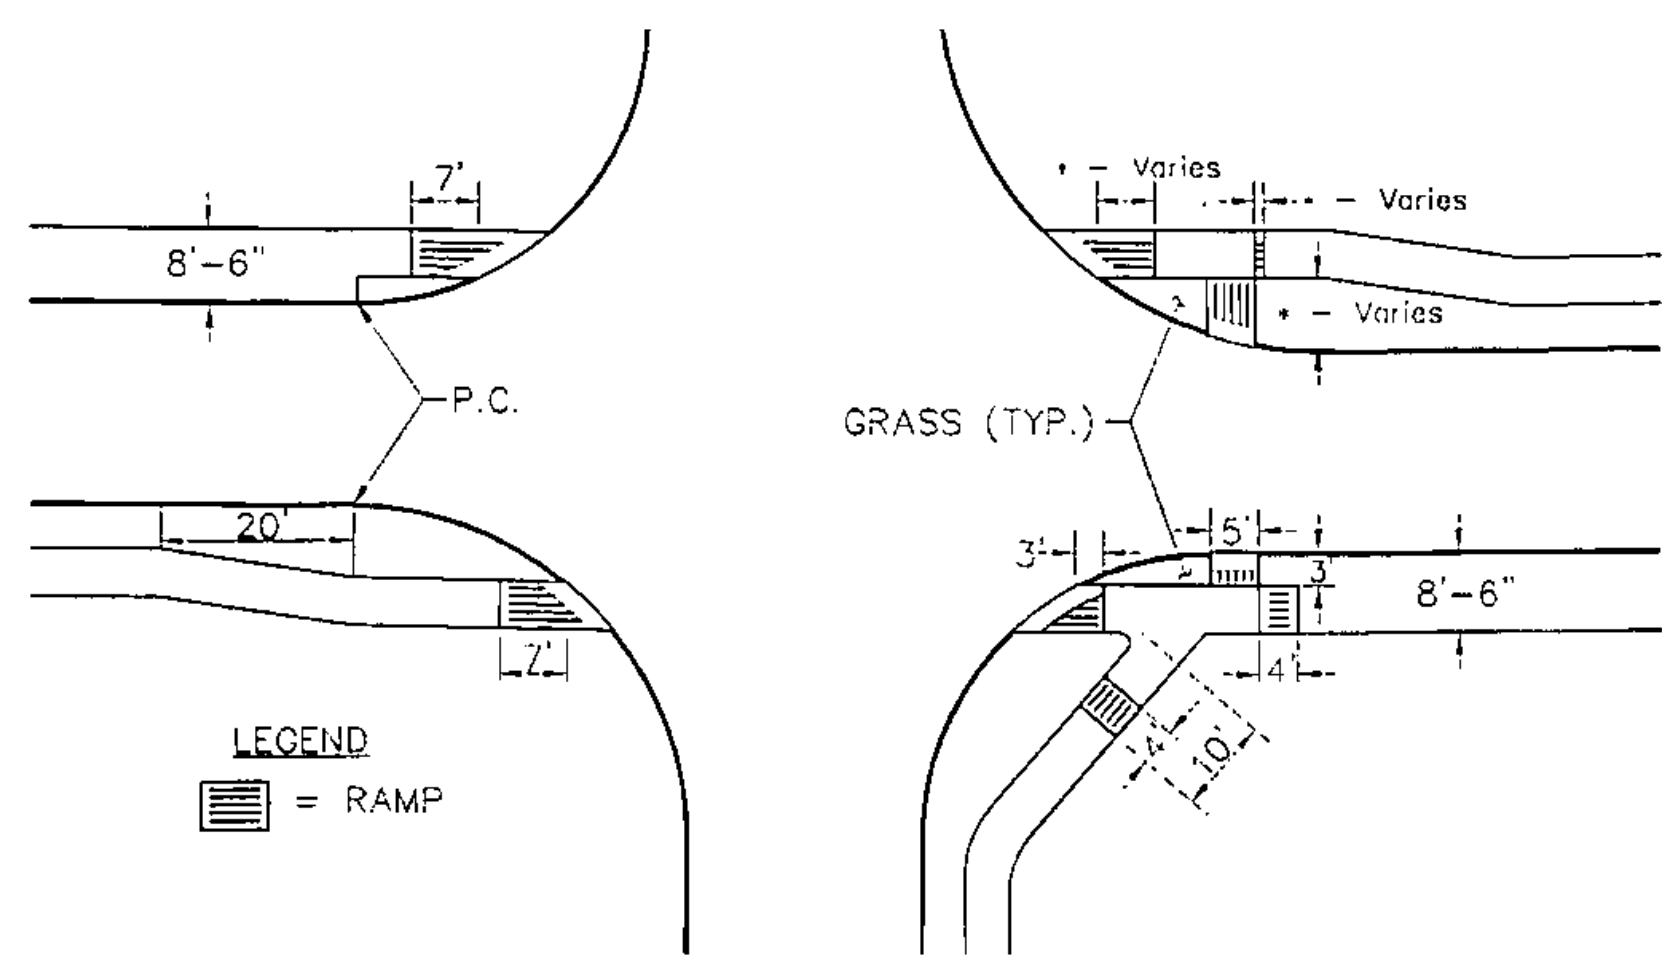


LEGEND
= RAMP

TYPICAL SIDEWALK RAMP LAYOUT

* - See grading plan for dimension

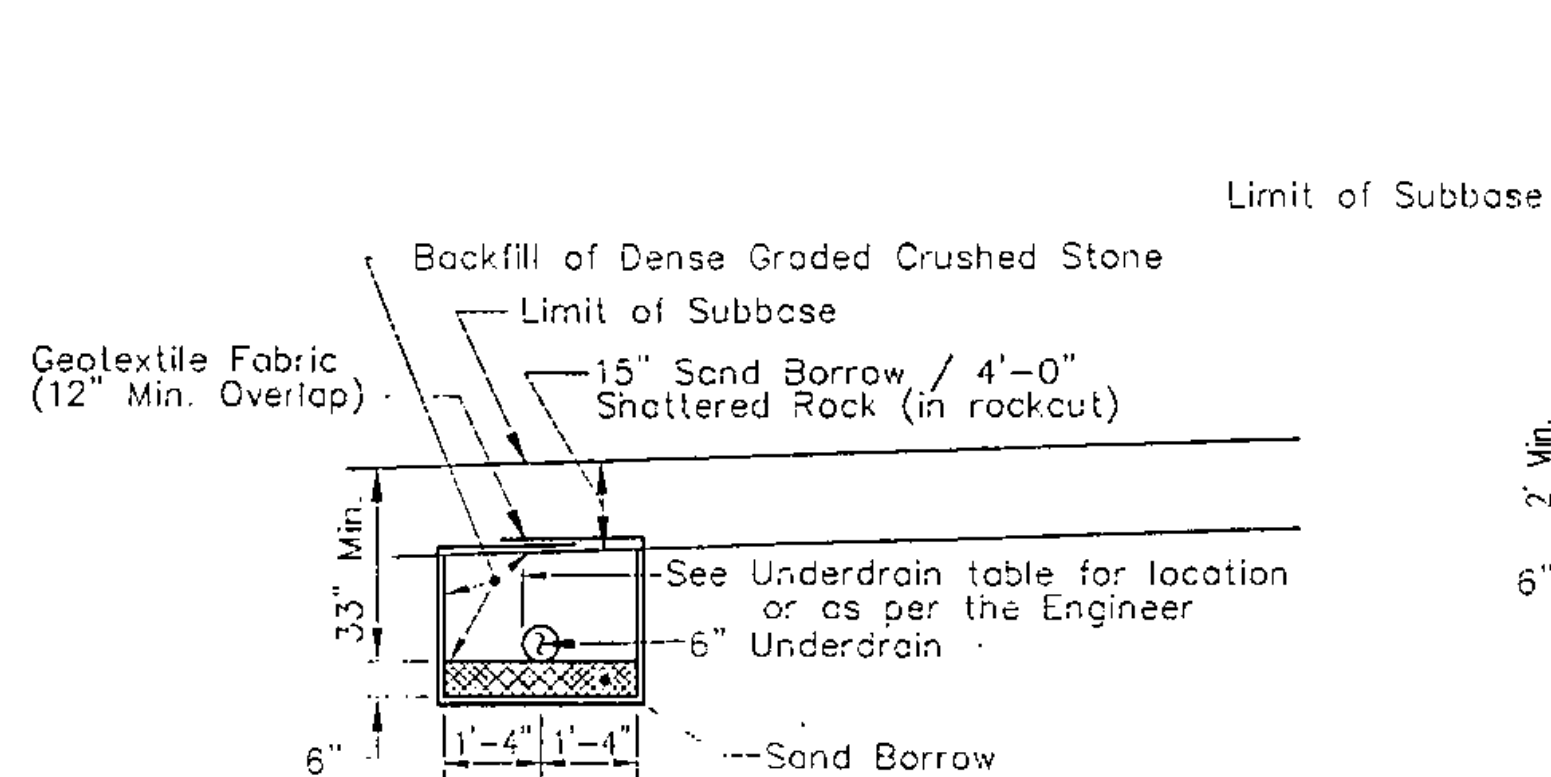

TYPICAL UNDERDRAIN TRENCH DETAIL

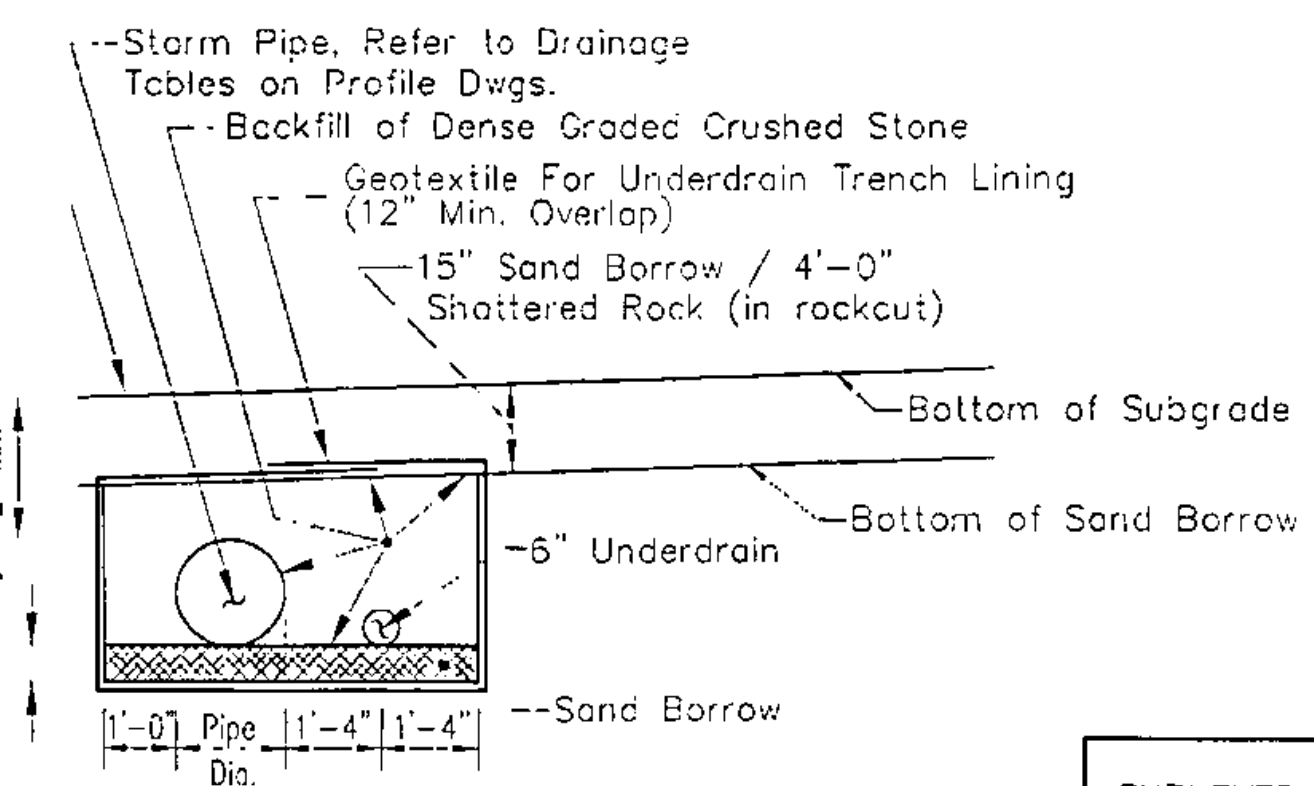

TYPICAL UNDERDRAIN TRENCH DETAIL WITH STORM DRAIN

GENERAL NOTES

- The Seed Mixture shall not have a weed content exceeding 0.40% by weight and shall be free from all noxious weed seed.
- Seed, Item 651.15, to be applied per seeding formula or as directed by the Engineer. See landscape plans.
- Fertilizer, Item 651.18, shall be mixed as per the fertilizer formula or as directed by the engineer. See landscape plans.
- Fertilizer shall be delivered in bags not to exceed 100 pounds each and to be applied at the rate of 500 Lbs / Acre. See landscape plans.
- Agricultural Limestone, Item 651.20, shall be applied to the Seeding Area at the rate of 2 Tons/Acre, or as directed by the Engineer. See landscape plans.
- Straw Mulch, Item 651.25, to be placed on earth slopes at the rate of 2 Tons/Acre or as directed by the Engineer.
- Steel Marker Posts, Item 619.16, to be placed as directed by the Engineer.
- Topsoil, Item 651.35, to be used with seed as indicated or as directed by the Engineer.
- Slope Rounding, all cut slopes to be rounded in accordance with Standard Sheet B-5.
- Sidewalks shall have expansion joints every 20 feet.
- Tack Coat: Emulsified asphalt is to be applied at a maximum rate of 0.15 Gal/SY between all lifts of pavement.
- Refer to Standard Sheet C-2A for curb radii details at driveways.
- Subgrade geotextile separator shall be installed as per the Engineer.
- All utility sleeves, pipe items, and manholes, drop inlets and catch basins are being paid inclusive of: trenching, material, material placement, and backfill with select material for this project. This includes drainage pipe, underdrain, carrier pipe, underdrain flushing basins, sewer pipe and water pipe. The Contractor is referred to items of Trench Excavation of Earth (204.20) and Trench Excavation of Rock (204.21) along with Sand Borrow (203.31) in cases where additional excavation is required due to poor material or rock under pipes.

DATUM
VERTICAL NGVD 1929
HORIZONTAL NAD 1927

SHELburne
SURVEYED BY V.S.C. INC. DATE _____
DRAWN BY E.A.A. INC. DATE _____
TRACED BY E.A.A. INC. DATE _____
PROJECT NH-ECC-019-4(27)
TYPICAL SECTION DRAWING NO. 9
SHEET NO. 12 OF 537

4/13/04