

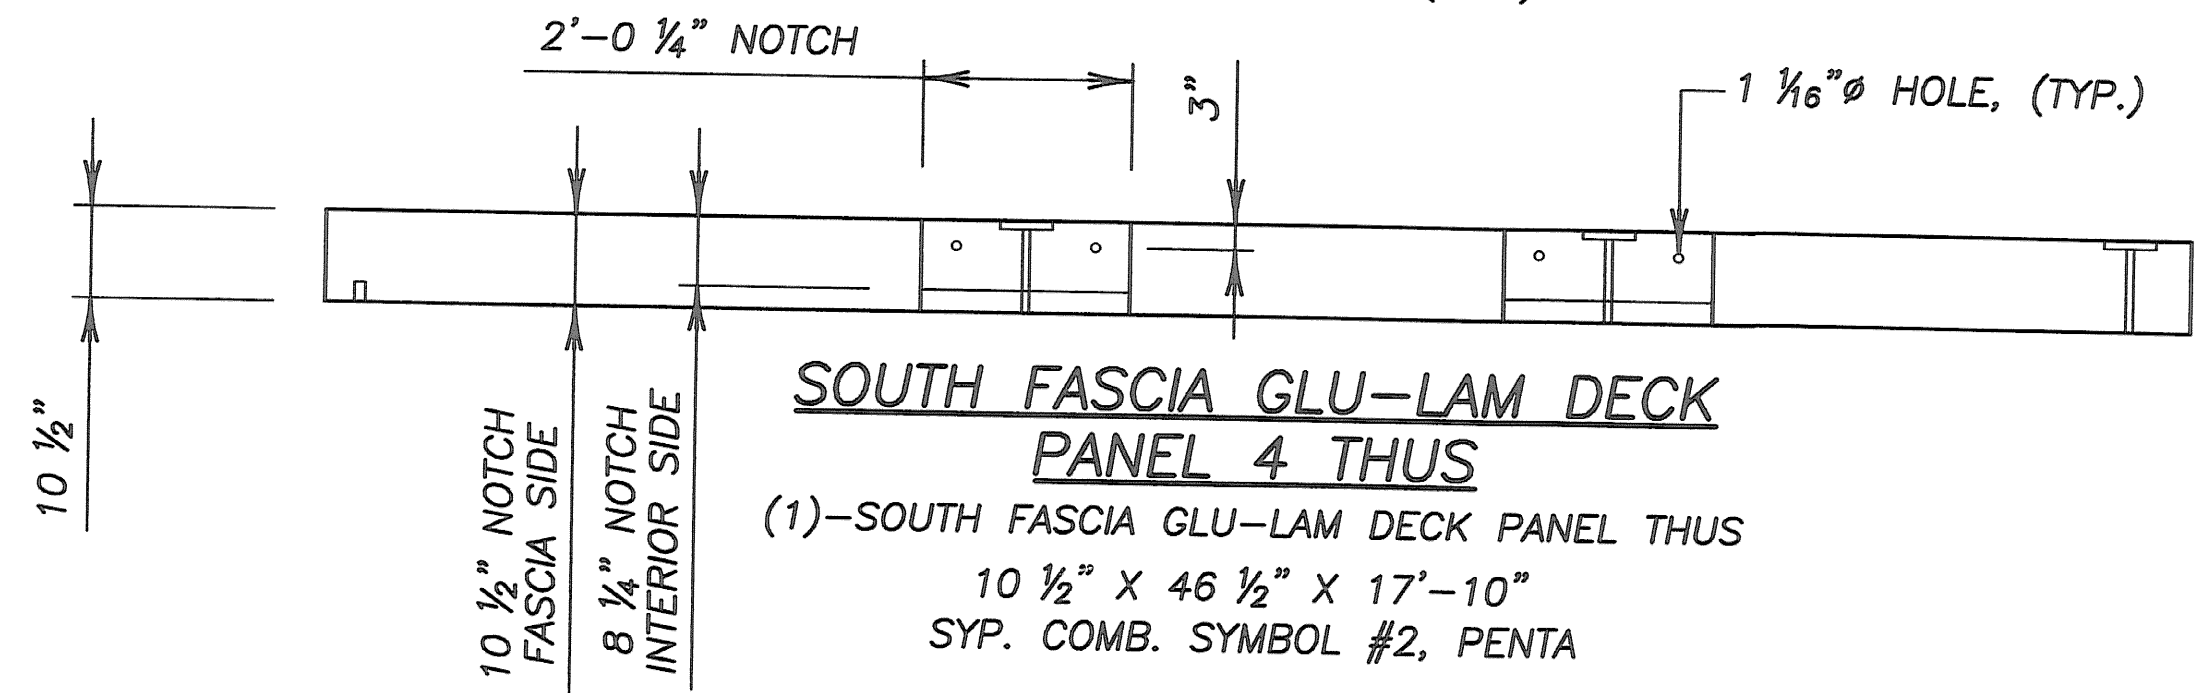
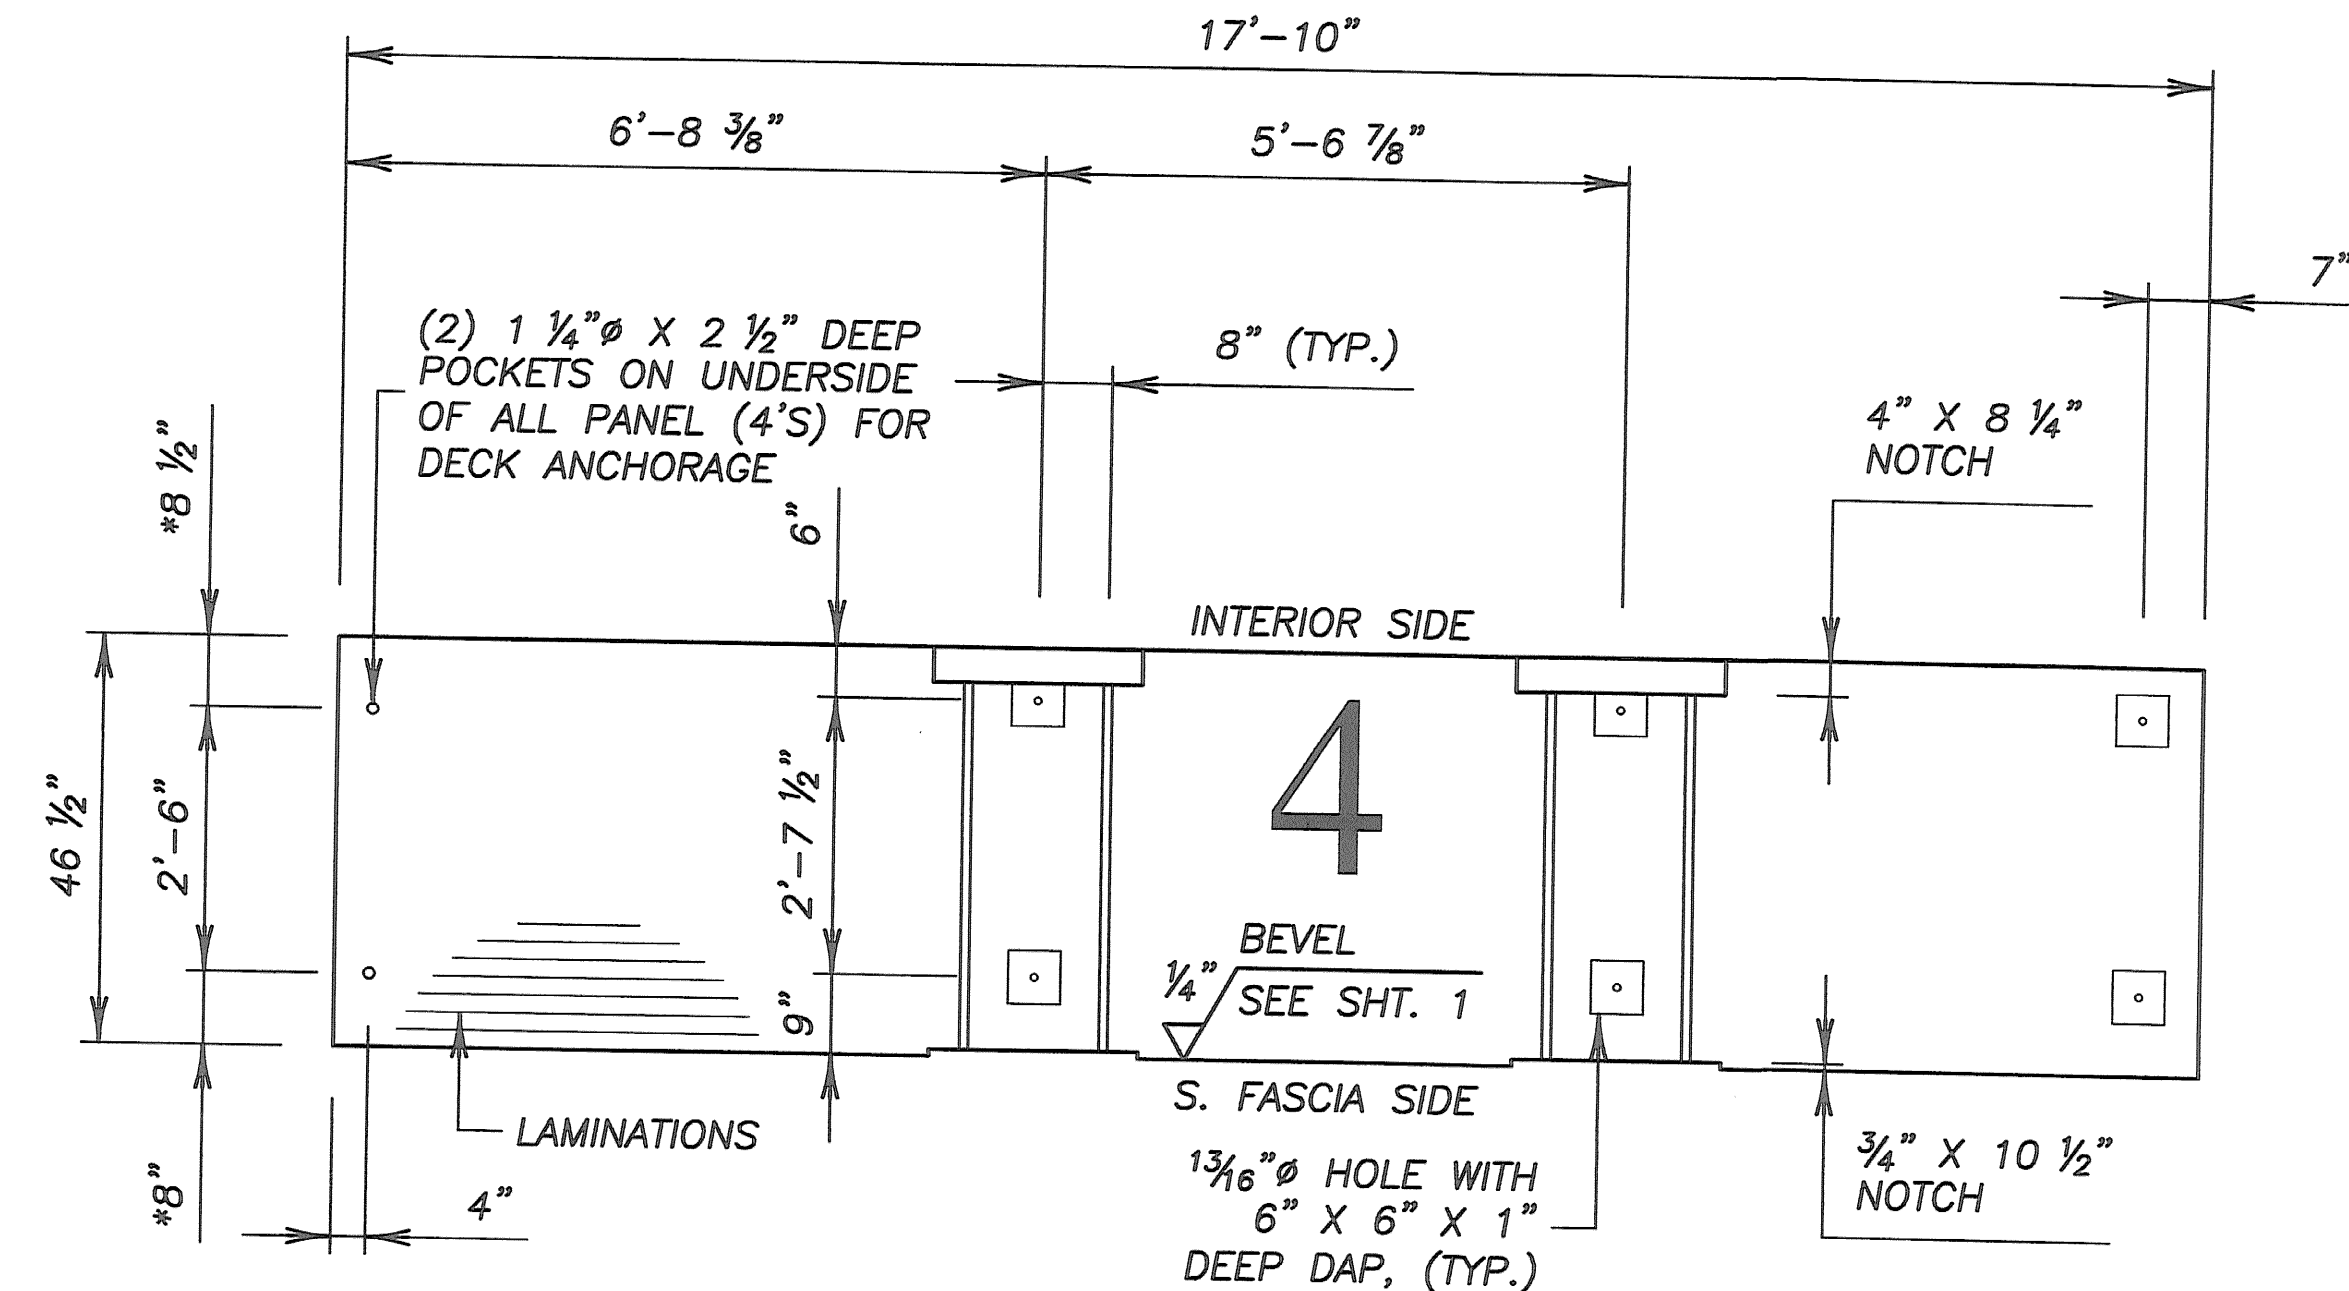


**NORTH FASCIA GLU-LAM DECK
PANEL 4 THUS**
(1)-NORTH FASCIA GLU-LAM DECK PANEL THUS
10 1/2" X 46 1/2" X 17'-10"
SYP. COMB. SYMBOL #2, PENTA

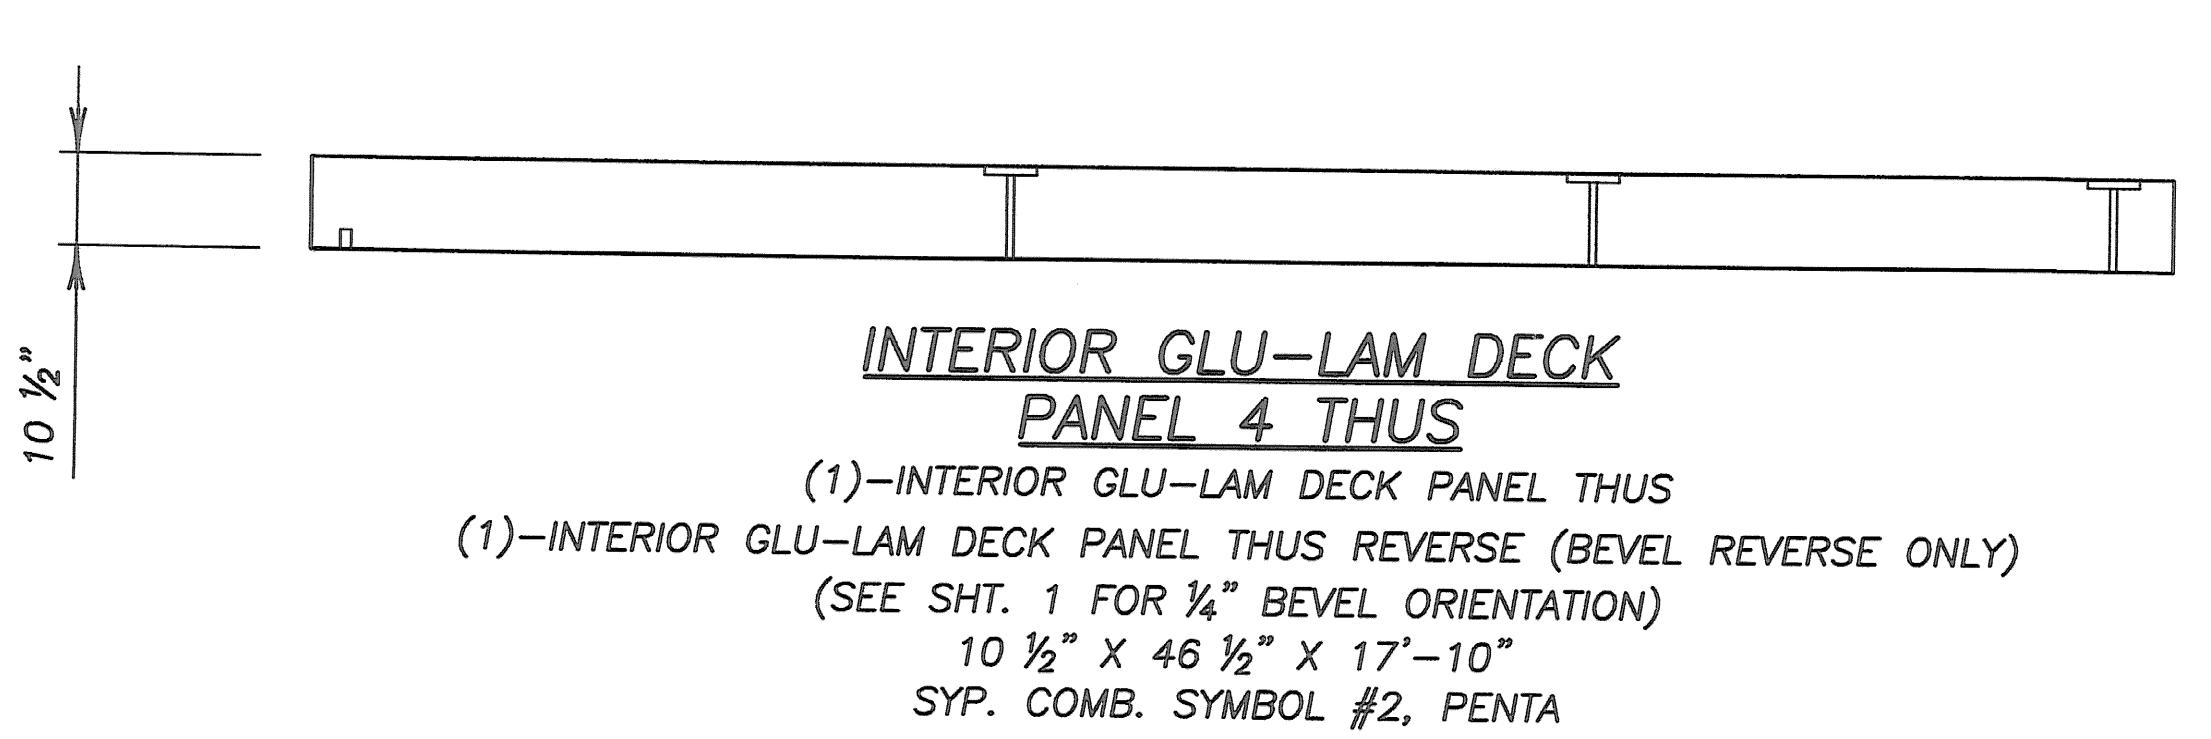

**SOUTH FASCIA GLU-LAM DECK
PANEL 4 THUS**
(1)-SOUTH FASCIA GLU-LAM DECK PANEL THUS
10 1/2" X 46 1/2" X 17'-10"
SYP. COMB. SYMBOL #2, PENTA

* MEASURED PRIOR TO PRECISION TRIM ON BOTTOM OF PANEL

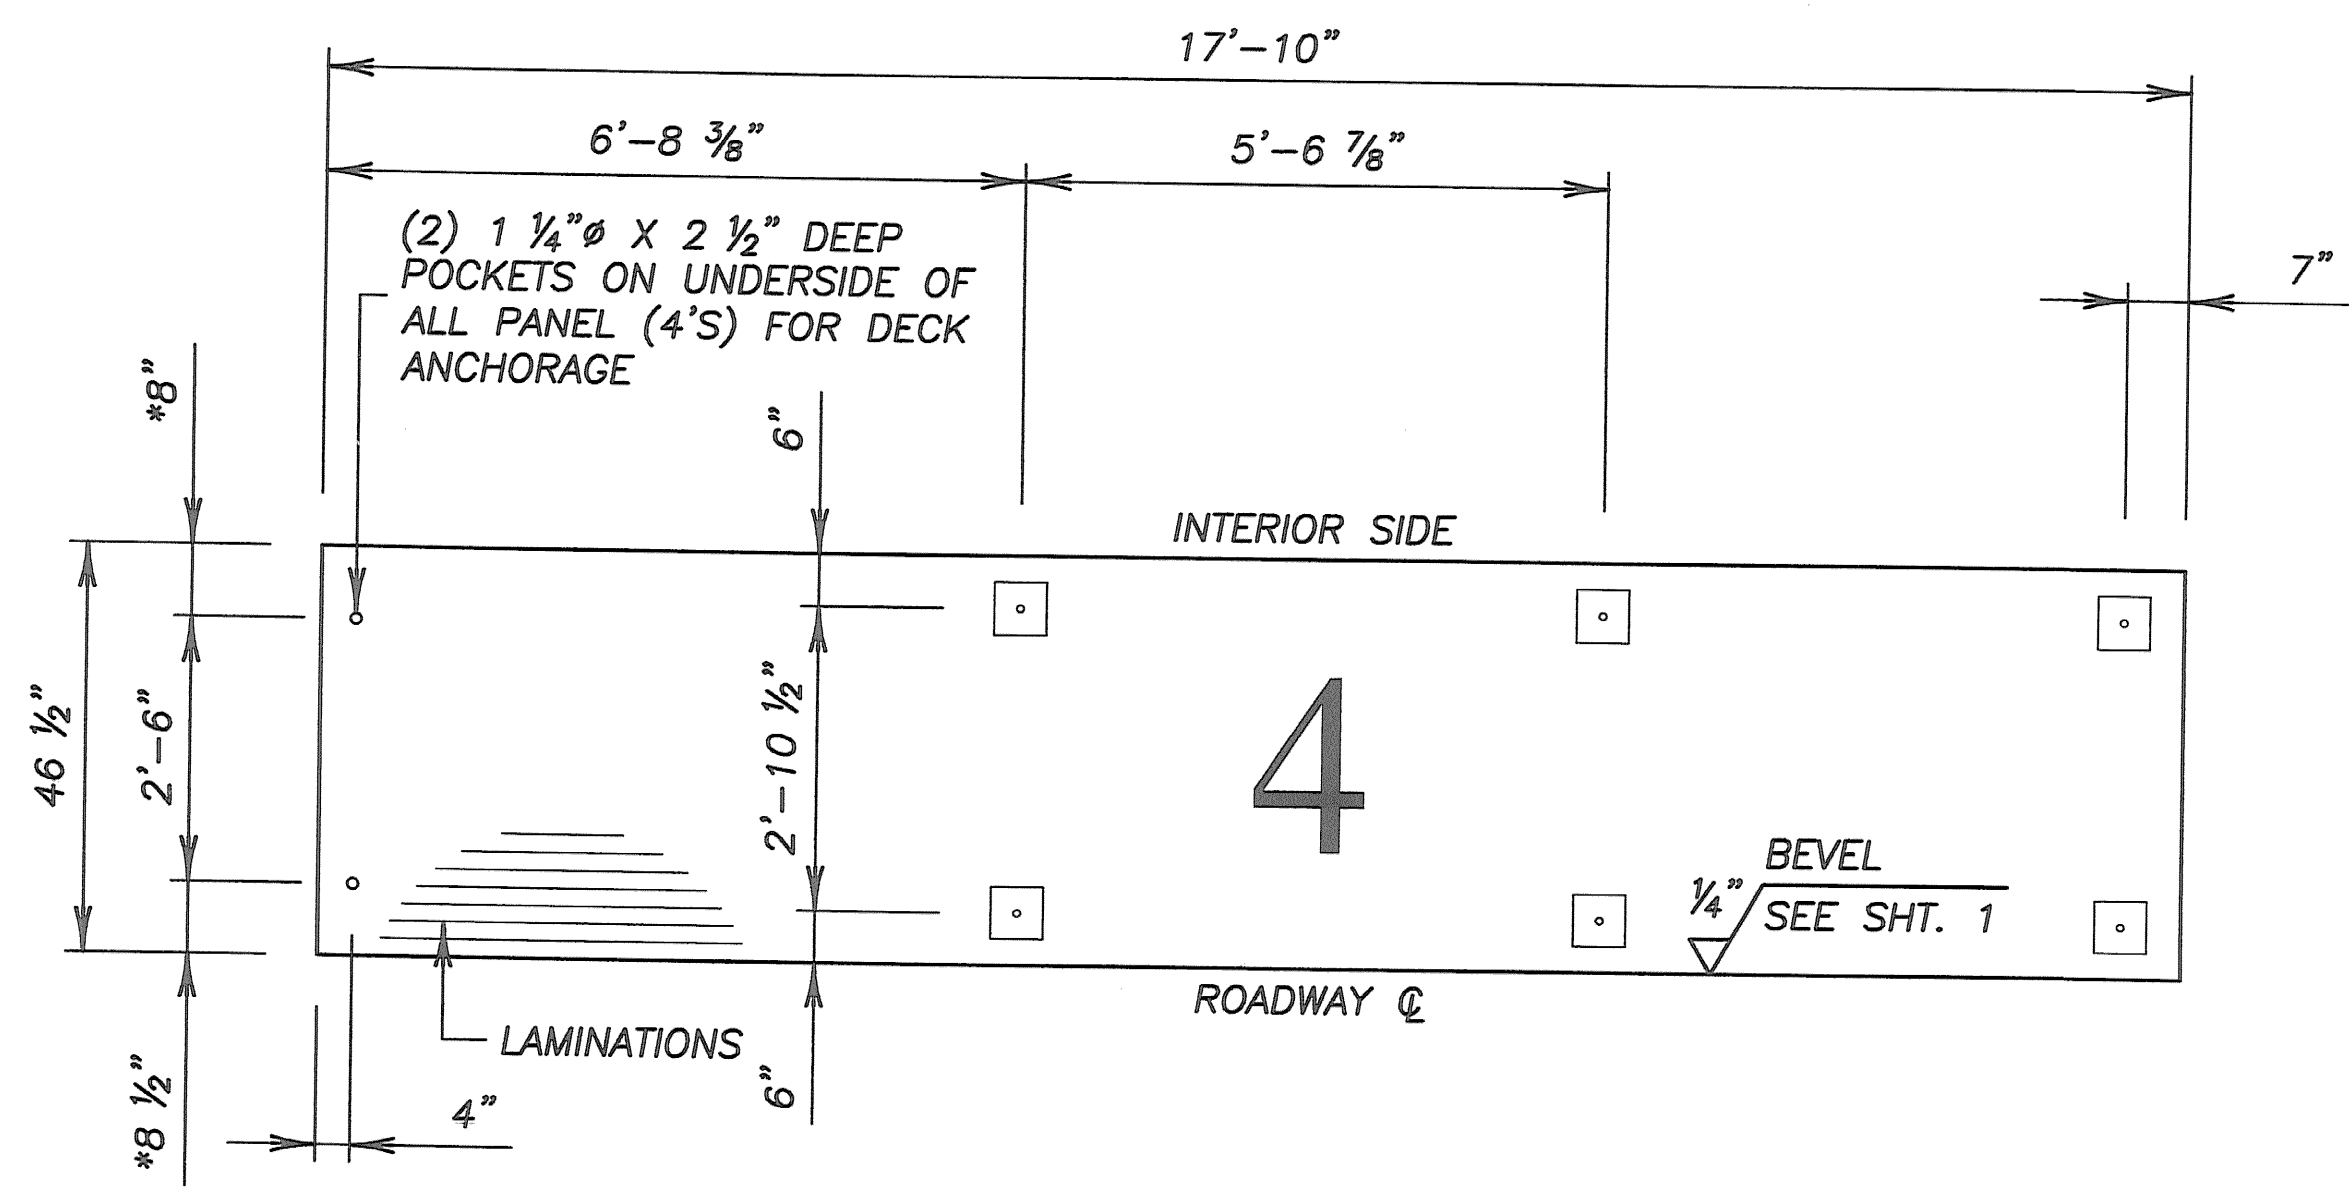

**INTERIOR GLU-LAM DECK
PANEL 4 THUS**
(1)-INTERIOR GLU-LAM DECK PANEL THUS
(1)-INTERIOR GLU-LAM DECK PANEL THUS REVERSE (BEVEL REVERSE ONLY)
(SEE SHT. 1 FOR 1/4" BEVEL ORIENTATION)
10 1/2" X 46 1/2" X 17'-10"
SYP. COMB. SYMBOL #2, PENTA

DISCLAIMER:
PLANS ARE FOR FABRICATION PURPOSED ONLY.
SIZE OF DECKS GIVEN.
WHEELER NOT RESPONSIBLE FOR DESIGN LOADS.

SPECIFICATIONS:
GLU-LAM BEAMS TO BE SOUTHERN YELLOW PINE, COMB. SYMB. 2, SP/SP.
GLU-LAMS TO BE INDUSTRIAL IN APPEARANCE, FILL ALL VOIDS.
GLU-LAMS ARE NOT TO BE END SEALED, SURFACE SEALED, OR WRAPPED.
GLU-LAMS TO BE PENTA TREATED AFTER FABRICATION IN ACCORDANCE WITH THE REQUIREMENTS OF AASHTO M133.
ENDS OF GLU-LAMS TO BE PLUMB.
GLU-LAMS SHALL BE INCISED FOR TREATING.
GLU-LAMS SHALL BE MANUFACTURED USING WET-USE ADHESIVES.
GLU-LAMS SHALL BE MARKED WITH A QUALIFIED INSPECTION & TESTING AGENCY MARK PRIOR TO TREATMENT & A CERTIFICATE & TEST RESULTS INDICATING CONFORMANCE TO ANSI/AITC A190.1 SHALL BE PROVIDED.
ALL HOLES SHALL BE DRILLED PERPENDICULAR TO SURFACE SHOWN TO ASSURE FIELD PLACEMENT OF BEAMS, DIAPHRAGMS, ATTACHING STEEL, ETC...

DO NOT SCALE DRAWINGS

RECEIVED
APPROVED
RECEIVED
MAY 19 2004
RESUBMIT APPROVED
BY DATE

STATE OF VERMONT
AGENCY OF TRANSPORTATION
PROPOSED IMPROVEMENT BRIDGE PROJECT

PANEL 4 PREFRAMING

SHOPS PREPARED BY:
WHEELER CONSOLIDATED
12127 WHITEWOOD SERVICE ROAD
WHITEWOOD, SD 57793 (605) 269-2372

TRACKING NO.: T11547
ORDER NO.: 11245

DATE: 1/20/04
DWN: LAF
CHKD. MAC
SHEET 6 OF 10