


SOUTH ABUTMENT ELEV.

N. T. S.

AREA OF REPOINTING  
MASONRY (MOD)  
LIMITS TO BE DETERMINED  
BY THE ENGINEER

INSTALL IRREGULAR STONES  
TO TIGHT FIT. GAP BETWEEN  
NEW AND EXISTING STONE  
SHALL BE LESS THAN 1/2".

OUTSIDE FACE OF  
STONE MASONRY

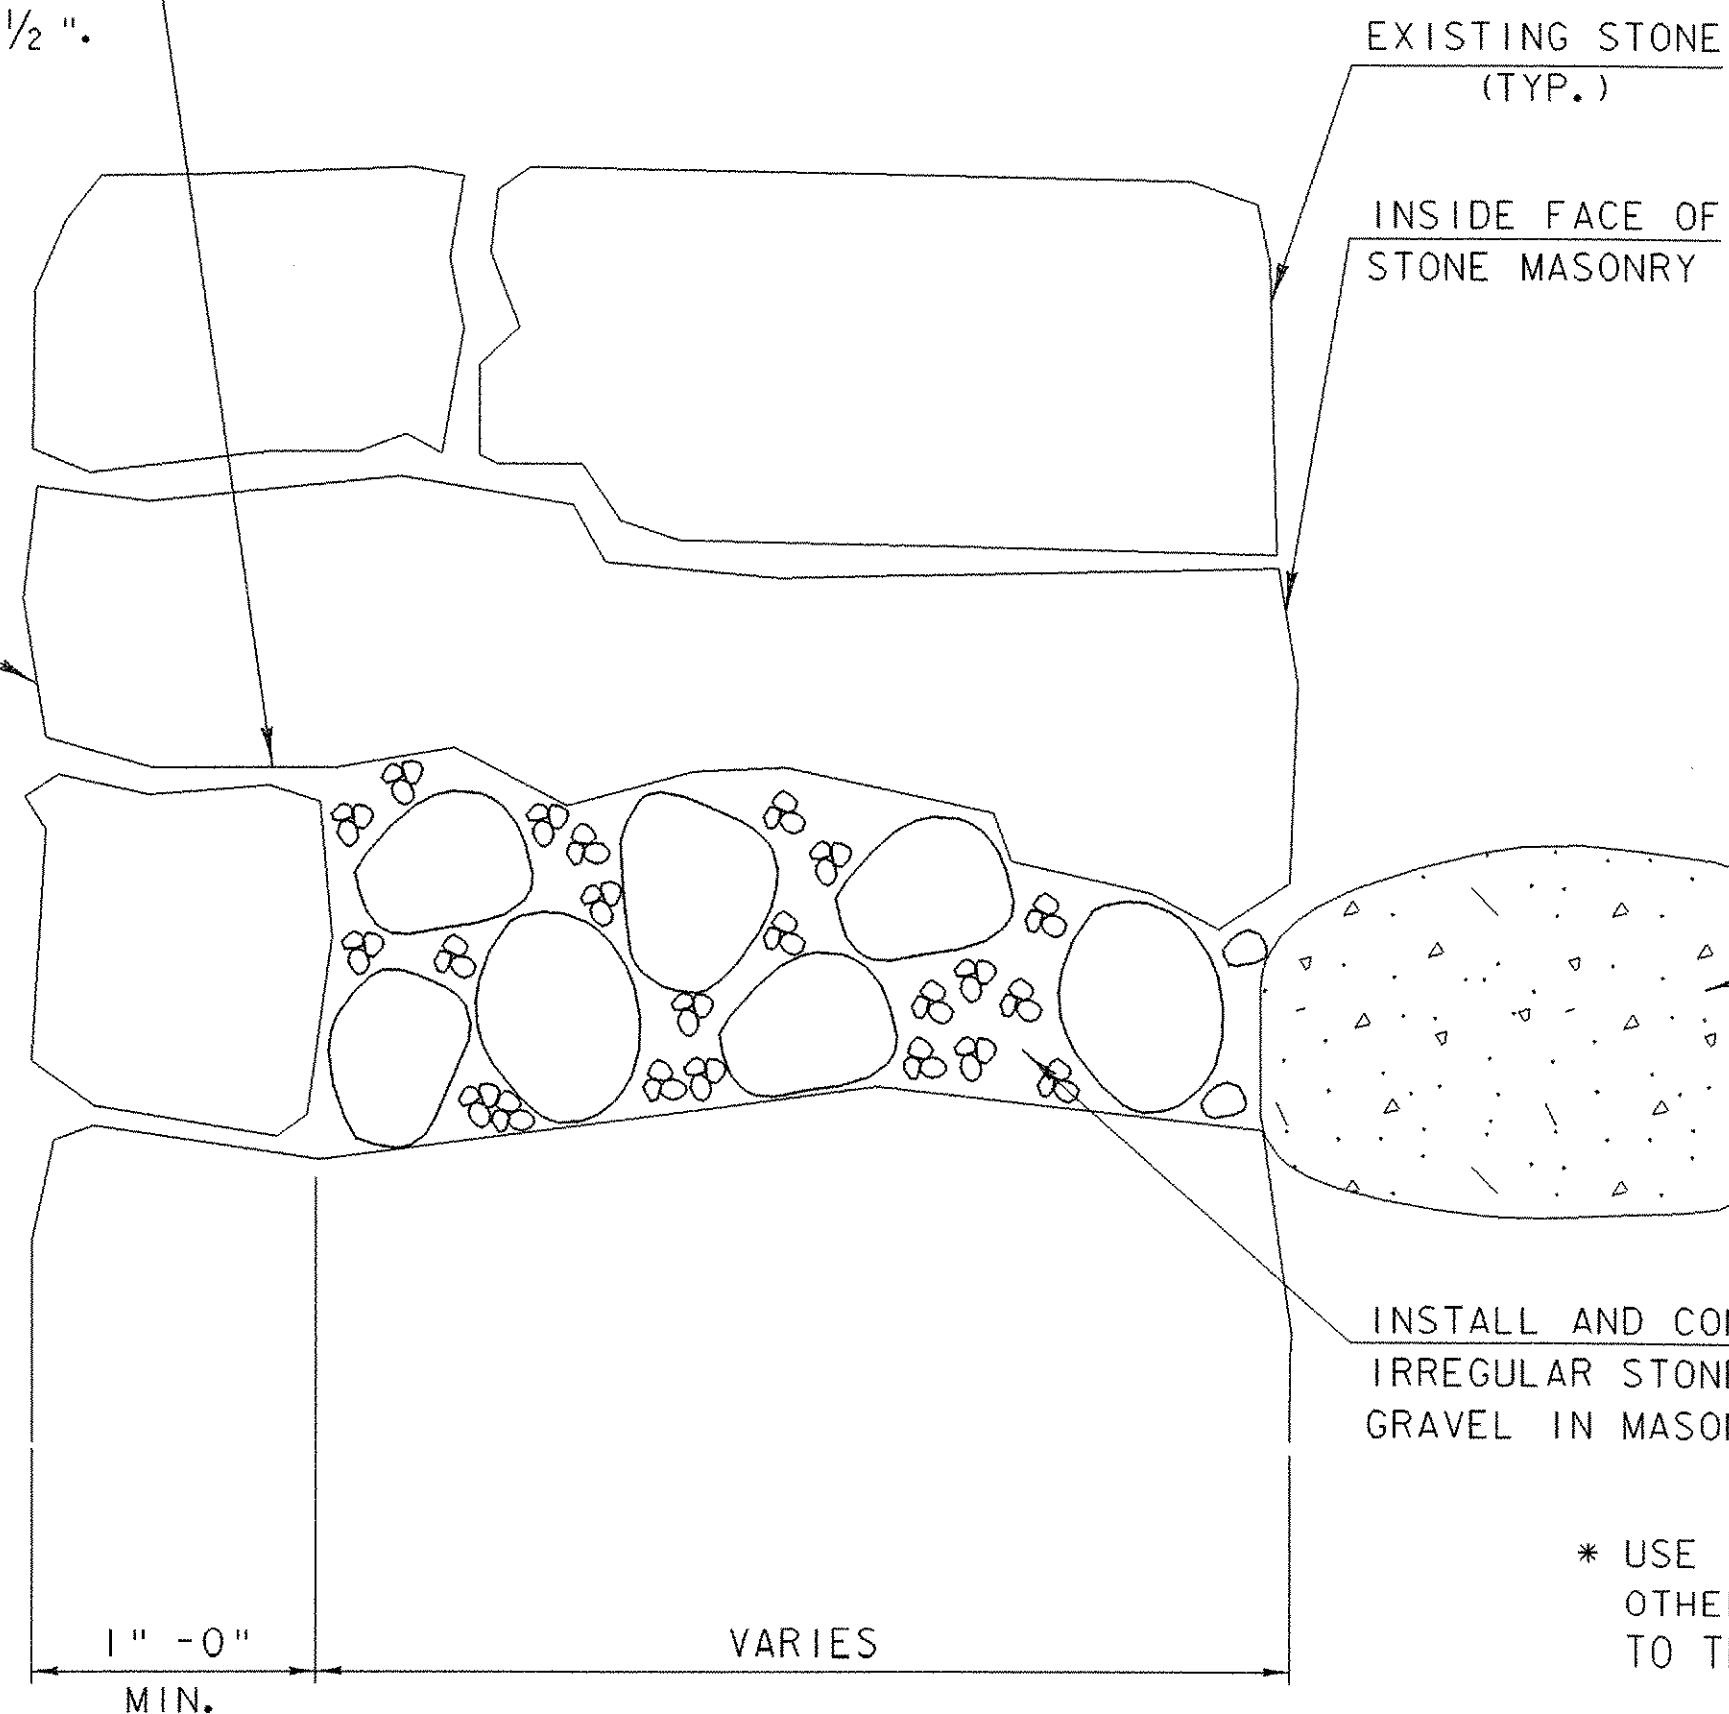

EXISTING STONE  
(TYP.)  
INSIDE FACE OF  
STONE MASONRY

INSTALL AND COMPACT CRUSHED  
GRAVEL TO COMPLETELY FILL  
VOIDS IN EXISTING FILL BEHIND  
MASONRY WALL. \*

INSTALL AND COMPACT SMALL  
IRREGULAR STONES AND CRUSHED  
GRAVEL IN MASONRY WALL. \*

\* USE TAMPING RODS OR  
OTHER METHODS ACCEPTABLE  
TO THE ENGINEER.

\*\* FOR FURTHER INFORMATION SEE  
SECTION 602 OF THE PROJECT  
SPECIAL PROVISIONS.

REPOINTING DETAIL\*\*

N. T. S.

SCALE 1 1/2" = 1'-0"



PROJECT NAME: BRATTLEBORO  
PROJECT NUMBER: BHO 1442 (33)

FILE NAME:	PLOT DATE: 10-AUG-2006
PROJECT LEADER:	DRAWN BY: D.D. BEARD
DESIGNED BY: J. WEAVER	CHECKED BY: J. WEAVER
CONSTRUCTION DETAIL SHEET 3	SHEET 8 OF 8