



UNDER-DECK DETAIL
NOT TO SCALE

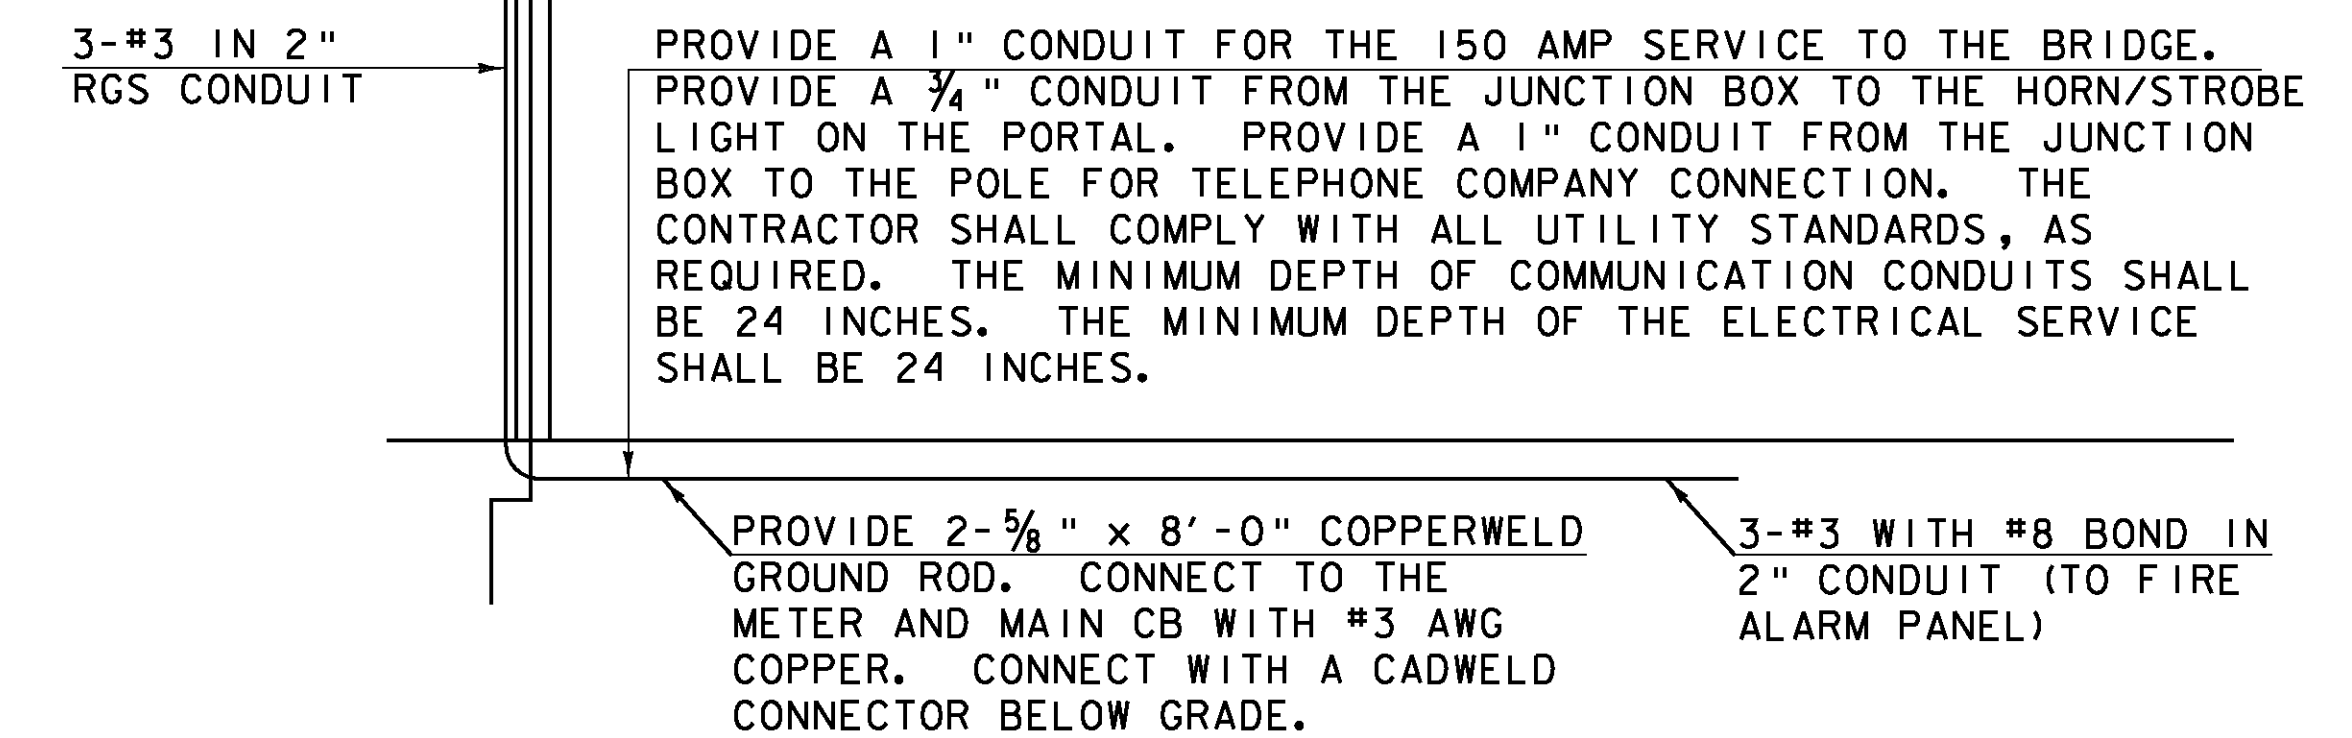

PARTIAL SIDE ELEVATION

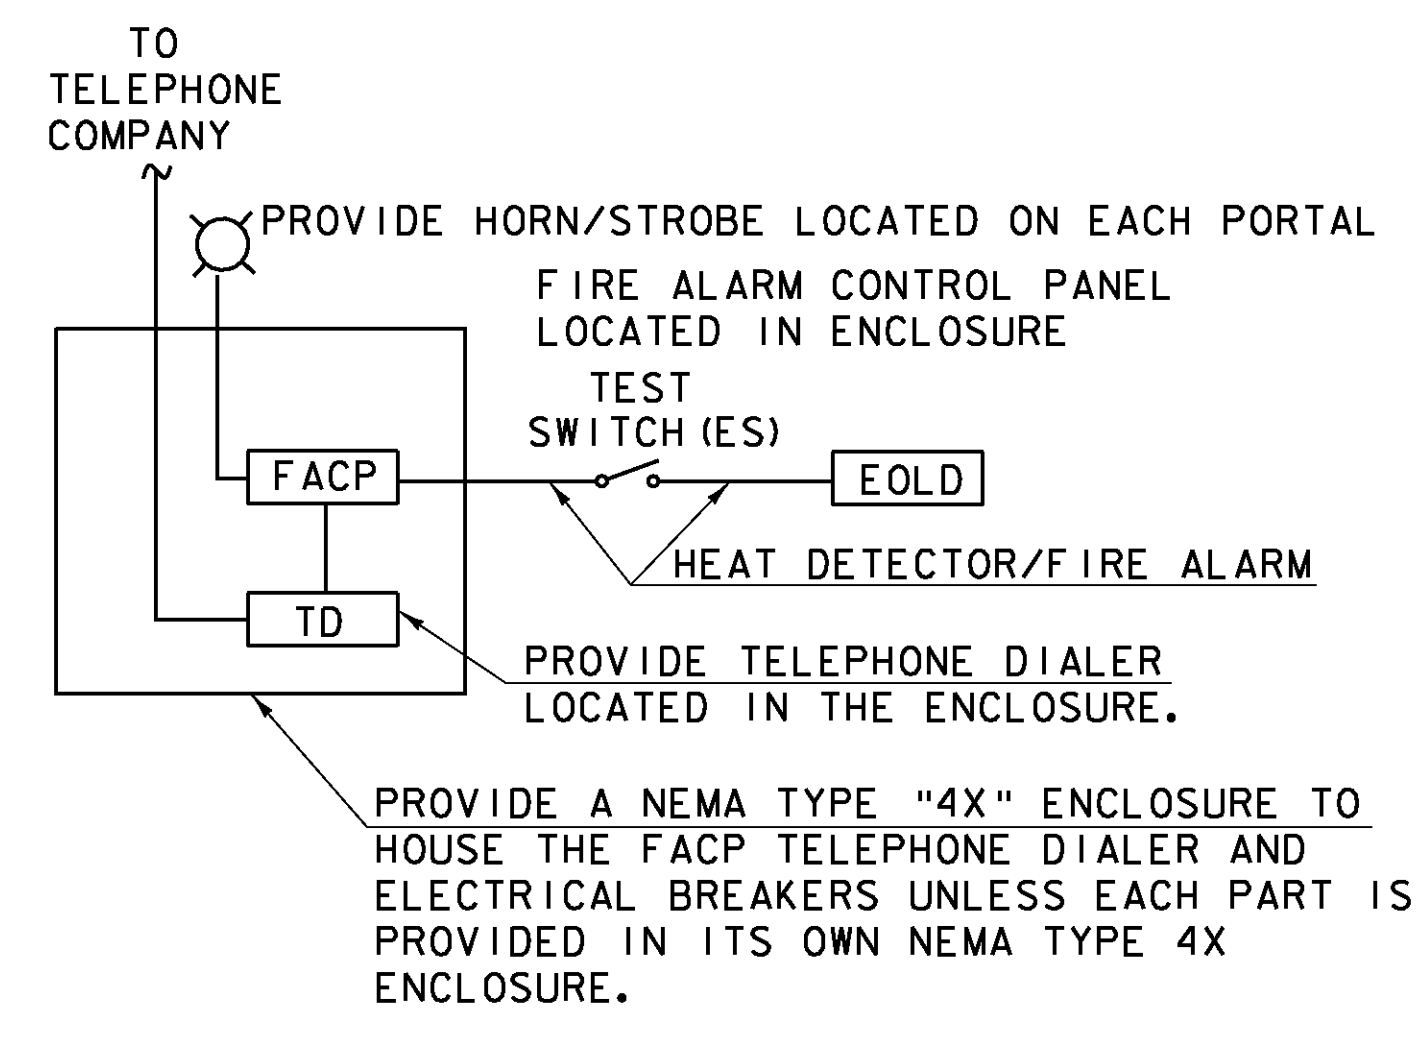

RISER DIAGRAM

LEGEND:

- TEST SWITCH
- FIRE ALARM CONTROL PANEL
- TELEPHONE DIALER
- END OF LINE DEVICE
- RIGID GALVANIZED STEEL

PLAN NOTES:

1. ALL WORK SHALL COMPLY WITH THE APPLICABLE FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. WORK SHALL BE DONE IN A NEAT AND WORKMANLIKE MANNER.
2. THE DRAWING FOR THE LINEAR HEAT DETECTOR/FIRE ALARM SYSTEM IS DIAGRAMMATIC ONLY. THE CONTRACTOR SHALL INSTALL A SYSTEM IN ACCORDANCE WITH THE DRAWINGS, SPECIAL PROVISIONS AND THE MANUFACTURER GUIDELINES FOR PROPER INSTALLATION. THE LOCATIONS OF WIRE AND EQUIPMENT ARE APPROXIMATE AND SHALL BE VERIFIED WITH THE ENGINEER PRIOR TO INSTALLATION.
3. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR COORDINATION WITH ALL UTILITIES TO VERIFY THEIR REQUIREMENTS ARE MET WITH THE CONSTRUCTION.
4. THE BRIDGE IS 201 FEET LONG, AN OVERALL WIDTH OF 26 FEET AND A ROADWAY WIDTH OF 24 FEET. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXACT DIMENSIONS AS REQUIRED.
5. NO STRUCTURAL MEMBERS OF THE BRIDGE SHALL BE CUT OR NOTCHED BY THE CONTRACTOR AS PART OF INSTALLING THE FIRE PROTECTION SYSTEM.
6. THE CONTRACTOR SHALL COORDINATE WITH THE TOWN AND ITS ALARM MONITORING COMPANY AND ENSURE THAT THE SYSTEM IS FUNCTIONING PROPERLY.
7. ALL WORK DESCRIBED AND DETAILED ON THIS SHEET WILL BE PAID UNDER ITEM 900.645 (SPECIAL PROVISION, FIRE DETECTION SYSTEM).

Hoyle, Tanner & Associates, Inc.

HTA PROJECT NO. 90427 MODEL FDS

PROJECT NAME:	MIDDLEBURY-WEYBRIDGE	PROJECT NUMBER:	BHO 1445(33)
FILE NAME:	z06J086FDS0.dgn	PLOT DATE:	9/20/2011
PROJECT LEADER:	M.D.SARGENT	DRAWN BY:	J.B.McQUAD
DESIGNED BY:	J.BICJA	CHECKED BY:	S.T.JAMES
FIRE DETECTION SYSTEM & DETAILS		SHEET 56 OF 66	