



NON-VOIDED SLAB PLAN - TYPE II
 BEAM NO. 2 (BEAM NO. 6 SAME BY 180° ROTATION)
 SCALE 1/2" = 1'-0"

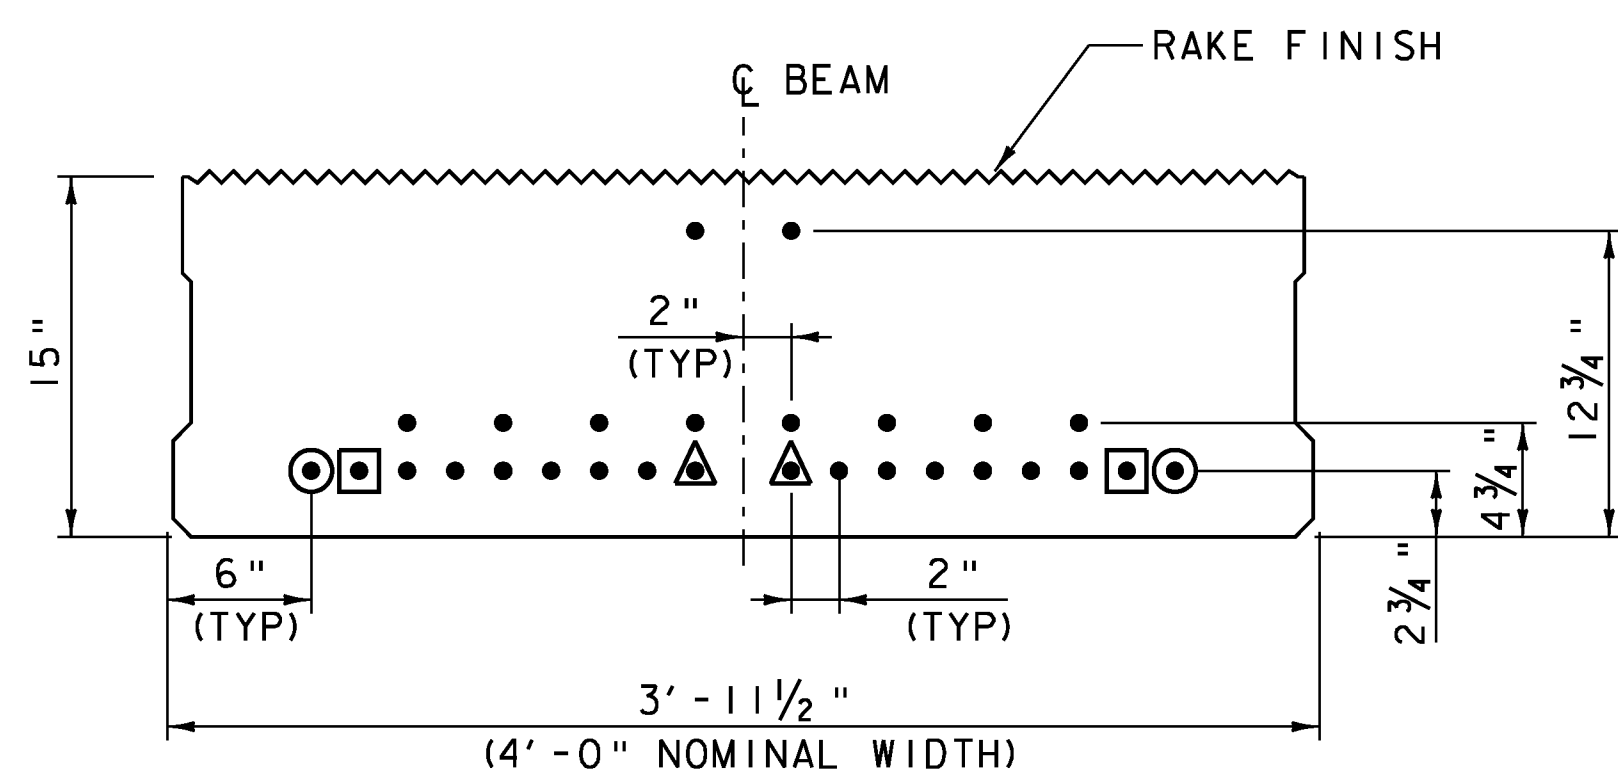


- ▲ - (2) SHIELDED AT ENDS FOR 10'-0"
- - (2) SHIELDED AT ENDS FOR 12'-0"
- - (2) SHIELDED AT ENDS FOR 14'-0"


PRESTRESSED S11-48 BEAM
 TYPICAL SECTION - STRAND LAYOUT
 SCALE 1/2" = 1'-0"

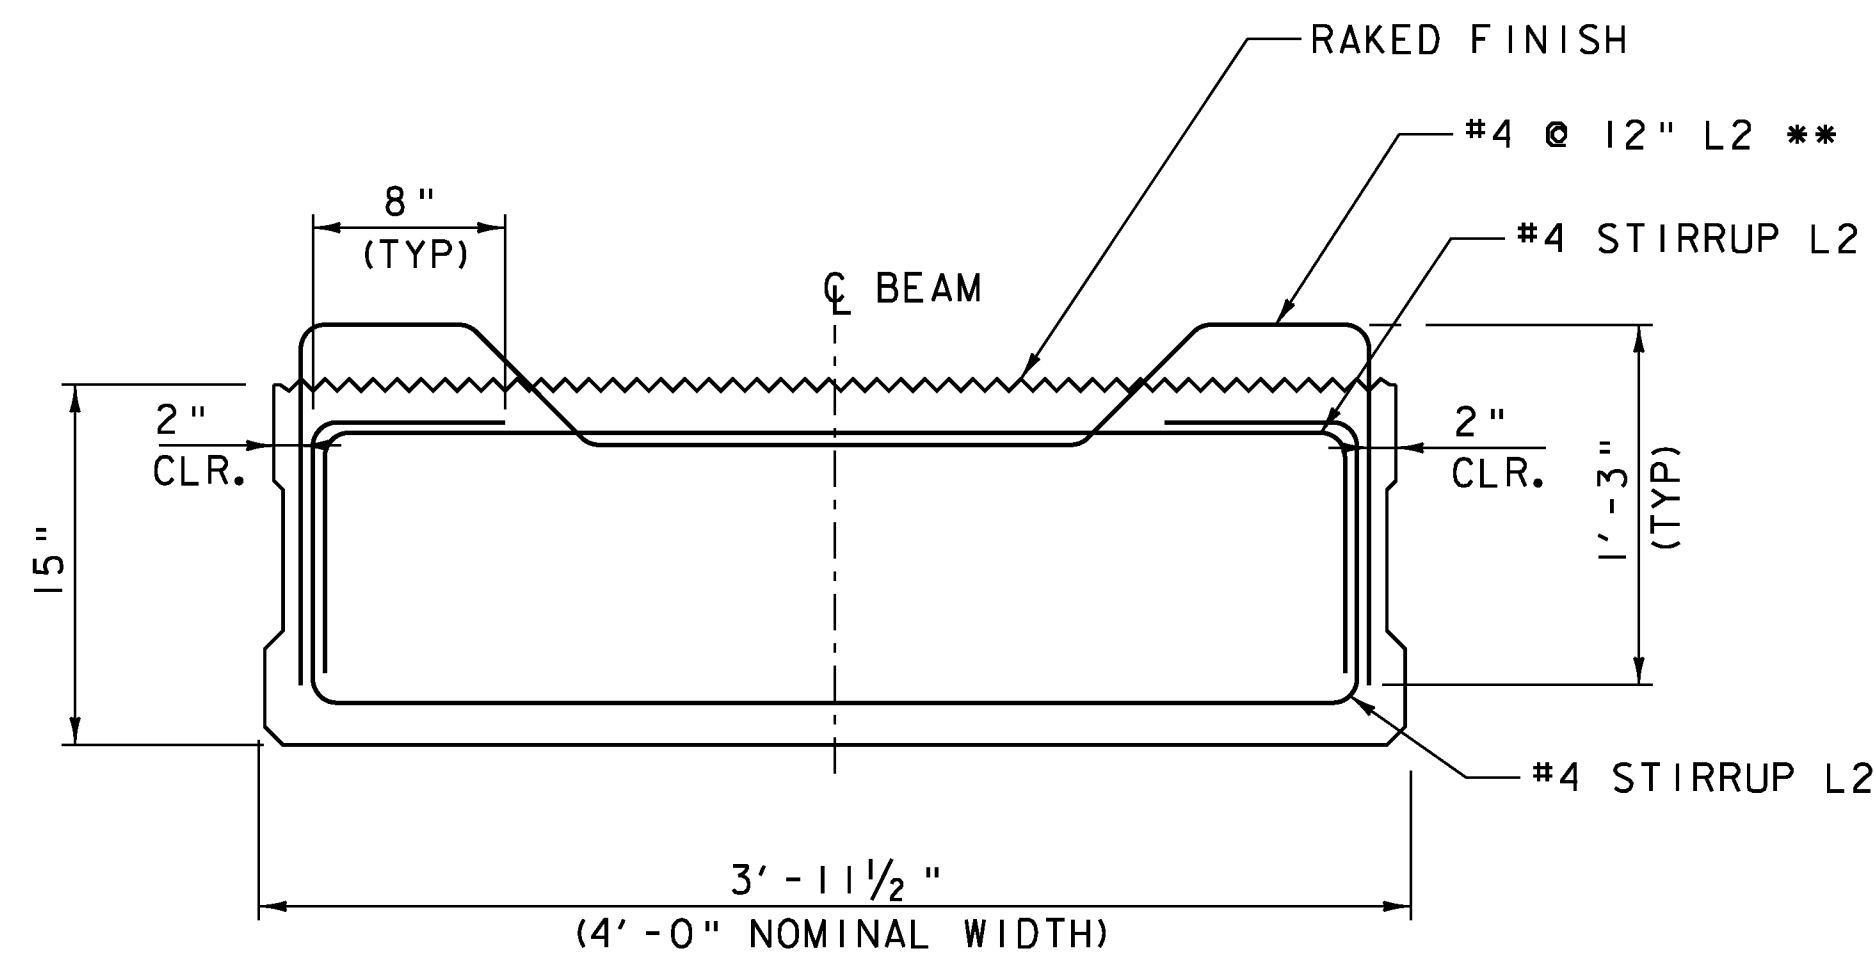

PRESTRESSED S11-48 BEAM
 TYPICAL SECTION - REINFORCING
 SCALE 1/2" = 1'-0"

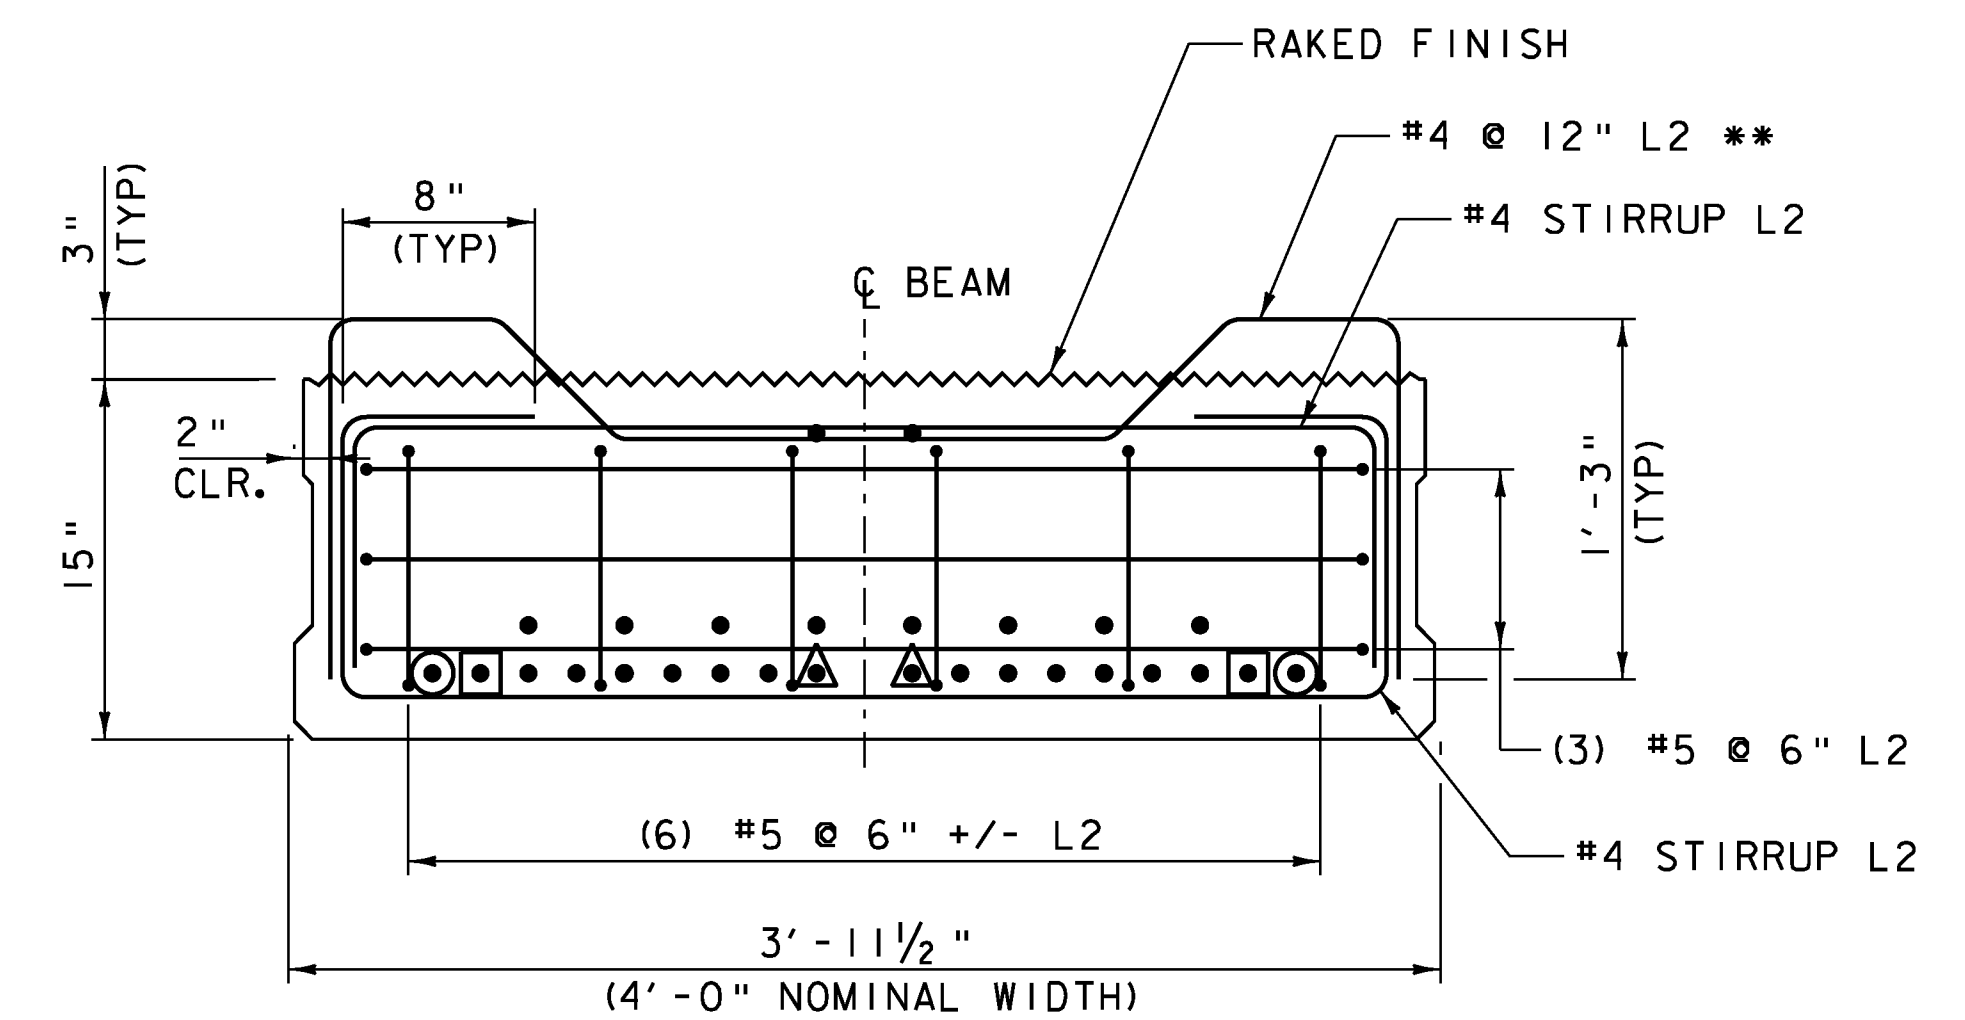

PRESTRESSED S11-48 BEAM
 TYPICAL SECTION - END REINFORCING
 SCALE 1/2" = 1'-0"

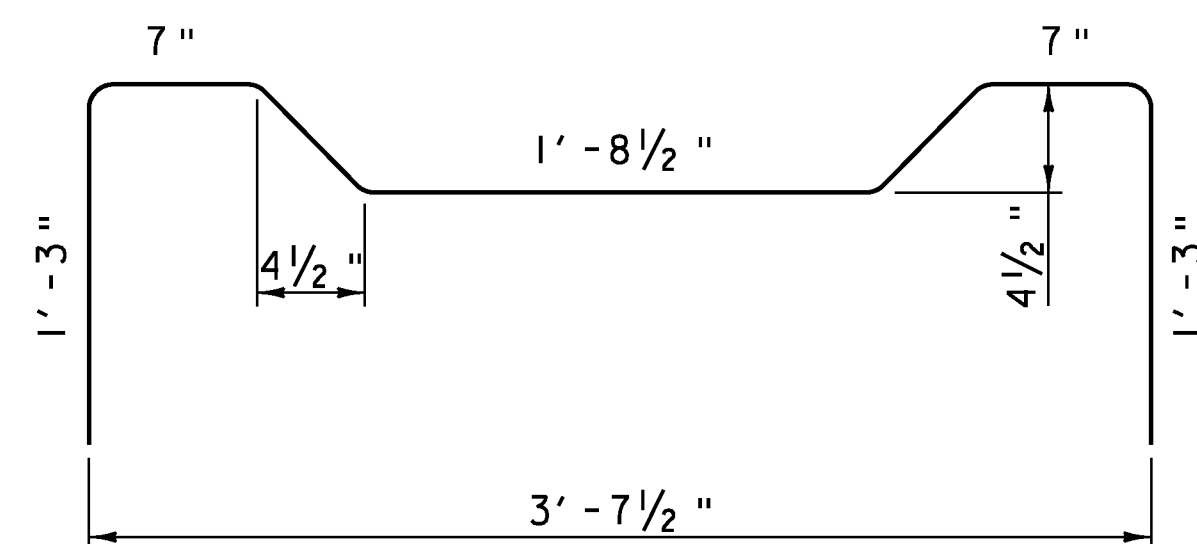

"M" BAR **
 SCALE 1/2" = 1'-0"

** - FIRST "M" - BAR SHALL BE PARALLEL WITH END OF S11-48 BEAM, 2ND SHALL BE FLARED AND THIRD SHALL BE PERPENDICULAR WITH THE SIDES OF THE S11-48 BEAM. FIRST "M" - BAR SHALL BE LOCATED SO AS TO BE 3" CLEAR FROM THE ASPHALTIC PLUG JOINT. CONTRACTOR SHALL COORDINATE BETWEEN ASPHALTIC PLUG MANUFACTURER, INSTALLER AND NON-VOIDED SLAB FABRICATOR TO LOCATE "M" - BAR PROPERLY.

NOTES:

1. REINFORCING STEEL SHALL MEET THE REQUIREMENTS OF SECTION 507, LEVEL II.
2. SEE NEXT SHEET FOR END OF BEAM REINFORCING AND STIRRUP SPACING.

PROJECT NAME: BRATTLEBORO
 PROJECT NUMBER: BRO 1442(35)

FILE NAME: z10j062sup02.dgn PLOT DATE: 10/14/2013
 PROJECT LEADER: S.E. BURBANK DRAWN BY: E.A. FIALA
 DESIGNED BY: B.M. KLINFELTER CHECKED BY: S.E. BURBANK
 NON-VOIDED SLAB DETAILS TYPE II (1 OF 2) SHEET 33 OF 68