


ABUTMENT #1 REINFORCING NOTES

1. ALL REINFORCING STEEL SHALL MEET THE REQUIREMENTS OF AASHTO M31M (ASTM A615M) ALL BARS SHALL BE GRADE 420 Mpa
2. ALL ABUTMENT REINFORCEMENT SHALL BE EPOXY COATED FINISH UNLESS NOTED OTHERWISE.
3. ALL BENDS SHALL CONFORM TO ACI 318M RECOMMENDED PIN DIAMETERS
4. ALL DIMENSIONS ARE OUT TO OUT OF REINFORCEMENT
5. PROVIDE 75 mm CLEAR COVER TYPICAL U.N.O.

CALDERWOOD ENGINEERING, ETC.
 STRUCTURAL ENGINEERING • DETAILING SERVICES
 222 RIVER ROAD, RICHMOND, ME 04867 PH/FX (207)757-4801
PREPARED FOR AUSTIN CONST., INC
BURKE - VALUE ENGINEERING
 PROJ. BRZ. 1447 (16)

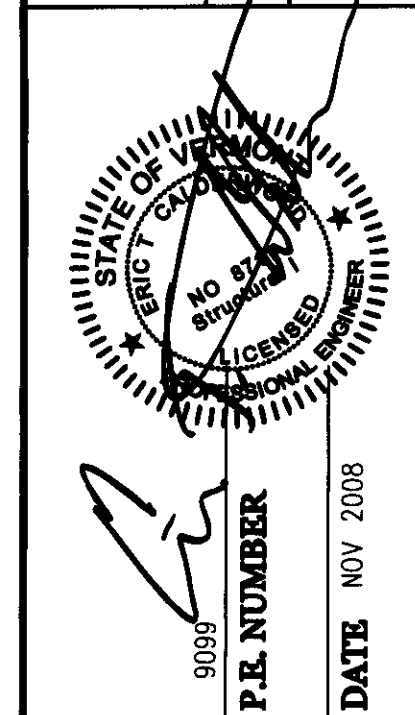

DESIGN-DETAILED	DATE	BY
CHECKED-REVIEWED	NOV 08	ETC
REVISIONS 1	JAN 09	REVISED PER AOT COMMENTS
REVISIONS 2	MAR 09	NO CHANGES THIS SHIT
REVISIONS 3	APR 09	NO CHANGES THIS SHIT
REVISIONS 4		
FIELD CHANGES		

BURKE
VALUE ENGINEERED DESIGN
ABUTMENT #1 REINFORCEMENT

SHEET NUMBER
A6