Notice: Not for Use/disclosure outside of BELL ATLANTIC without written agreement

BELL ATLANTIC

SAFETY NOTES: INPUT	MOD/REV NO.	DATE	EWO NO. .	
			PRINT 3 OF	
			PREPARED BY:	
			J. BRIAN GRESL	
			C.O. /EXCHANGE NAME:	
	TYPE -	RECORD REF:	S. ROYALTON	
SIGNATURE DATE INPUT	AERIAL	INPUT	C.O. /EXCHANGE CODE:	
PRE CT YES ☐ NO ☒	UNDERGROUND	—	4875	
PRIMARY VOLTAGE TO GROUND	BLOCK (NYT)	—	MUNICIPALITY:	
7.2 KV MGN SYSTEM	CONDUIT	—	S. ROYALTON	
CABLE PRESS. / UNDER PRESS. YES ☐ NO ☒	BUFFER YES ☐	NO ☒	MANHOLE LOCATION MH# NA	
TRANSMISSION / 26GA LIMIT YES ☐ NO ☒	AMT. BRIDGE TAP	INPUT	KF	

PROJECT - 131154

WORK ORDER

4C - PL 6 - 4" PC
MH#13 TO PT"A" = '406

SEE PLAN # 5 & 6 FOR TRENCH DETAILS

NOTE TO CONTRACTOR
- WATER AND SEWER SERVICES NOT SHOWN
LOCATE PRIOR TO EXCAVATING

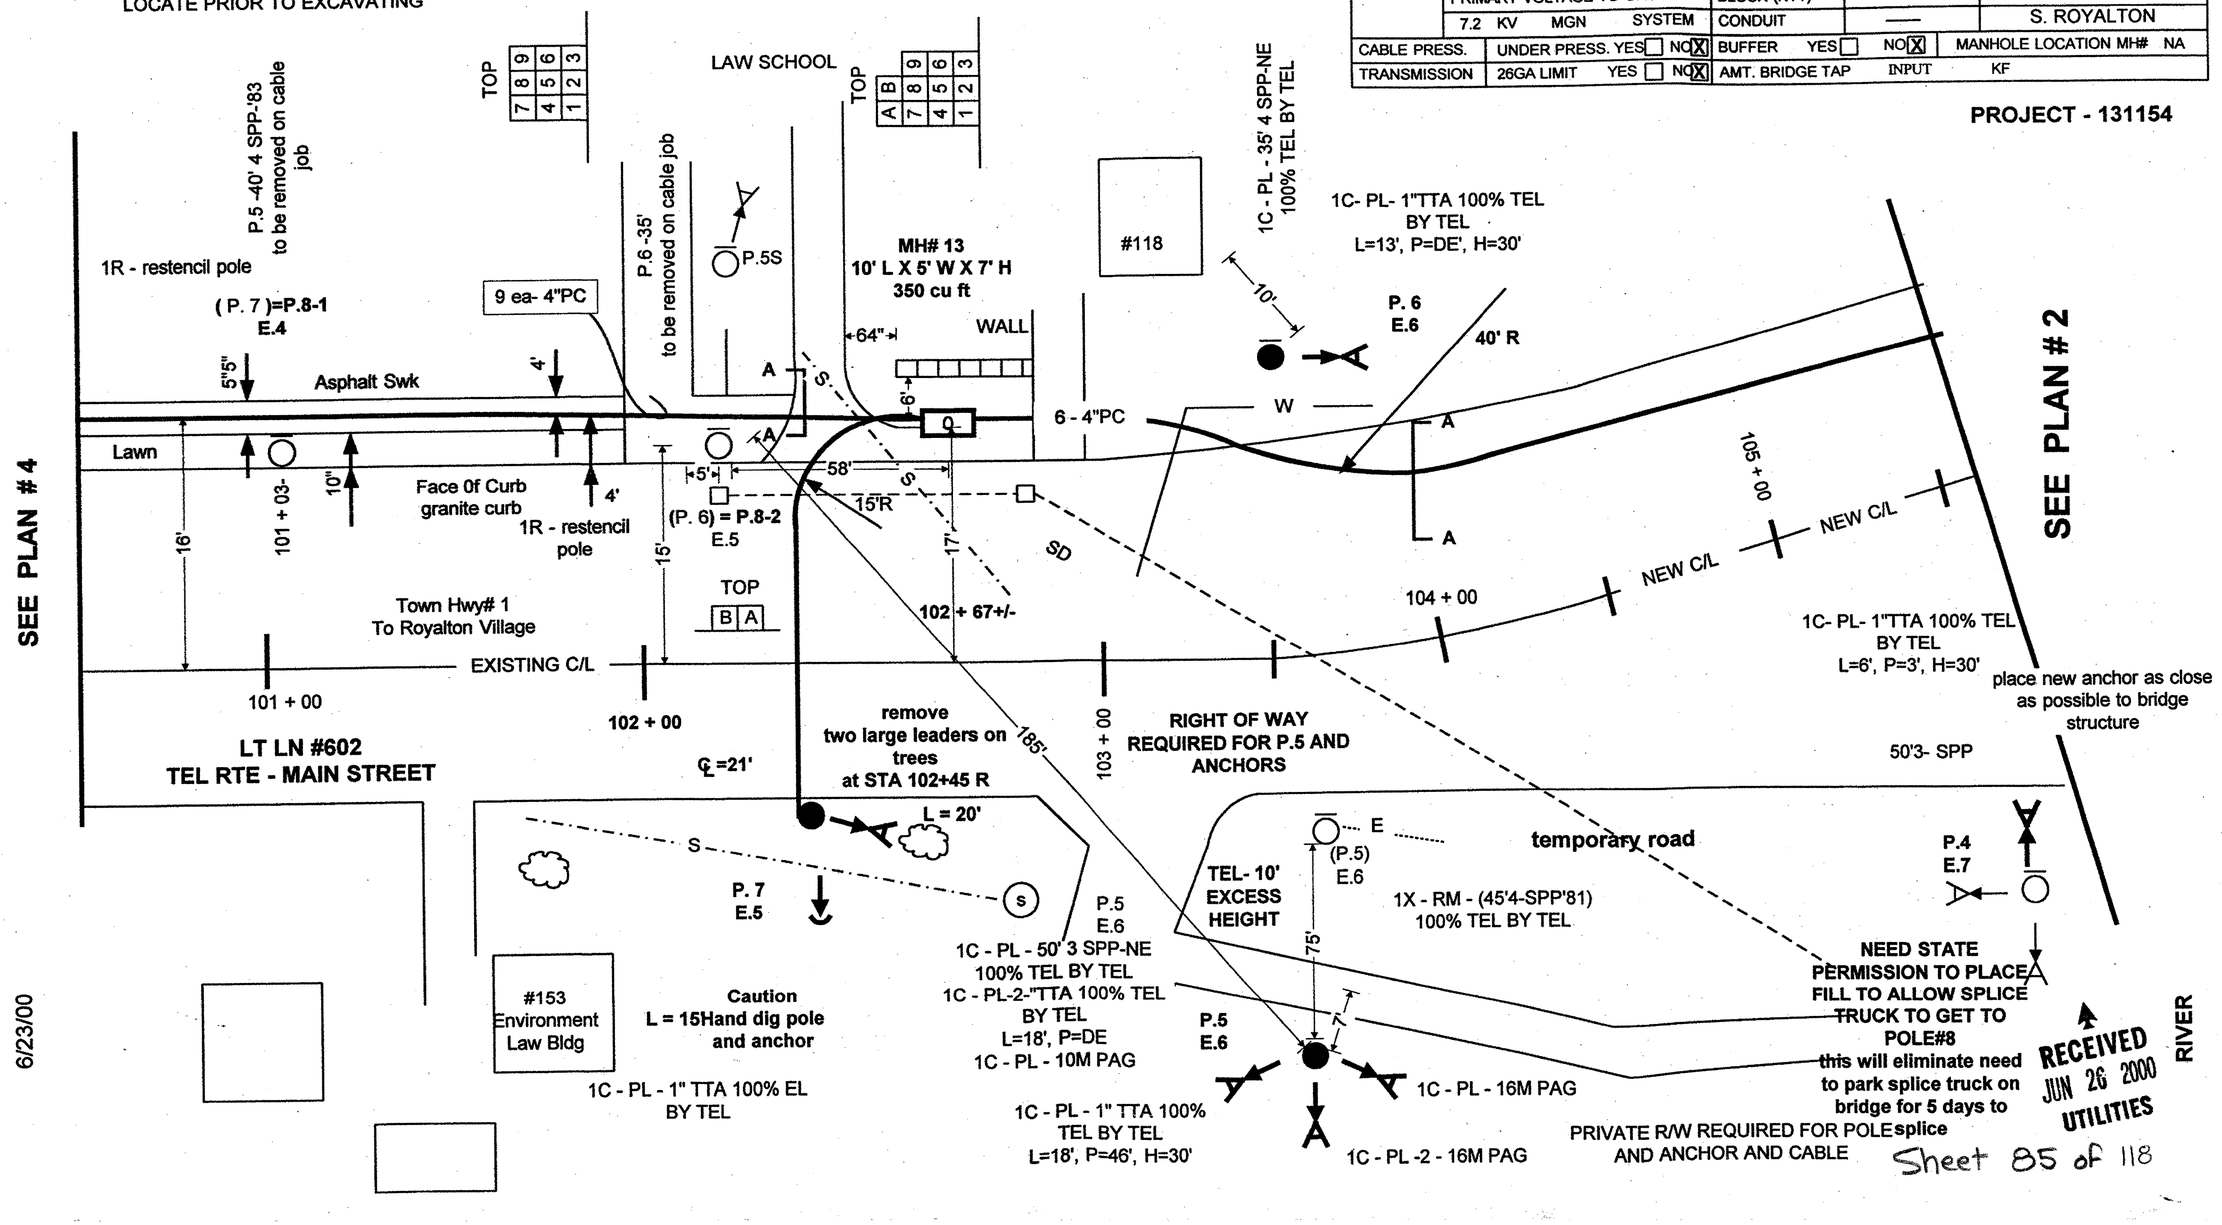

6/23/00

RECEIVED
JUN 26 2000
UTILITIES

Sheet 85 of 118