


Joint Detail

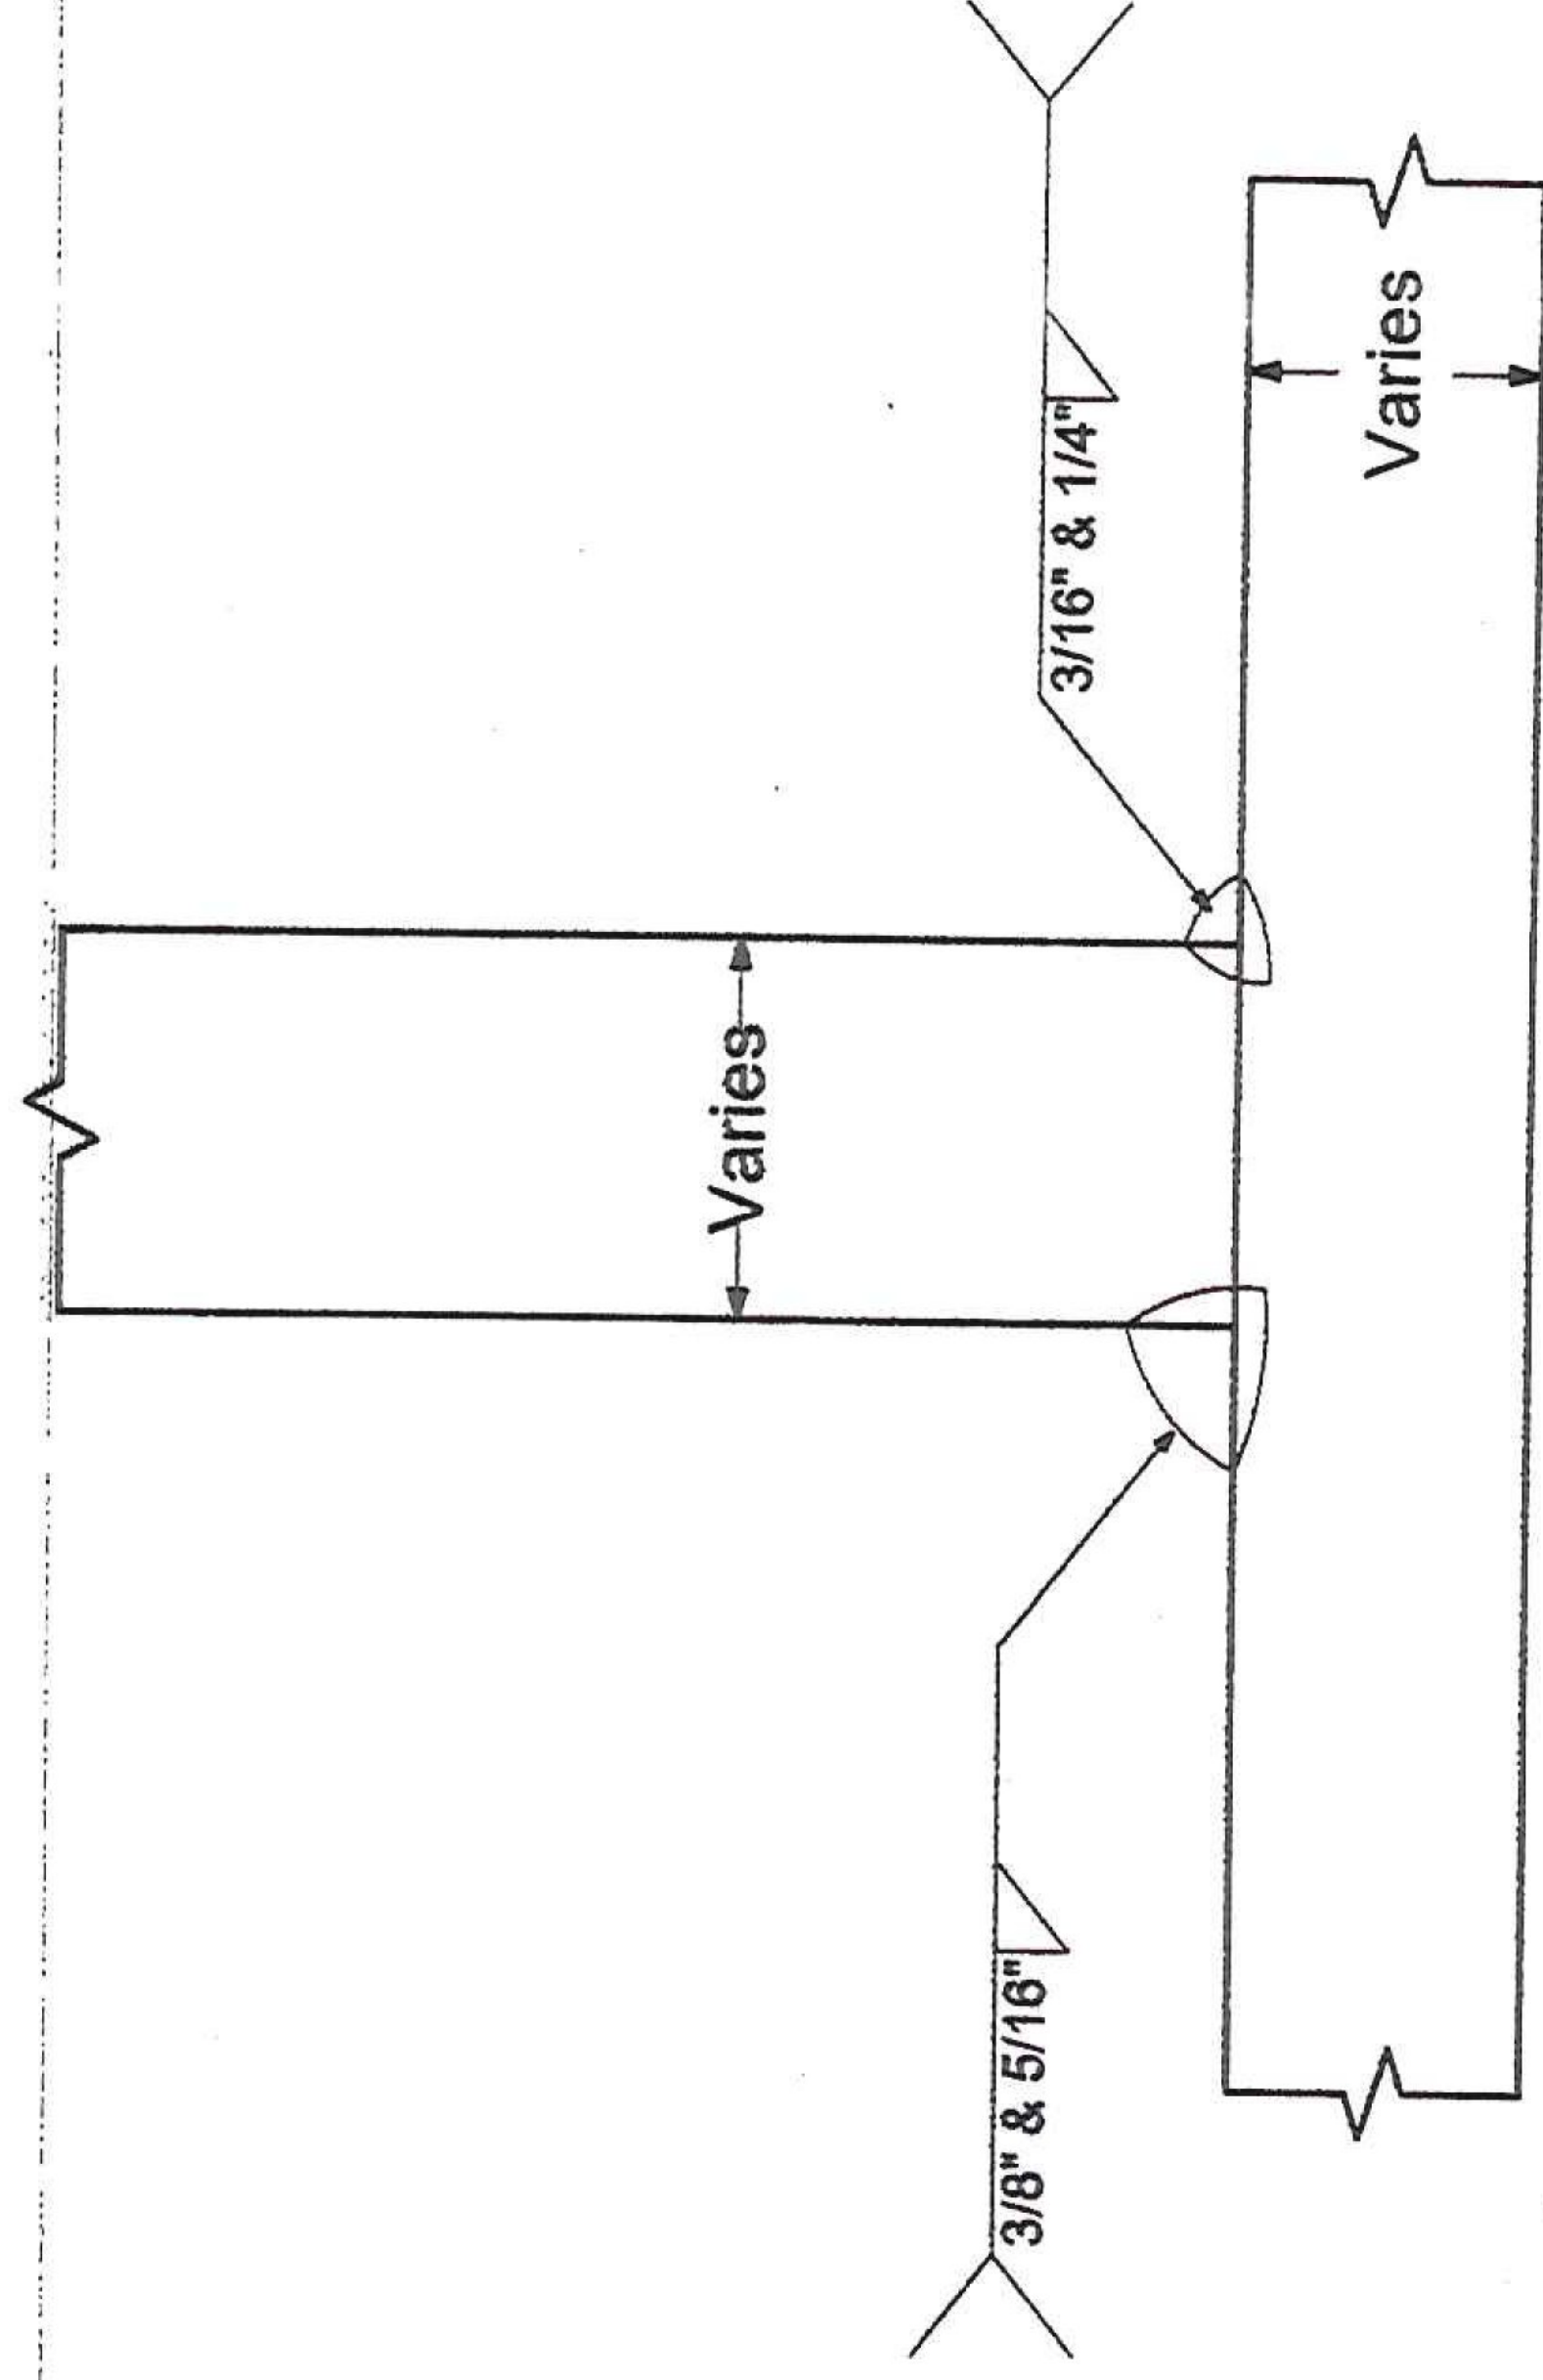

MEMO

Preheat Treatment:
50 Deg. F. up to 3/4";
over 3/4" to 1 1/2" 70 Deg. F.;
over 1 1/2" to 2 1/2" 150 Deg. F

Supporting LBF PQR 2009 A Expire March 2014
For Bridge Flooring

RECEIVED

CK'D BY _____ OK'D BY _____

FEB 18 2011

RESUBMIT _____ APPROVED

BY *KMH* DATE *2/24/11*