



DRILL AND GROUT CF80IBARS ▲ 2'-0" MIN. EMBEDMENT
 AS REQUIRED TO HOLD REINFORCING STEEL GRID IN PLACE.
 IN ORDER TO PRESERVE THE EXISTING STONE INTEGRITY, USE
 OF A PNEUMATIC ROTARY DRILL WILL NOT BE ALLOWED. HOLES
 FOR DOWELS WILL BE CORE DRILLED TO 2 INCH DIAMETER.

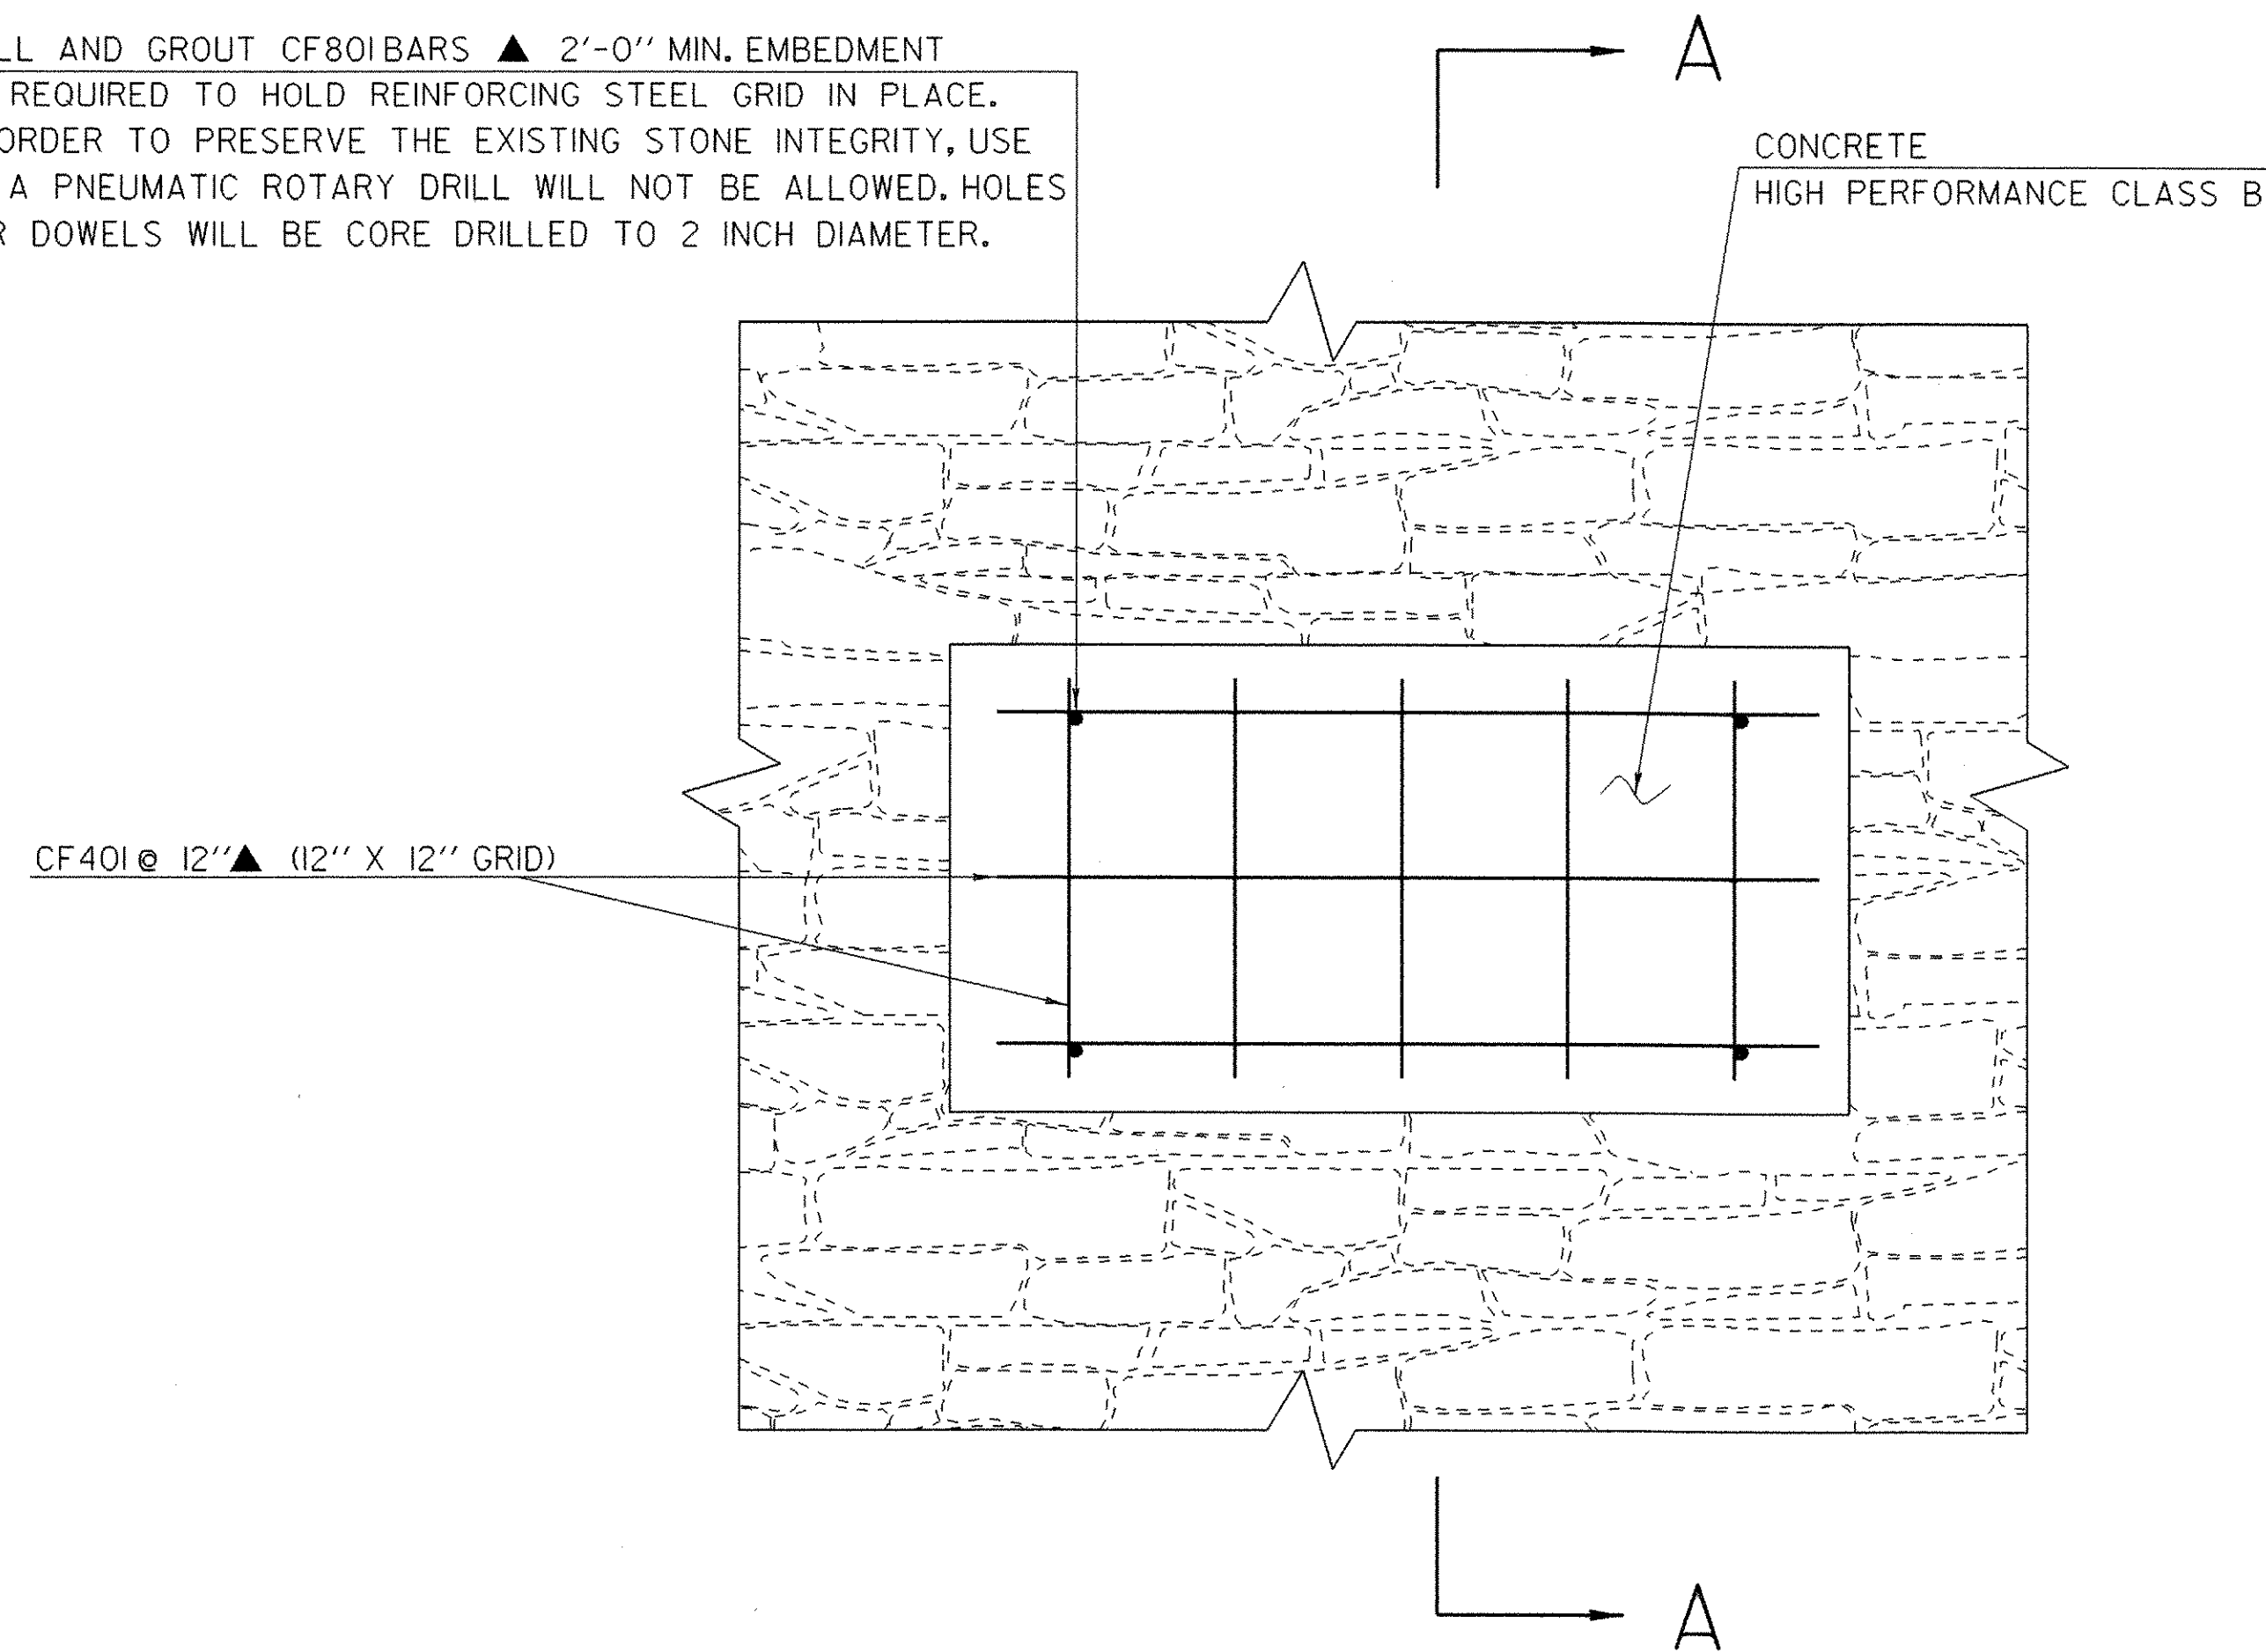

ABUTMENT #2 TYPICAL REPAIR AREA
 ELEVATION

SCALE: 1" = 1'

CONCRETE
 HIGH PERFORMANCE CLASS B

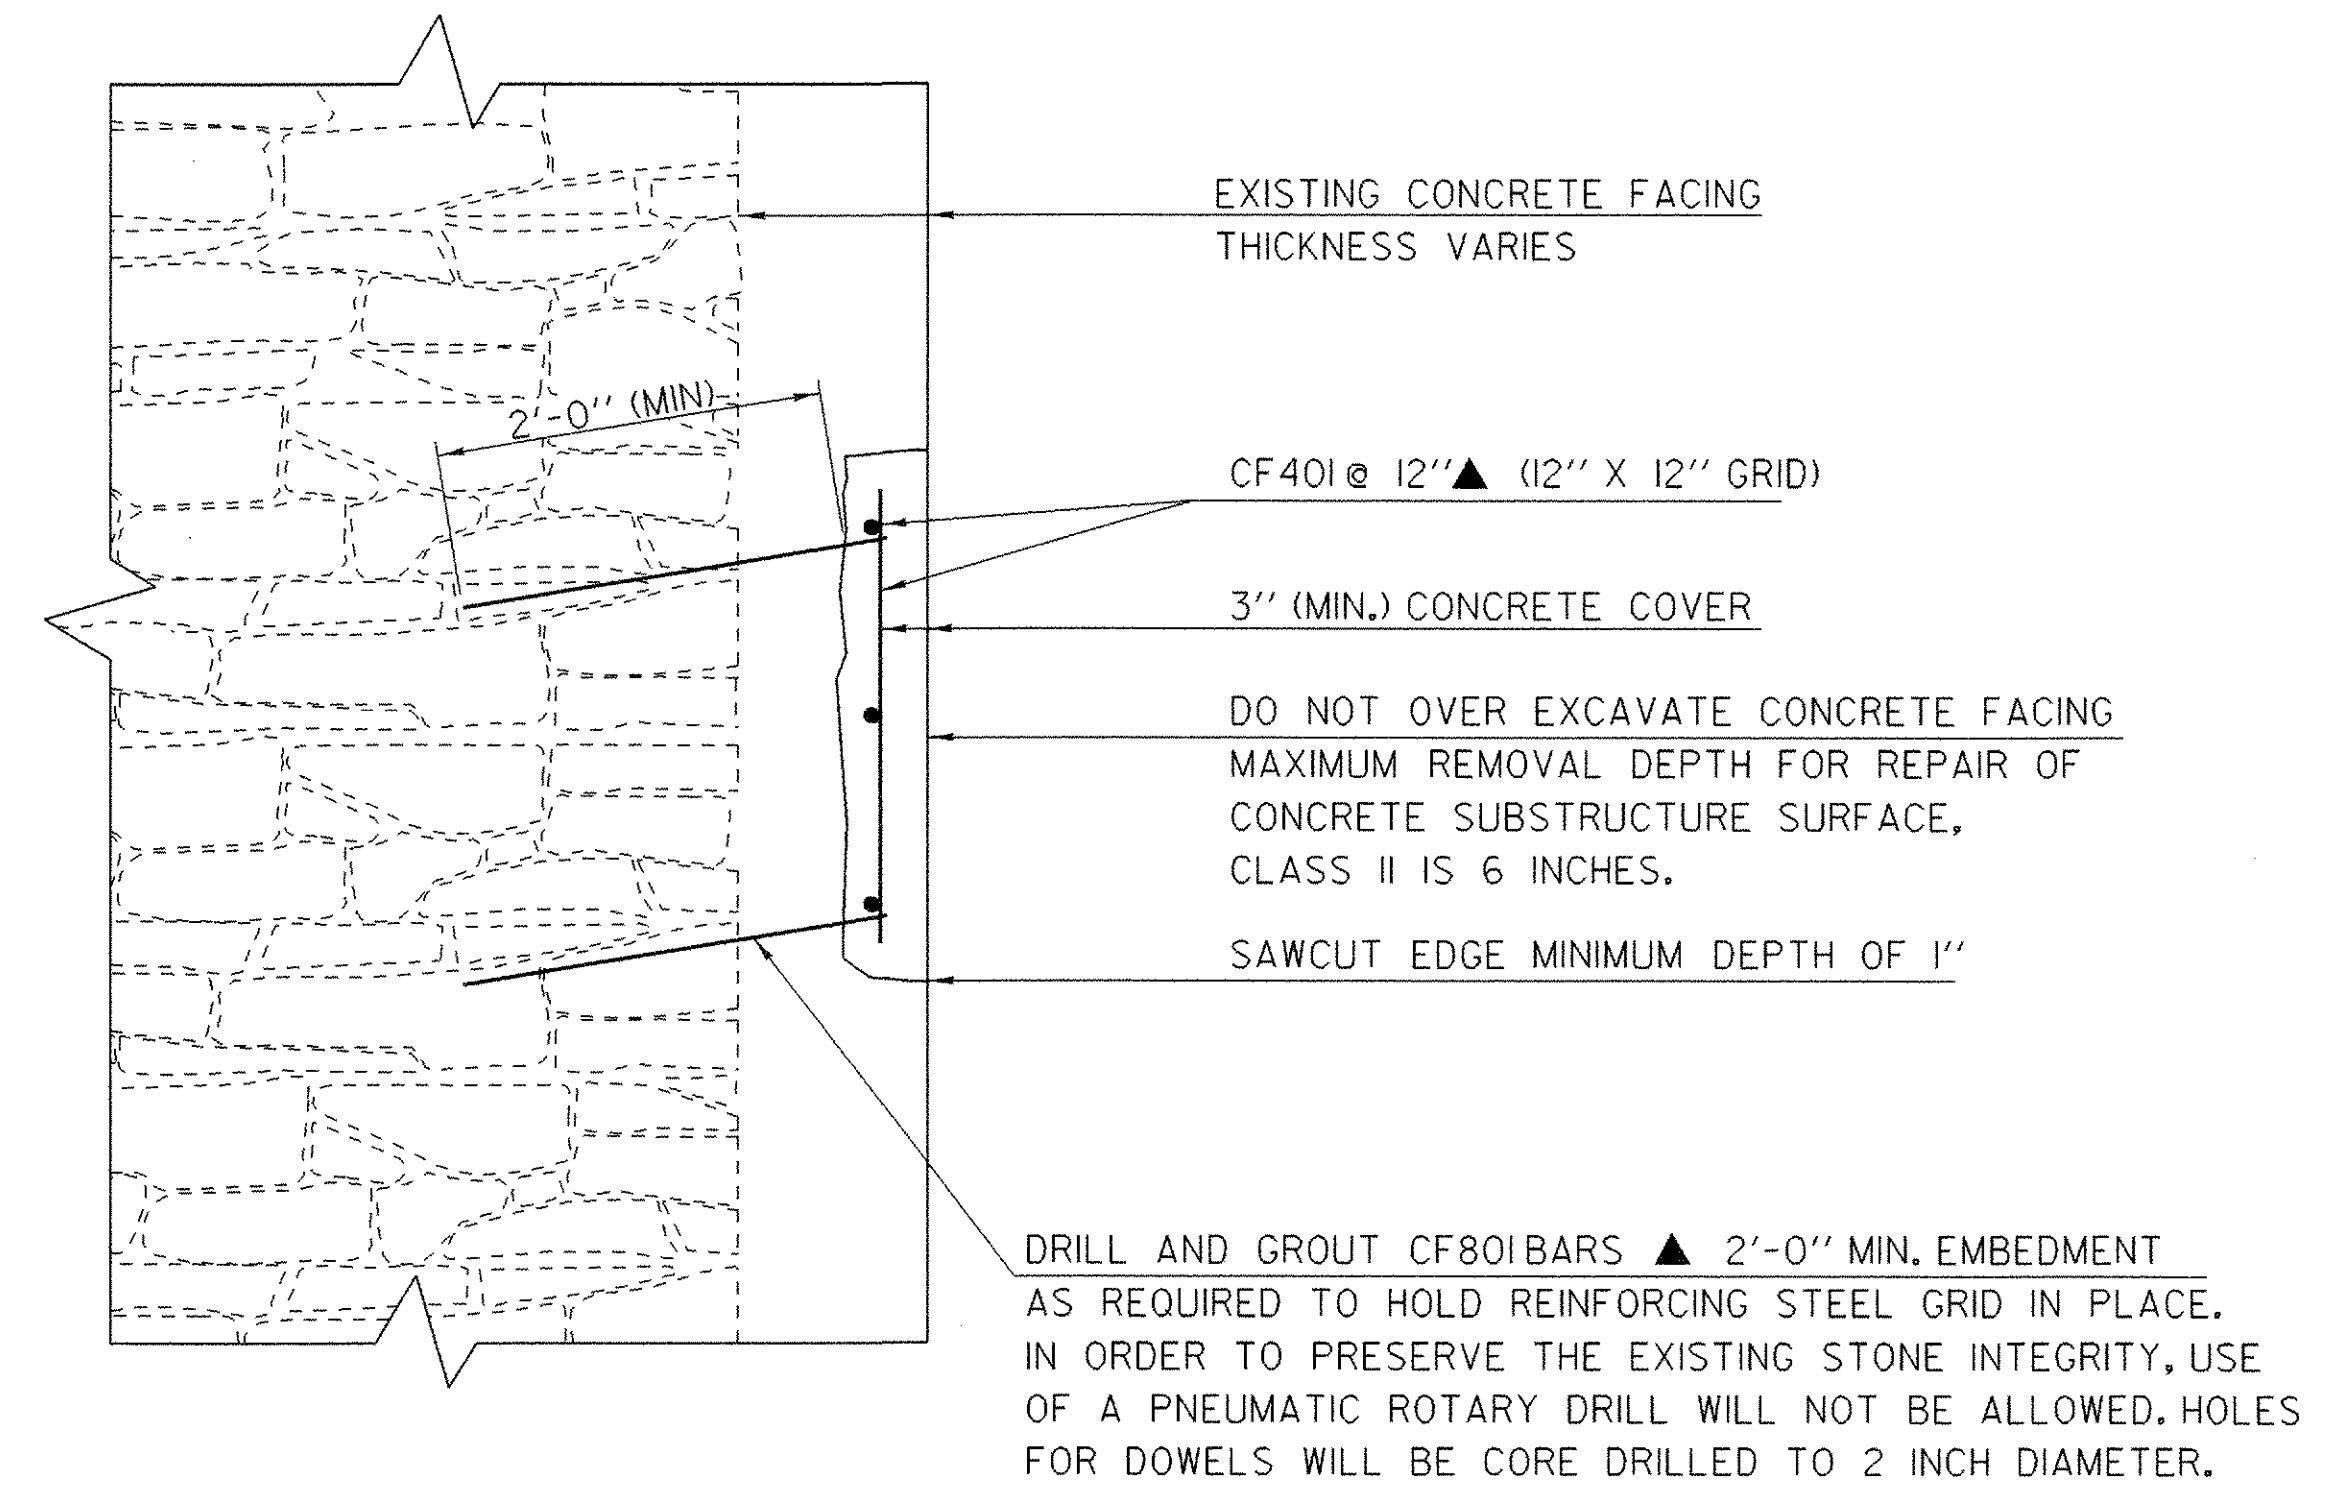

ABUTMENT #2 TYPICAL REPAIR AREA
 SECTION A-A

SCALE: 1" = 1'

CONCRETE FACING REPAIR DETAIL

PROJECT NAME:	WEATHERSFIELD
PROJECT NUMBER:	BHO 1442(29)
FILE NAME: /96J234/str/s96J234typ.dgn	PLOT DATE: 15-MAR-2007
PROJECT LEADER: W. SYMONDS	DRAWN BY: D. BASSETT
DESIGNED BY: T. SUMNER	CHECKED BY: T. SUMNER
sj234repair.i	SHEET 43 OF 60