
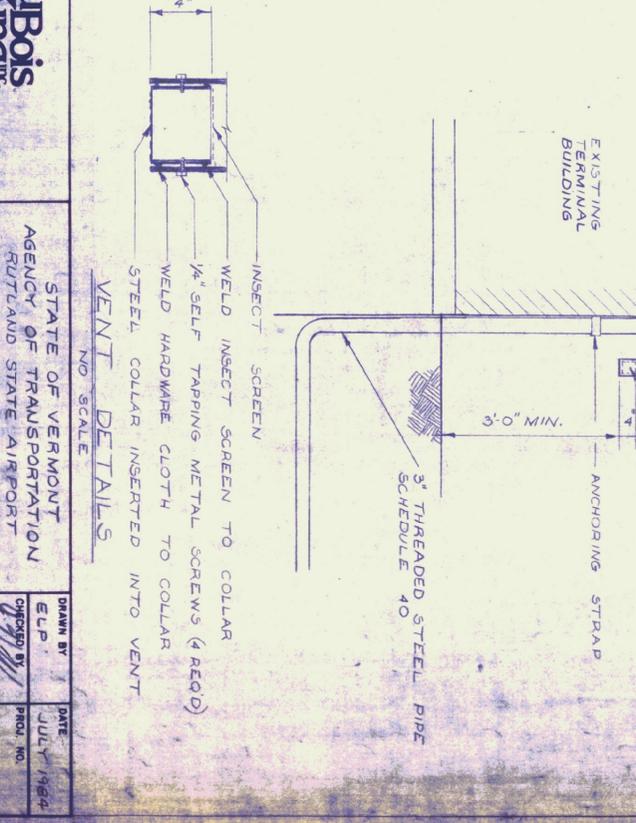
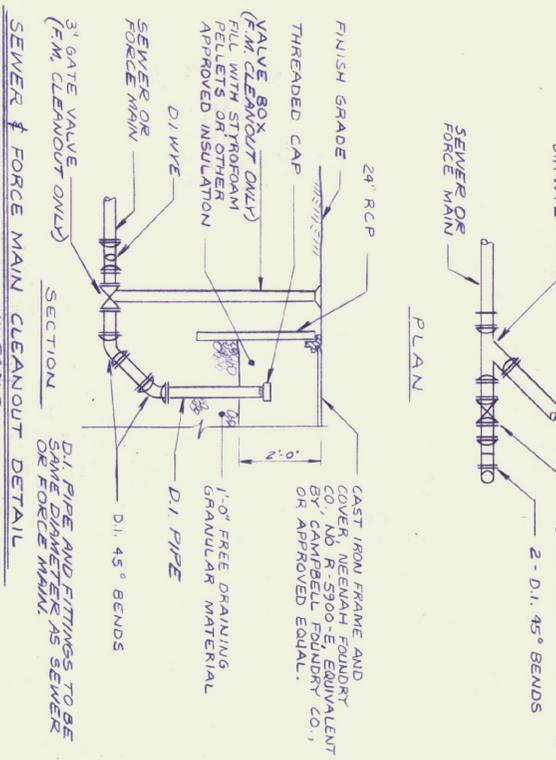


DUPLEX GRINDER PUMPING STATION SCHEDULE

PUMPING STATION LOCATION	INLET-SIZE AND INVERT EL.	INLET-SIZE AND INVERT EL.	INLET-SIZE AND INVERT EL.	DISCHARGE-SIZE AND INVERT EL.	LEAD/LAG PUMPS OFF EL.	LEAD PUMP ON-EL.	LAG PUMP ON-EL.	ALARM ON-EL.	PORTABLE PUMP CONNECTION SIZE	VENT DIAMETER	BOTTOM EL. OF VENT WELL
	6"	773.3	6"	773.3	771.3	772.8	773.3	773.3	3"	3"	770.3
	6"	773.3	6"	773.3	771.3	772.8	773.3	773.3	3"	3"	770.3
	6"	773.3	6"	773.3	771.3	772.8	773.3	773.3	3"	3"	770.3
	6"	773.3	6"	773.3	771.3	772.8	773.3	773.3	3"	3"	770.3
	6"	773.3	6"	773.3	771.3	772.8	773.3	773.3	3"	3"	770.3
	6"	773.3	6"	773.3	771.3	772.8	773.3	773.3	3"	3"	770.3

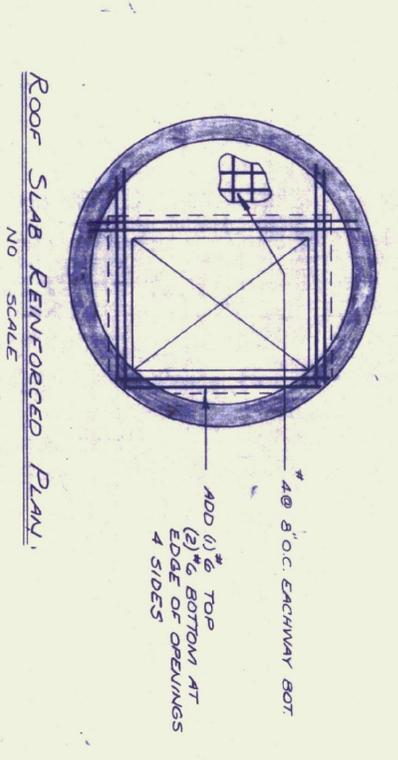

REVISIONS

NO.	DATE	BY	CRD.



engineering planning management development
DUBOIS E KING INC.
 STATE OF VERMONT
 AGENCY OF TRANSPORTATION
 RUTLAND STATE AIRPORT
 SEWER PUMP STATION
 PLANS AND DETAILS
 DRAWN BY ELP
 CHECKED BY EBC
 DATE JULY 1984
 PROJ. NO. 5557
 SHEET 5 OF 6