


MAIN TERMINAL FIRST FLOOR ELECTRICAL WORK FOR AIR CONDITIONING
 SCALE: 1/4" = 1'-0"

KEYED NOTES:

- ① CONNECT NEW RECEPTACLE TO EXISTING RECEPTACLE CIRCUIT IN THE BOILER ROOM.
- ② PANEL MDP IS AN EXISTING 600A, 120/240V, GE TYPE NLAB PANELBOARD. PROVIDE NEW CIRCUIT BREAKERS FOR THE NEW CIRCUITS AS REQUIRED.
- ③ PROVIDE (2) NEW 30A, 240V, SINGLE-PHASE CIRCUITS & DISCONNECTS FOR NEW COMPRESSORS. PROVIDE ALL LINE VOLTAGE WIRING REQUIRED. PROVIDE NEW GE BOLT-ON BREAKERS FOR PANEL MDP.
- ④ PROVIDE NEW 20A, 240V, SINGLE-PHASE CIRCUIT & DISCONNECT FOR NEW AIR HANDLER. PROVIDE ALL LINE VOLTAGE WIRING REQUIRED. PROVIDE NEW GE BOLT-ON BREAKER FOR PANEL MDP.
- ⑤ PROVIDE NEW JUNCTION BOX & 120V, 20A CIRCUIT FOR USE BY MECHANICAL CONTRACTOR FOR CONTROL CIRCUITRY. PROVIDE NEW CIRCUIT BREAKER IN PANEL MDP.

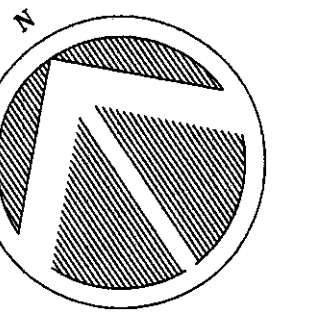


GBA

**GOSSENS
BACHMAN
ARCHITECTS**

85 Granite Shed Lane
 Montpelier, Vermont 05602
 P 802.229.1664 F 802.229.4822



Pearson & Associates
 MECHANICAL & ELECTRICAL ENGINEERS
 P.O. BOX 810 STOWE, VERMONT 05672
 TEL: (802) 253-9607 FAX: (802) 253-9280
 EMAIL: pearson@stowvt.net



STATE OF VERMONT
 DEPARTMENT OF BUILDINGS
 AND GENERAL SERVICES
 AGENCY OF ADMINISTRATION
 MONTPELIER, VERMONT



**Rutland
Airport**

Old Terminal

Rutland, Vermont

Revisions:

Job Number: 0302-105

File Name:

Scale: As Noted

Date: March 2005

**FLOOR PLAN
ELECTRICAL-
NEW
TERMINAL**

E1.2