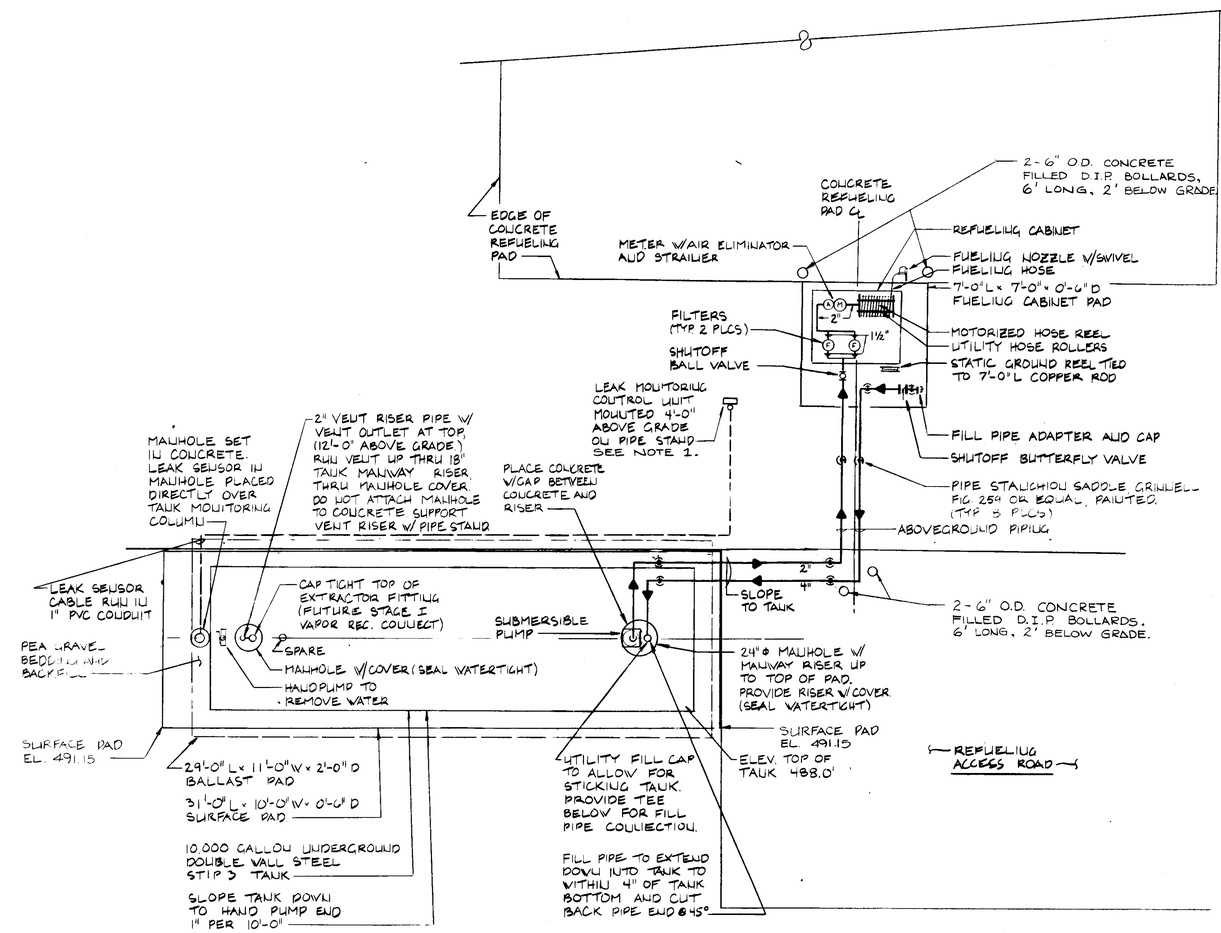

PLAN- TANK, PIPING & REFUELING CABINET

SCALE: 1/4"= 1'-0"

NOTES:

1. CONTRACTOR SHALL MOUNT A 12"x12" ALUMINUM SIGN DIRECTLY BELOW THE LEAK MONITORING UNIT WITH THE FOLLOWING MESSAGE:

   URGENT.
   IF THE LEAK DETECTION ALARM OR LIGHT GOES OFF, CALL THE FOLLOWING PHONE NUMBER COLLECT:
   882-2657

2. REINFORCEMENT FOR BALLAST PAD SHALL BE 2 MATS OF #4-12" EW, 2" MINIMUM COVER.
3. REINFORCEMENT FOR SURFACE PAD SHALL BE 6"x6" - W2 x W2 WWF, 2" MINIMUM COVER.

NO	REVISION	BY	DATE

STATE OF VERMONT — CHARLES L. BURNS — NO. 5563 — REGISTERED PROFESSIONAL ENGINEER

ALTERATION OF THIS DOCUMENT, EXCEPT BY A LICENSED PROFESSIONAL ENGINEER, IS ILLEGAL

DRAWN J.J.P. | CHECKED

PROJECT 1981-03

TANK AND REFUELING CABINET PLAN

MIDDLEBURY STATE AIRPORT
FUELING SYSTEM
A.I.R. 03-2069
TOWN OF MIDDLEBURY

CHA CLOUGH, HARBOUR & ASSOCIATES
ENGINEERS & PLANNERS
3 WINNERS CIRCLE, ALBANY N.Y. 12205/ 518-453-4500

DATE JULY 1990 | SCALE AS SHOWN | DWG. M-1 | SHEET 9 OF 10