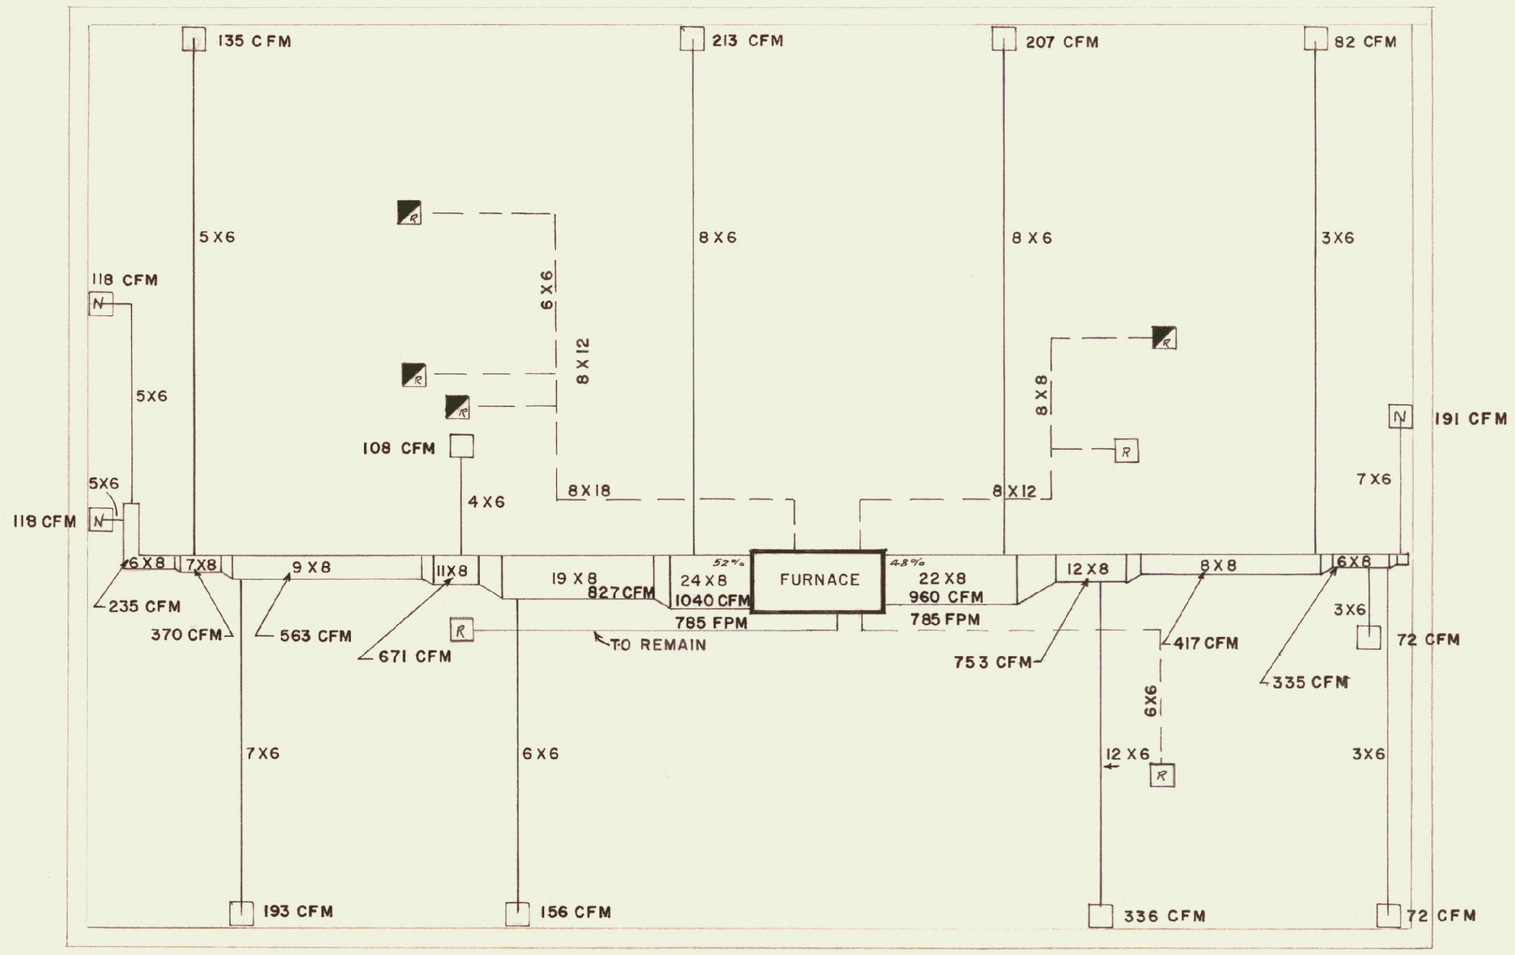

BASEMENT PLAN

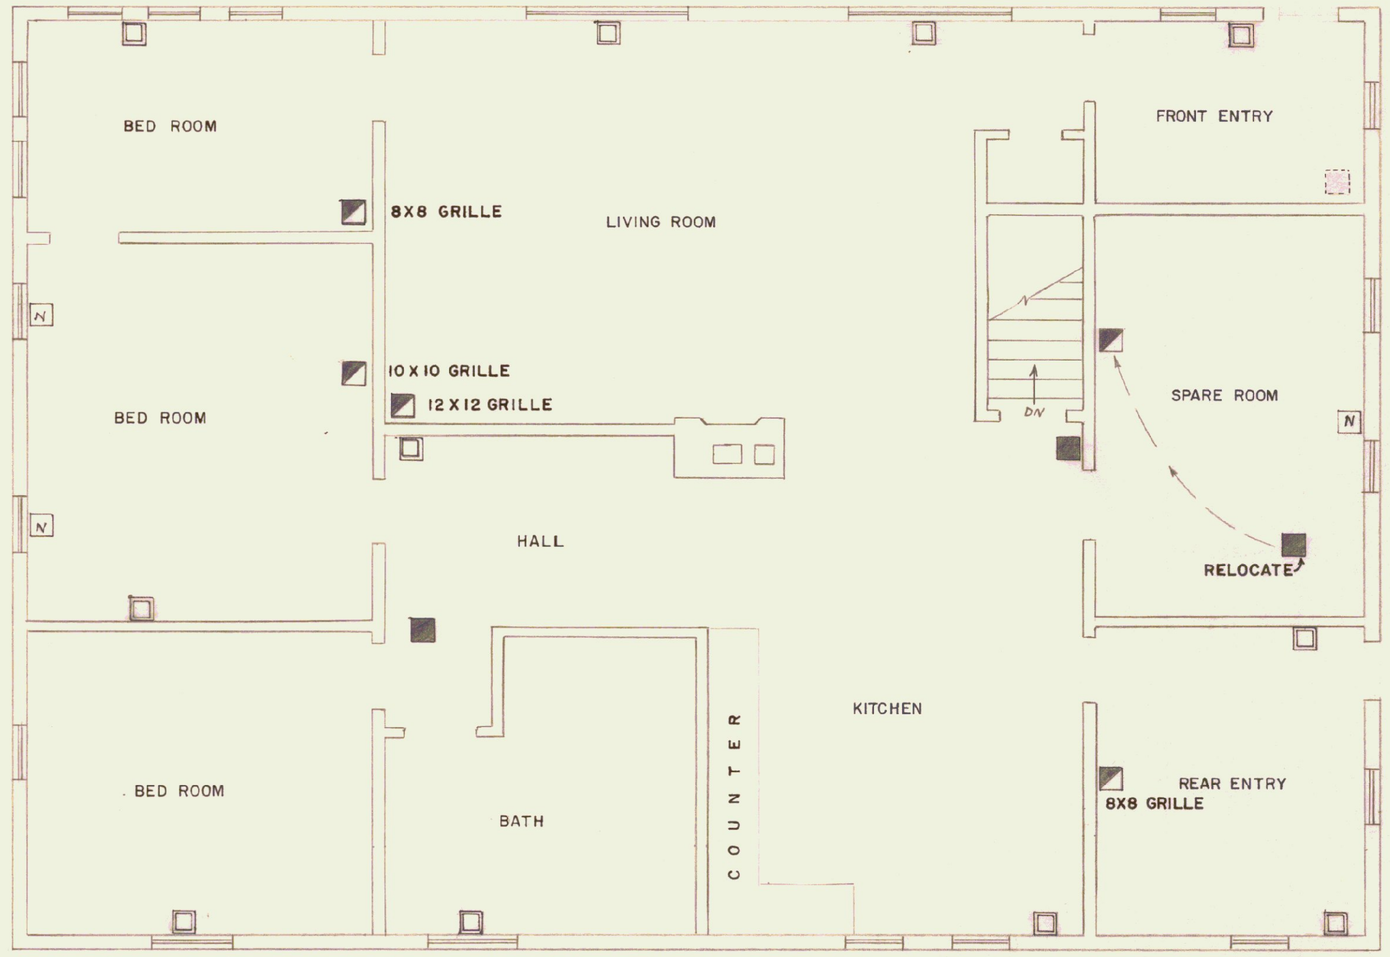

1st. FLOOR PLAN

CONSTRUCTION NOTES

1. PROVIDE SCOOP TAKE-OFF FOR ALL BRANCH DUCTWORK.
2. PROVIDE VOLUME DAMPERS AT ALL SUPPLY AIR DISCHARGE TO SPACES
3. PROPERLY BALANCE SYSTEM TO ACHIEVE DESIGN C.F.M. AT SUPPLY DISCHARGE.
4. SUBMIT BALANCE REPORT.
5. DUCT DRAWINGS ARE ONLY SHOWN FOR SIZE AND THE APPROXIMATE LOCATION. CONTRACTOR SHALL INSTALL DUCTS BETWEEN JOISTS WHEREVER POSSIBLE AND THE FINISHED DUCTWORK SHALL GIVE GOOD HEADROOM AND PROPER INSTALLATION.

KEY

- HOT AIR GRILLES
- COLD AIR RETURNS
- NEW COLD AIR RETURNS
- NEW SUPPLY AIR GRILLES
- EXISTING GRILLE TO BSMT (TO REMAIN)

STATE OF VERMONT
DIVISION OF STATE BUILDINGS
AGENCY OF ADMINISTRATION
MONTPELIER, VERMONT

ISLAND POND AIRPORT HOUSE HEATING RENOVATIONS

DATE:	DESIGNED BY:	DWG. NO.
SEPT 1975	GNM	1
DRAWN BY:	SCALE	___ OF ___
DON	1/4" = 1 FOOT	