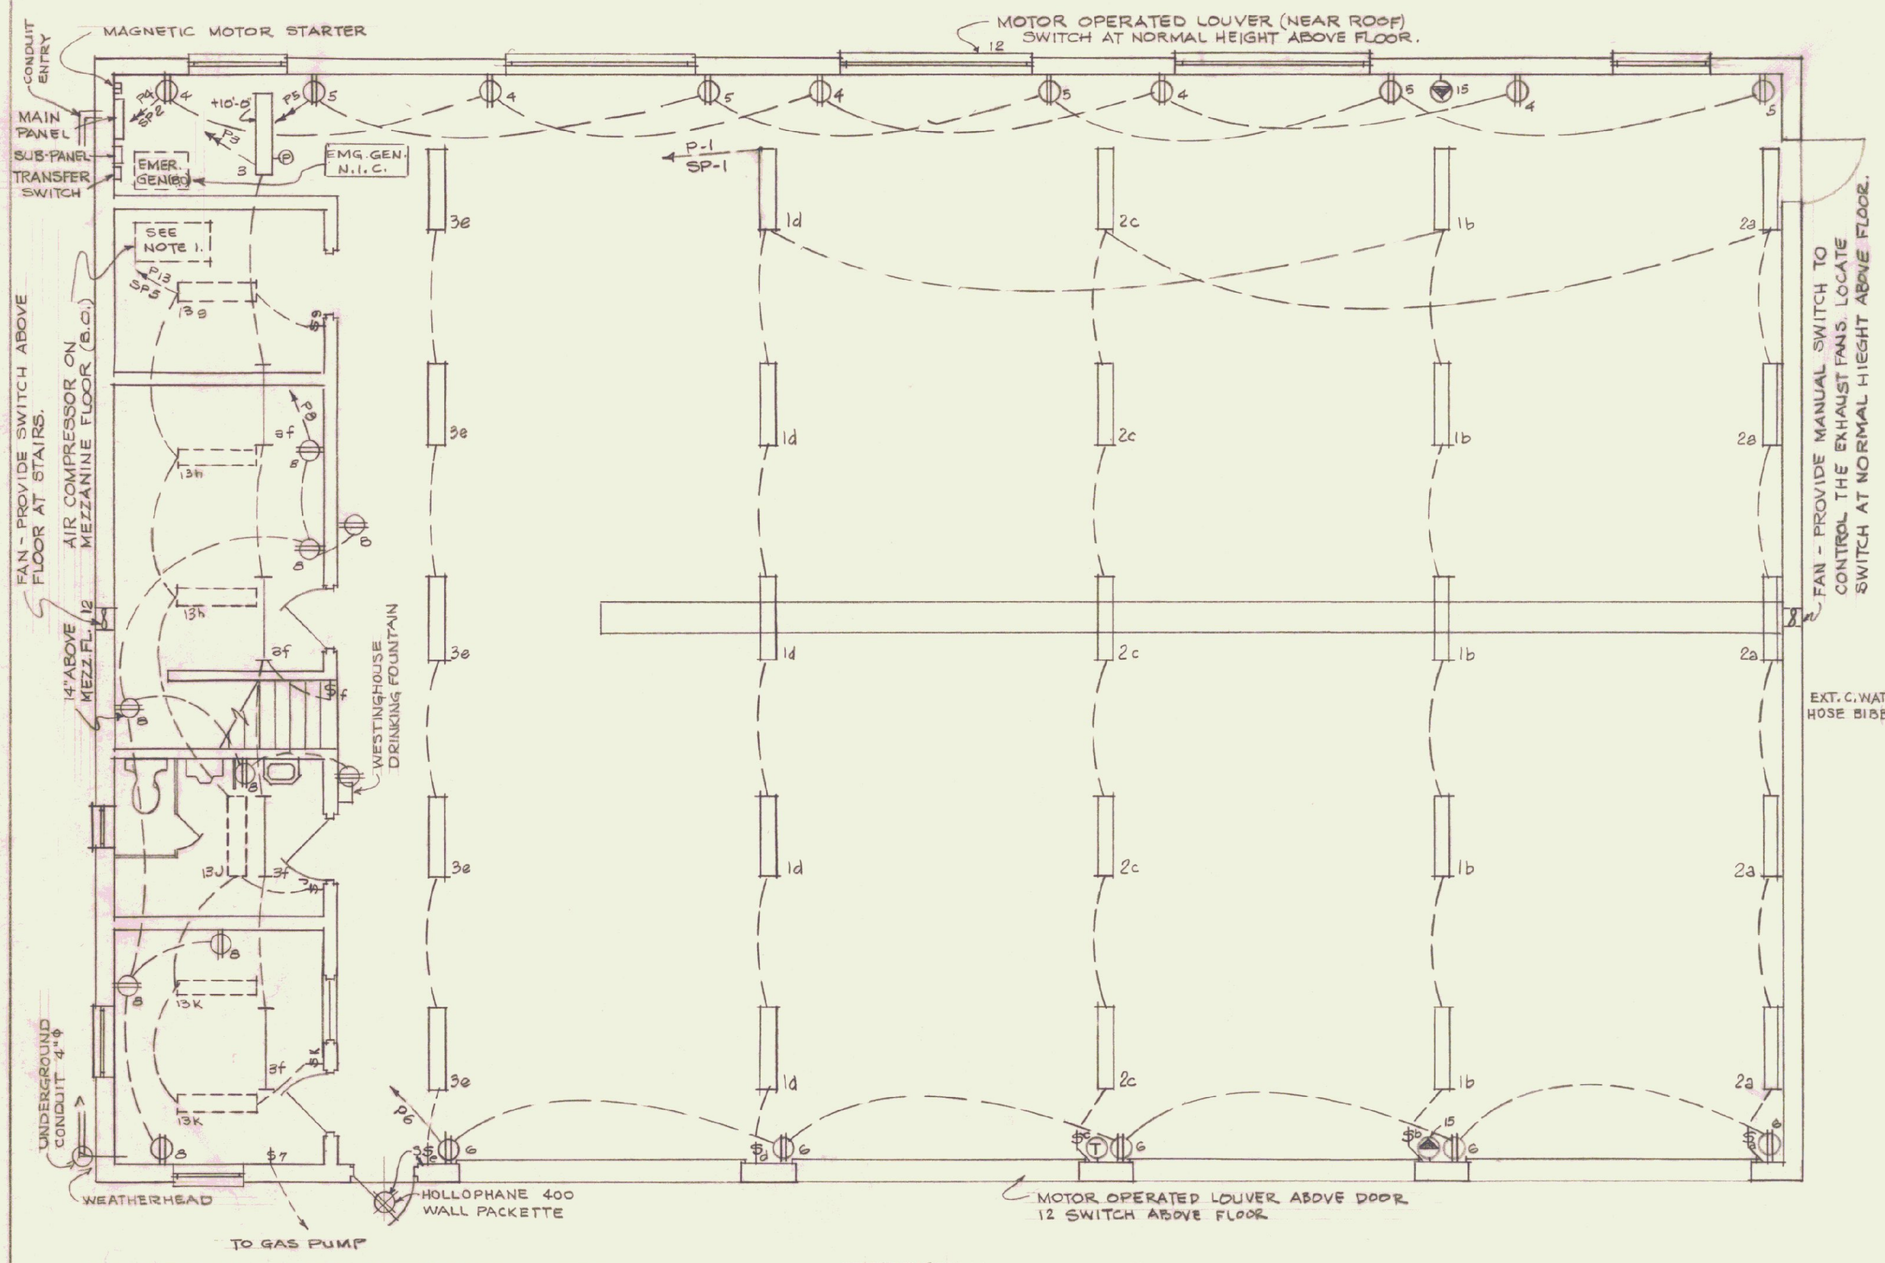

ELECTRICAL FLOOR PLAN
SCALE: 3/16" = 1'-0" (REVERSE)

NOTES:

- SMITHCRAFT "TECH" 30-TEC-2-40S (MOUNT ON BOT. OF JOIST)
- WESTINGHOUSE 1-TUBE RS STRIP, 5 STMOR (MOUNT ON BOT. OF JOIST)
- SMITHCRAFT DOMINAIRE, 6-DMA-2-40 (SURFACE MOUNT TO CEILG.)
- (T) THERMOSTAT - CONNECT TO CIRCUIT 12 & TO SUBPANEL CIR. 4 - THERMOSTAT 5'-6" OFF FLOOR
- (◐) 100 AMP. WELDER OUTLET

1. RUN 1" CONDUIT FROM MAIN PANEL THRU MOTOR STARTER TO WALL AT AIR COMPRESSOR.
ALL CONDUIT TO BE RUN IN BLOCKWORK FOR RECEPTACLES.
ALL EXPOSED CONDUIT IS TO BE PAINTED.

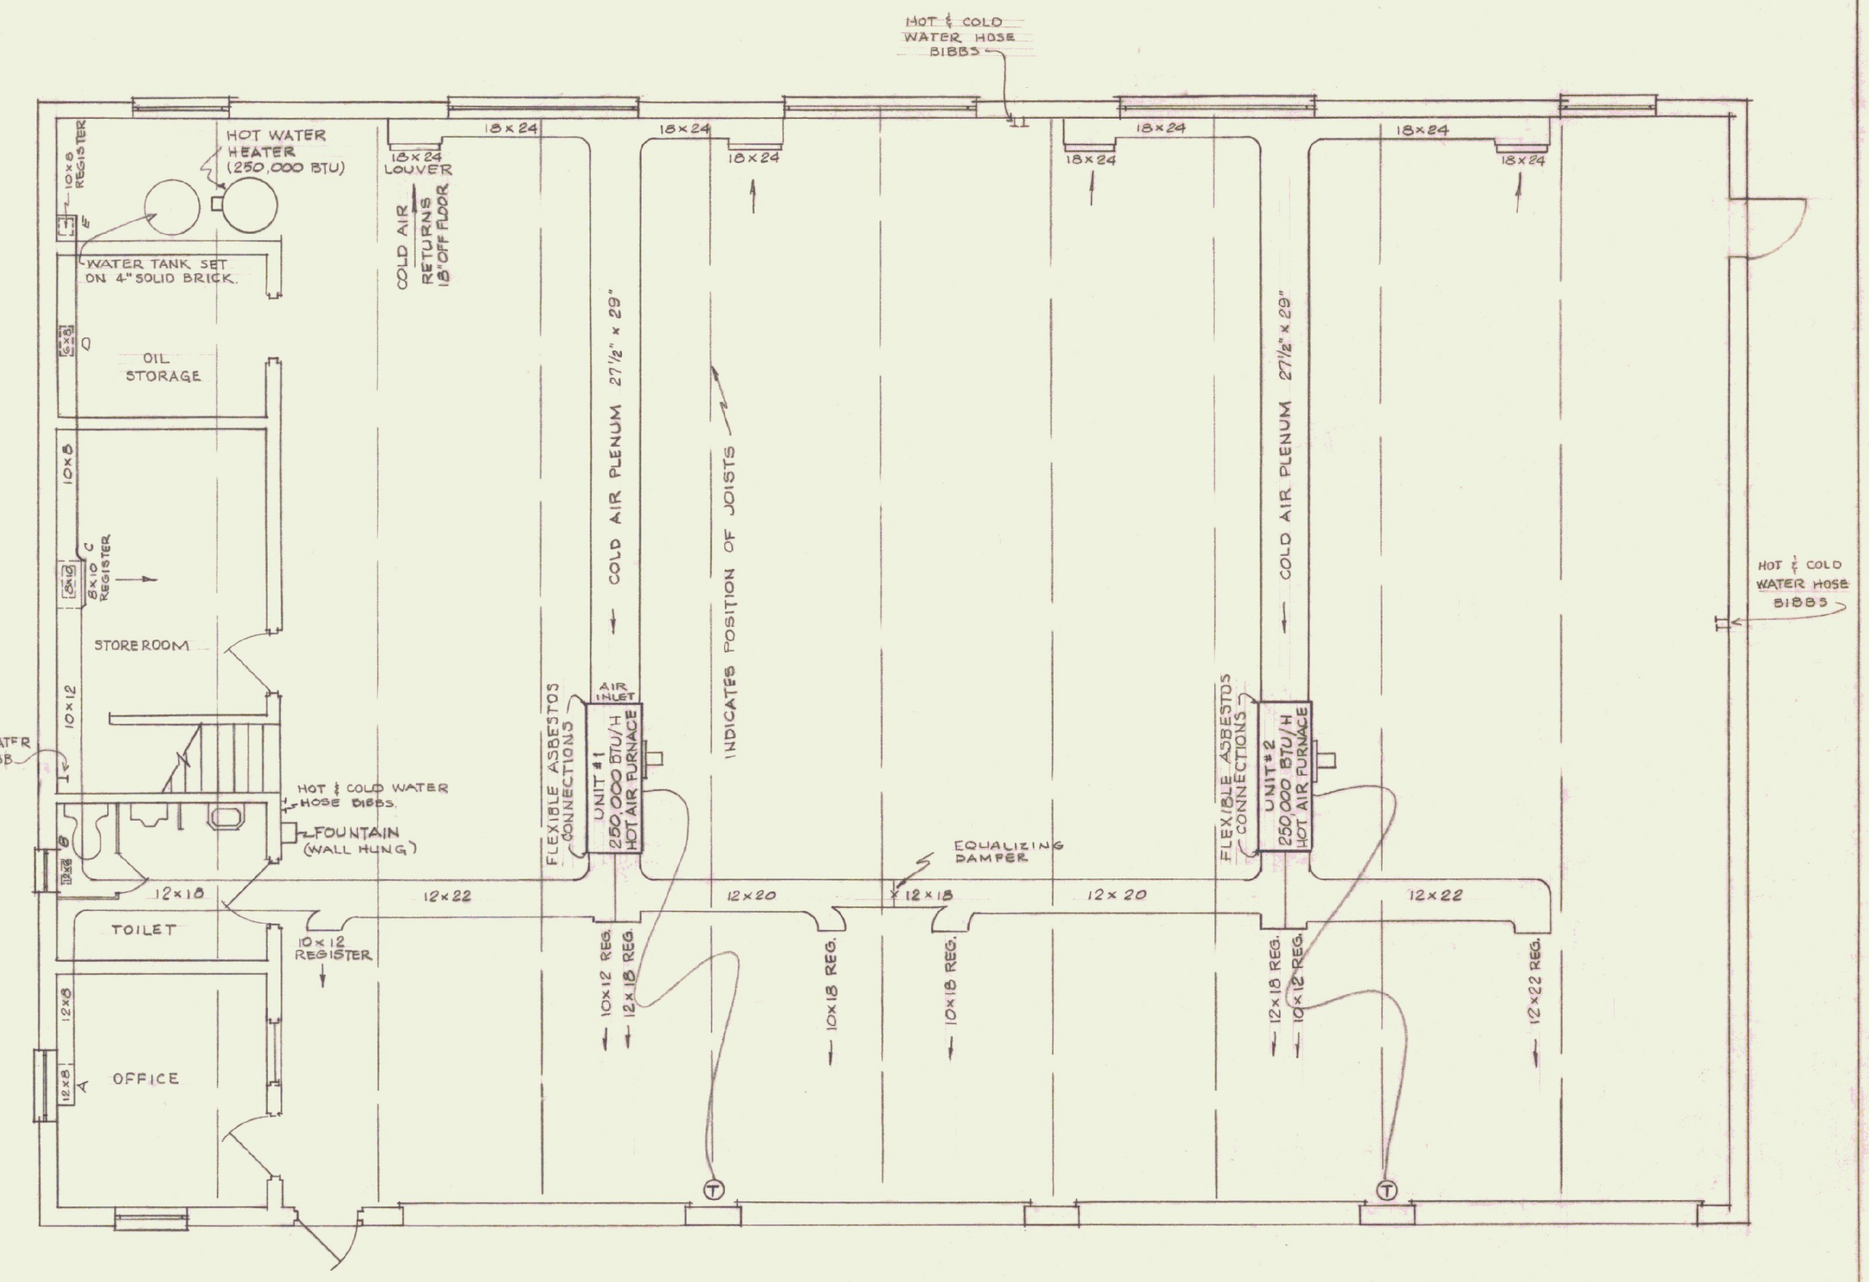

MECHANICAL FLOOR PLAN
SCALE: 3/16" = 1'-0" (REVERSE)

GENERAL NOTES :-

1. A, B, C, D & E INDICATE AIR SUPPLY DUCTS TO 4 ROOMS & MECH. AREA. SIZED SUFFICIENTLY TO SUPPLY INDICATED REGISTERS.
2. (T) INDICATES THERMOSTAT w/ MERCURY ACTIVATION RANGE 50°F - 80°F.
3. OVER EACH HEATING UNIT ASBESTOS BOARD 4'x8'x½"
4. EACH DUCT FACING DOWN TO HAVE 45° ELBOW DOWNWARD AND REGISTER
5. CAULK CONTROL JOINTS AT WALLS BEFORE INSTALLATION OF WALL DUCTS.
6. ALL DUCTWORK IS TO BE PAINTED (2) COATS.
7. HOT & COLD WATER PIPING TO BE ¾" COPPER.
8. ALL HOT & COLD WATER PIPING TO BE INSULATED & PAINTED.

REVISIONS	
DATE	REVISION
8/1/68	—

STANDARD GARAGE BUILDING
FOR
VERMONT DEPARTMENT OF HIGHWAYS
[FOUR TRUCK BAYS]

DATE		DRWG No
MAY 27, 1968 CORR. AUG 1, 1968	STATE BUILDINGS DIVISION AGENCY OF ADMINISTRATION MONTPELIER VERMONT	2-4