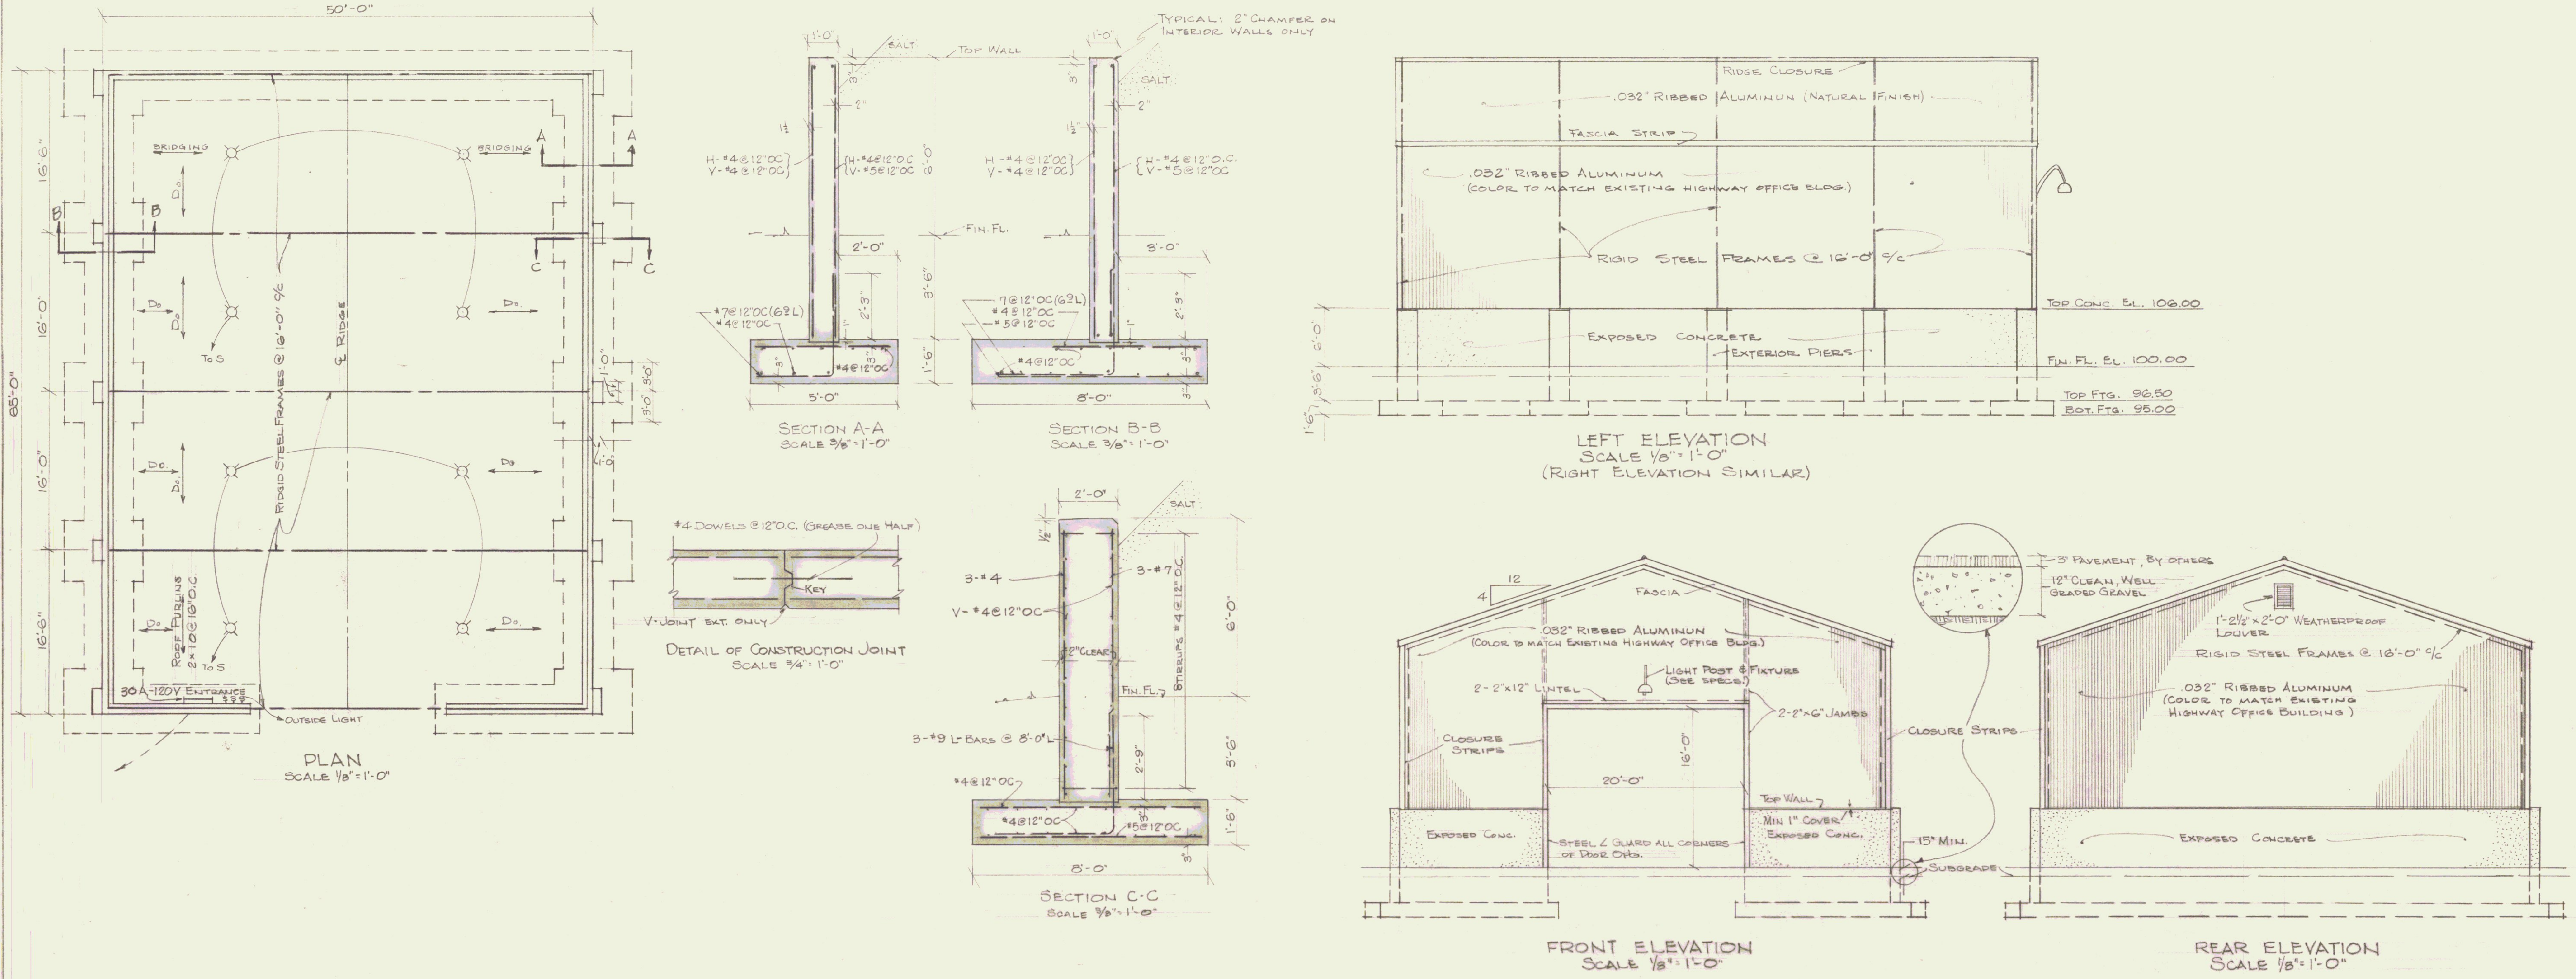

GENERAL NOTES
1. SEE SITE PLAN S-1 FOR BUILDING LOCATION
2. SEE SITE PLAN S-1 FOR BURIED ELECTRICAL CONDUIT LOCATION.
3. CONCRETE: 3000 PSI @ 28 DAYS - MAXIMUM 4" SLUMP.
4. ALL EXPOSED CONCRETE SHALL BE RUBBED TO A SMOOTH UNIFORM FINISH.
5. ALL FRAMING LUMBER SHALL BE "CONSTRUCTION GRADE", f = 1500 PSI.
6. ALL BOLTS, & WASHERS FOR FOUNDATION SHALL BE GALVANIZED.

REVISIONS	
BY	DATE

STATE OF VERMONT
STATE BUILDINGS DIVISION
DEPARTMENT OF ADMINISTRATION
MONTPELIER, VERMONT

VERMONT HIGHWAY DEPARTMENT

STANDARD SALT STORAGE BUILDING
TYPE II

DATE: 1-21-74	DESIGNED BY: TJ SETTE	DWG. NO. 1
DRAWN BY: CEH	APPROVED BY: [signature]	1 OF 1