


ARE OTHER FANS EXISTING?
 COVERED IN SET 15?

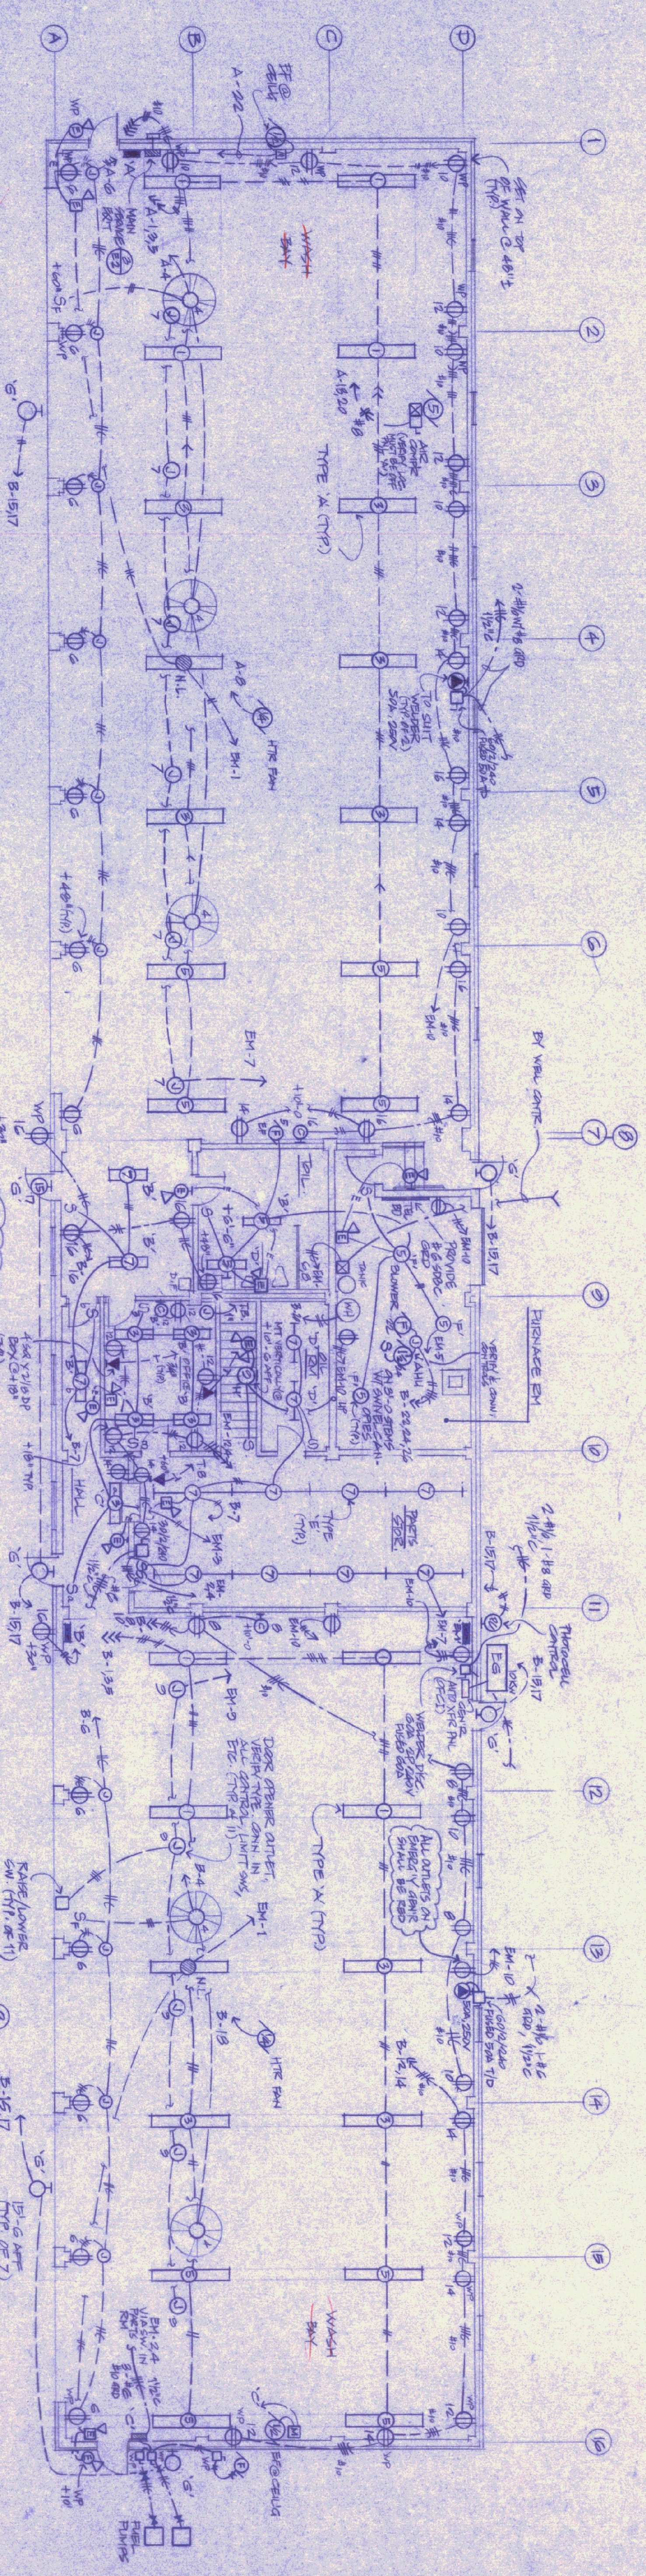


1 GRID FLR ELECT. PLAN
 SCALE: 1/8"=1'-0"

VOLTS 120/240		LUGS ONLY		LUGS ONLY		LUGS ONLY	
PHASE	NEUTRAL	PHASE	NEUTRAL	PHASE	NEUTRAL	PHASE	NEUTRAL
1	120	1	120	1	120	1	120
2	120	2	120	2	120	2	120
3	120	3	120	3	120	3	120
4	120	4	120	4	120	4	120
5	120	5	120	5	120	5	120
6	120	6	120	6	120	6	120
7	120	7	120	7	120	7	120
8	120	8	120	8	120	8	120
9	120	9	120	9	120	9	120
10	120	10	120	10	120	10	120
11	120	11	120	11	120	11	120
12	120	12	120	12	120	12	120
13	120	13	120	13	120	13	120
14	120	14	120	14	120	14	120
15	120	15	120	15	120	15	120
16	120	16	120	16	120	16	120
17	120	17	120	17	120	17	120
18	120	18	120	18	120	18	120
19	120	19	120	19	120	19	120
20	120	20	120	20	120	20	120
21	120	21	120	21	120	21	120
22	120	22	120	22	120	22	120
23	120	23	120	23	120	23	120
24	120	24	120	24	120	24	120
25	120	25	120	25	120	25	120
26	120	26	120	26	120	26	120
27	120	27	120	27	120	27	120
28	120	28	120	28	120	28	120
29	120	29	120	29	120	29	120
30	120	30	120	30	120	30	120


PANEL A (RUMBA 200)

PANEL B

VOLTS 120/240		LUGS ONLY		LUGS ONLY		LUGS ONLY	
PHASE	NEUTRAL	PHASE	NEUTRAL	PHASE	NEUTRAL	PHASE	NEUTRAL
1	120	1	120	1	120	1	120
2	120	2	120	2	120	2	120
3	120	3	120	3	120	3	120
4	120	4	120	4	120	4	120
5	120	5	120	5	120	5	120
6	120	6	120	6	120	6	120
7	120	7	120	7	120	7	120
8	120	8	120	8	120	8	120
9	120	9	120	9	120	9	120
10	120	10	120	10	120	10	120
11	120	11	120	11	120	11	120
12	120	12	120	12	120	12	120
13	120	13	120	13	120	13	120
14	120	14	120	14	120	14	120
15	120	15	120	15	120	15	120
16	120	16	120	16	120	16	120
17	120	17	120	17	120	17	120
18	120	18	120	18	120	18	120
19	120	19	120	19	120	19	120
20	120	20	120	20	120	20	120
21	120	21	120	21	120	21	120
22	120	22	120	22	120	22	120
23	120	23	120	23	120	23	120
24	120	24	120	24	120	24	120
25	120	25	120	25	120	25	120
26	120	26	120	26	120	26	120
27	120	27	120	27	120	27	120
28	120	28	120	28	120	28	120
29	120	29	120	29	120	29	120
30	120	30	120	30	120	30	120

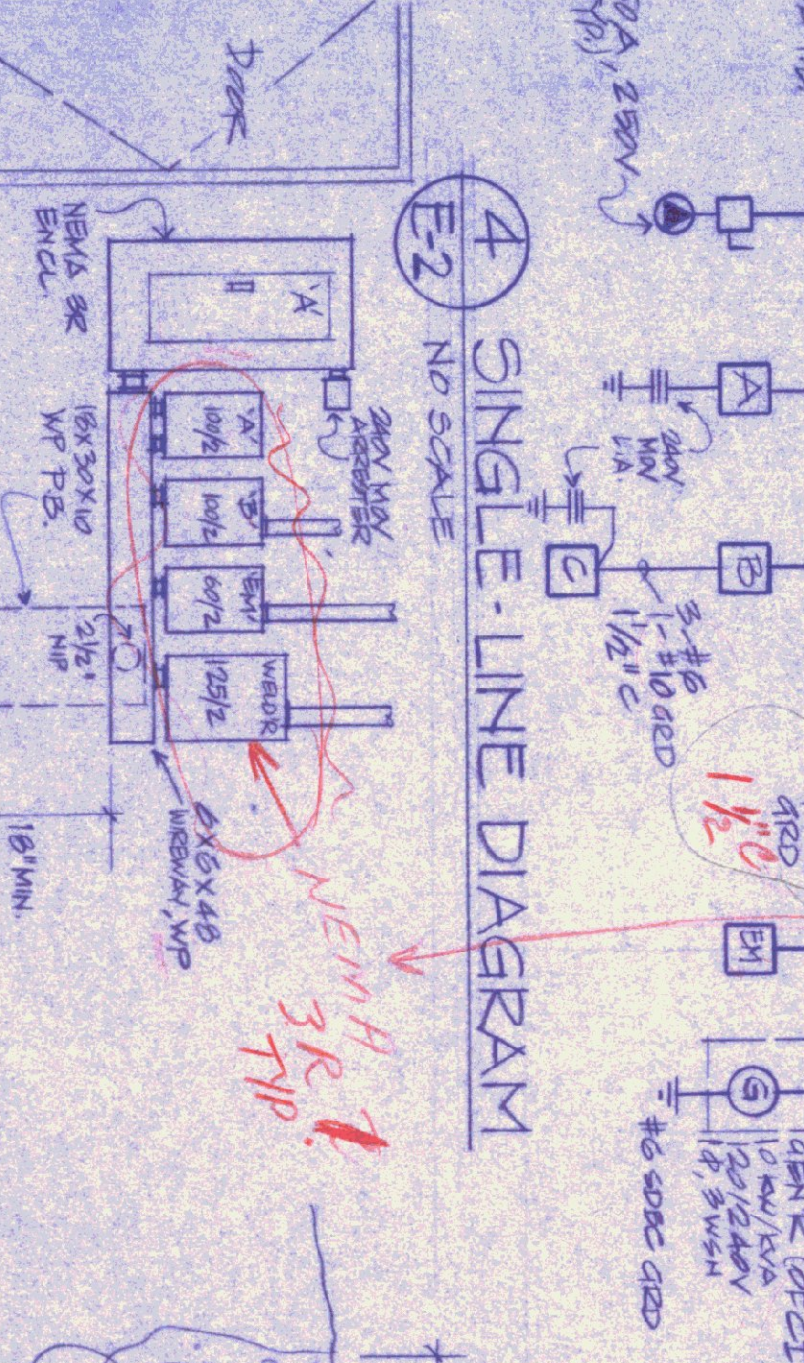

4 SINGLE-LINE DIAGRAM
 ND SCALE

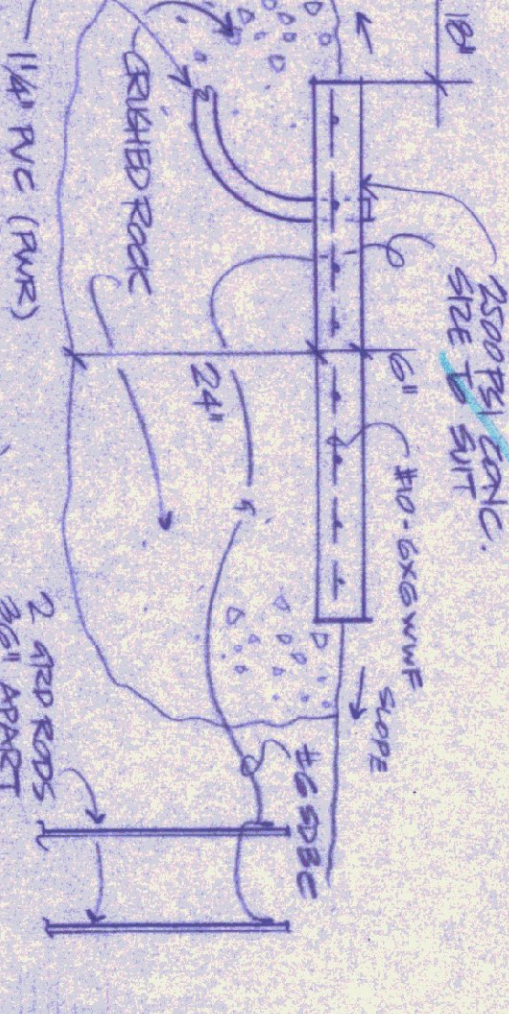


5 GEN'RL PADDET
 E2 NTS

TYPE	DESCRIPTION	REQ. TO
A	REPTD. FLUOR. INDUSTRIAL 10% 120V LIGHT 120V BALLAST & LAMPS	110/110V
B	1-LAMP 4W 85 WATT-ACCORD W/ 1-KW/HR. REFR. UNIT, LOW BALLAST	110/110V
C	1-LAMP 20WATT FLUOR. VANDAL PROOF	110/110V
D	2-LAMP TUBEM. 85W 40W 85 WATT FLUOR. 120V 2-WIRE/2-PRST	110/110V
E	INDUSTRIAL 10% 120V BALLAST	110/110V
F	INDUSTRIAL 10% 120V BALLAST	110/110V
G	INDUSTRIAL 10% 120V BALLAST	110/110V
H	INDUSTRIAL 10% 120V BALLAST	110/110V
I	INDUSTRIAL 10% 120V BALLAST	110/110V

1 1/2" 100ft x 7 1/2" minimum w/ 100ft conduit for each end

2 MEZZ. ELECT. PLAN
 E-1 SCALE

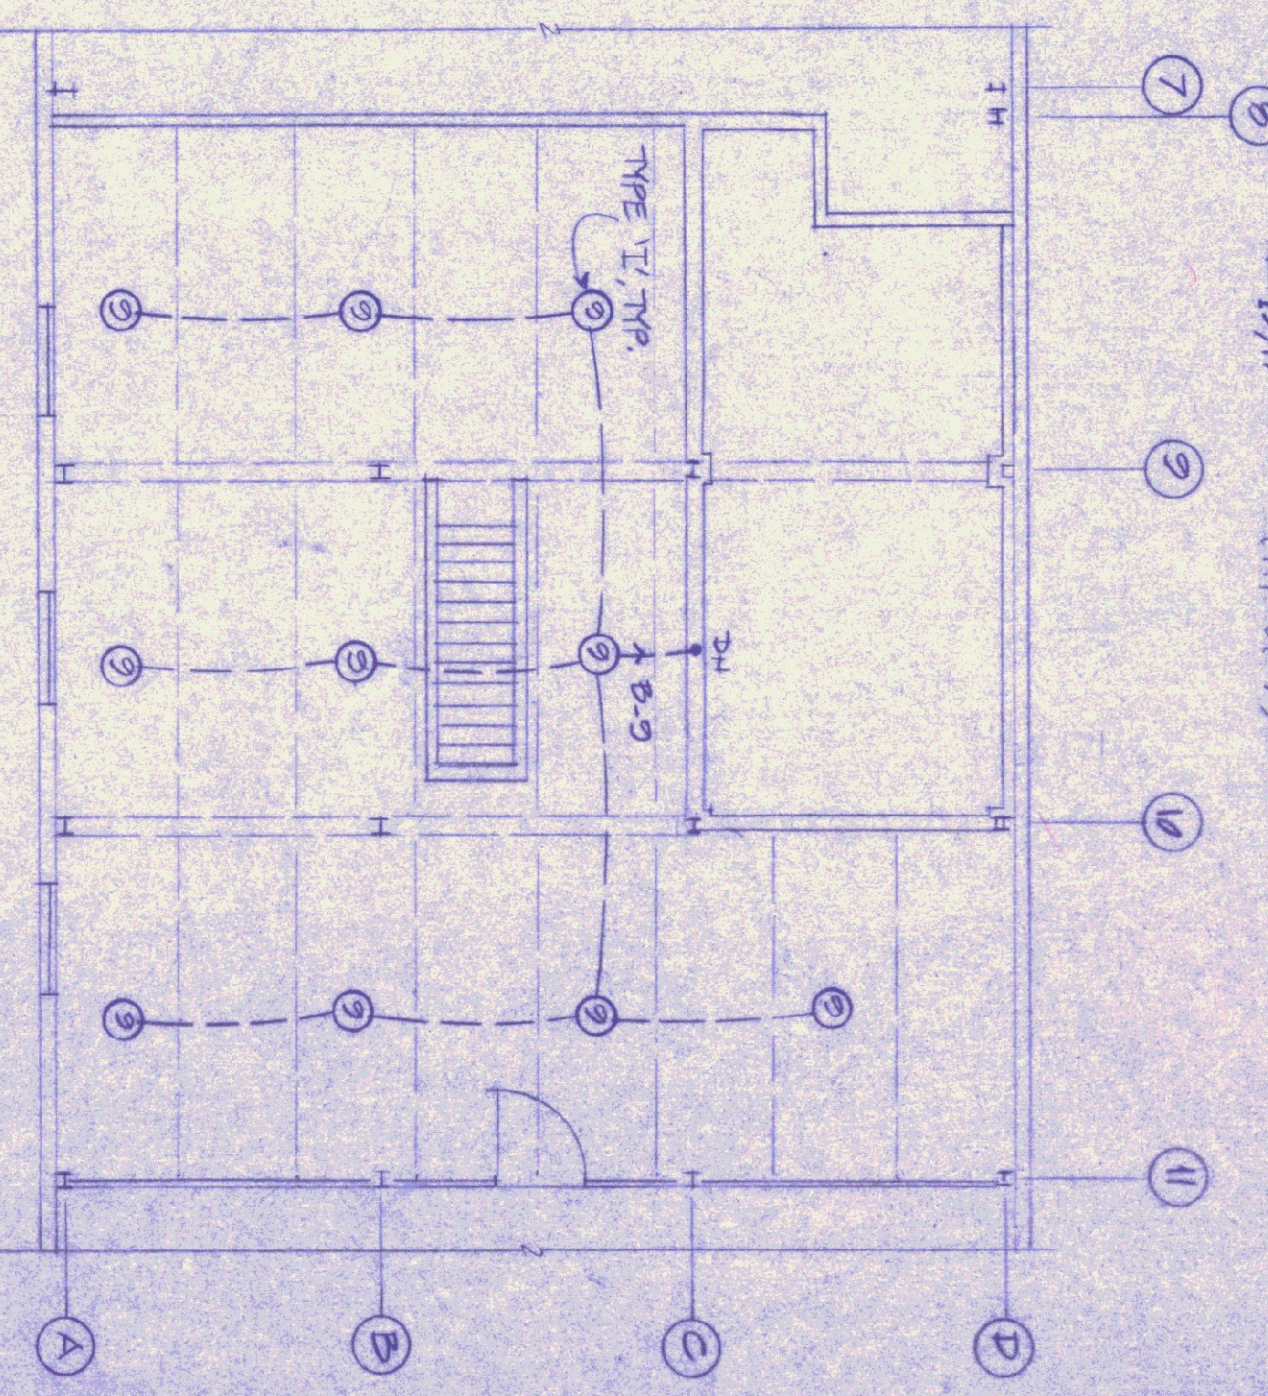

Wakefield Ward & Associates
 Consulting Electrical Engineer
 Swanton, Vermont

STATE OF VERMONT
 PROFESSIONAL ENGINEER
 ROBERT WARD
 No. 3814
 EXPIRES 12/31/2004

STATE OF VERMONT
 DEPARTMENT OF STATE BUILDINGS
 AGENCY OF ADMINISTRATION
 MONTPELIER, VERMONT

ELECTRICAL PLANS & DETAILS

DATE: 9-22-95
 SCALE: AS NOTED
 DRAWN BY: [Signature]
 APPROVED BY: [Signature]

REVISIONS:

DWG NO. E-2