TEST PIT LOG

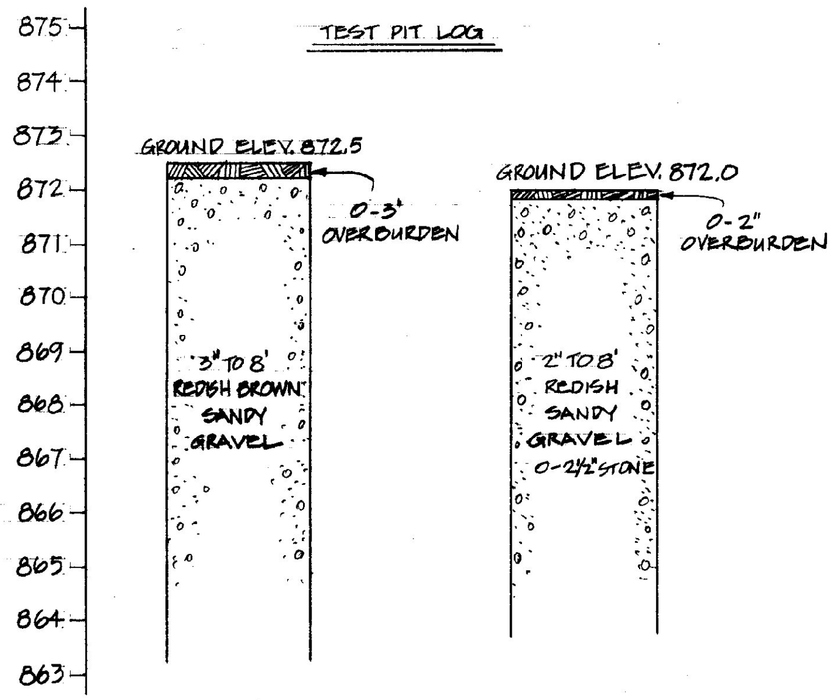

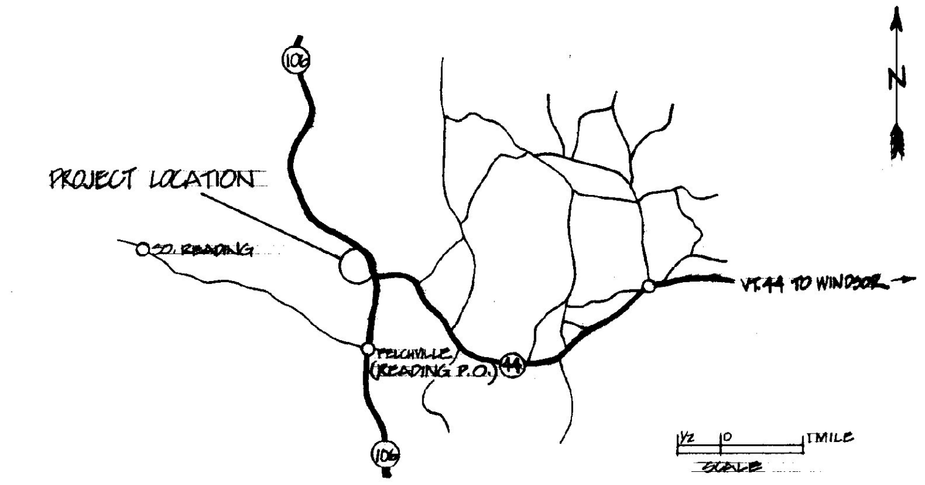

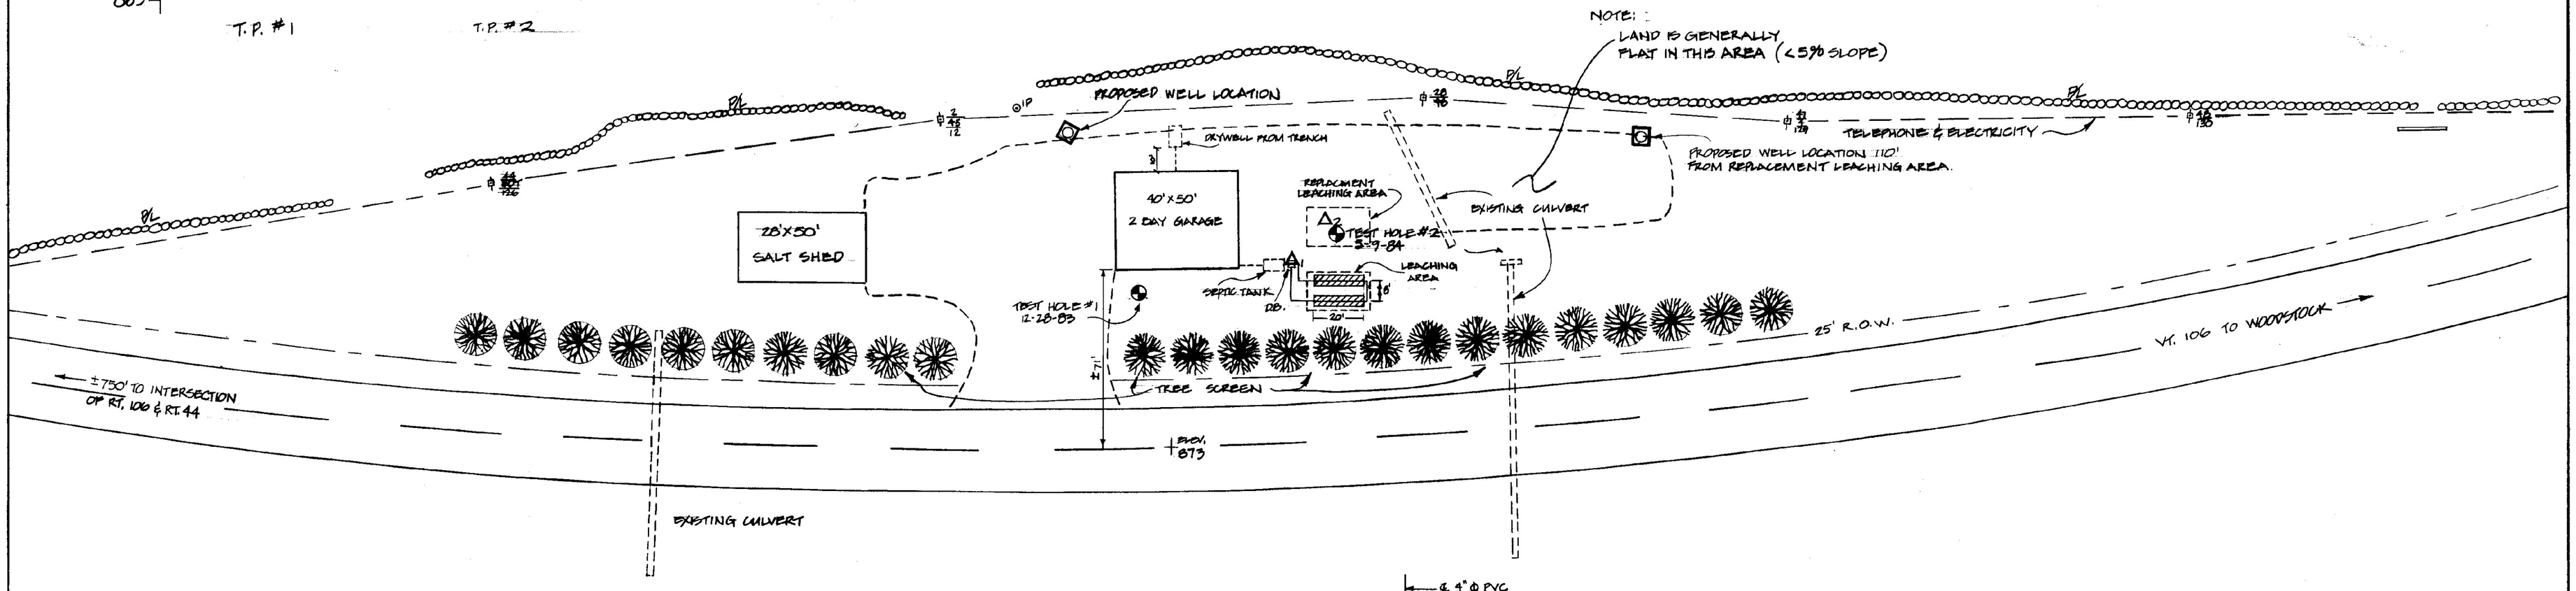

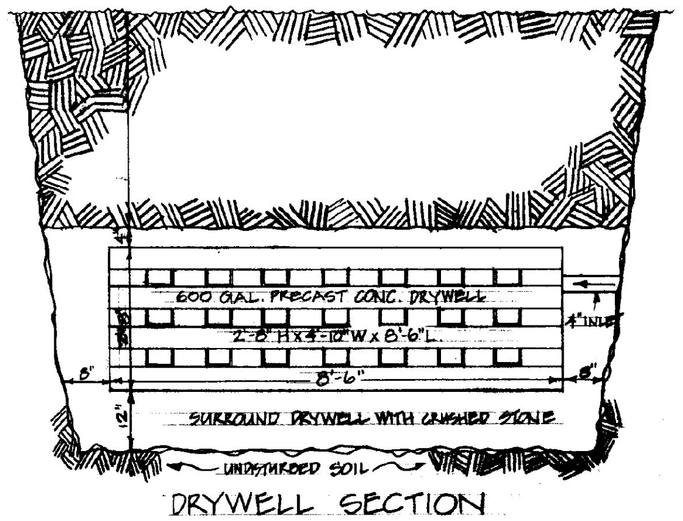

DRYWELL SECTION
SCALE 1/2" = 1'-0"

SEPTIC SYSTEM DESIGN INFORMATION

2 EMPLOYEES FULL TIME
MINIMUM DESIGN FLOW ——— 150 GPD
PERCOLATION RATES:
P1 - 1 MIN/INCH
P2 - 2½ MIN/INCH (DESIGN
APPLICATION RATE ——— 1.5 GAL./FT²/DAY
FACTOR OF SAFETY ——— 1.20

- SOIL BORING (8' DEPTH ±)
- △1 PERCOLATION TEST HOLE (36" DEPTH) 4/24/84
- △2 PERCOLATION TEST HOLE (30" DEPTH)

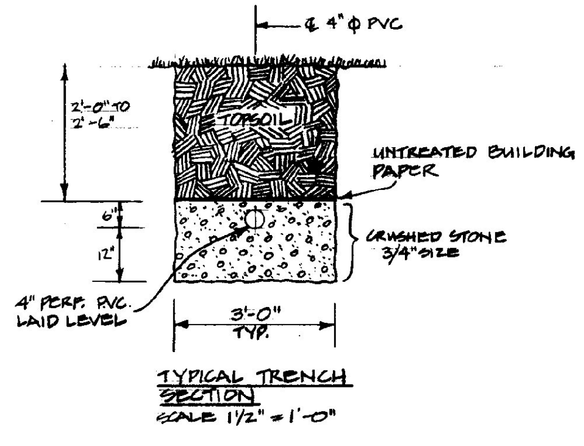

TYPICAL TRENCH SECTION
SCALE 1½" = 1'-0"

STATE OF VERMONT
DIVISION OF STATE BUILDINGS
AGENCY OF ADMINISTRATION
MONTPELIER, VERMONT

AGENCY OF TRANSPORTATION
TWO BAY GARAGE
READING, VERMONT - DISTRICT 4
SITE PLAN

DATE: JANUARY 1984	SCALE: 1" = 30'	REVISIONS: AVP 5/9/84	DWG. NO. 1 OF 1
DRAWN BY: A. POULIN	APPROVED BY: F. PRATT		

STATE OF VERMONT
JAMES A. RICHARDSON NO. 2897 REGISTERED PROFESSIONAL ENGINEER