


- GENERAL NOTES**
1. CONTRACTOR SHALL SUBMIT DATA & CUTS OF EQUIPMENT FOR APPROVAL PRIOR TO RECEIVING MATERIAL.
 2. ALL PIPING IS COPPER, UNLESS OTHERWISE SPECIFIED.
 3. NOTES ON ALL UNIT HEATERS SHALL BE TYPICALLY IDENTICAL FROM CONSTRUCTION WITH PERMISSIBLE VARIATIONS FOR FITTINGS & SHALL BE IDENTICAL TO THE HEATING CONTRACTOR'S DRAWINGS.
 4. HEATING CONTRACTOR SHALL PROVIDE SERVICE SWITCH FOR EACH UNIT HEATER.
 5. SEE SITE PLAN FOR LOCATION OF UNDERGROUND OIL TANK.
 6. ALL WATER SUPPLY PIPING ABOVE FLOOR SLAB ELEVATION SHALL BE INSULATED. INSULATION SHALL BE R-10.
 7. ALL HEATING PIPING IN THE BOILER ROOM, MAIN BLDG., & TUBS SHALL BE INSULATED AND THE INSULATION PAINTED.
 8. ALL PUMPS SHALL BE PAINTED OR OPERATE ON 120V/240V/3PH UNLESS OTHERWISE SPECIFIED OR INDICATED.
 9. PROVIDE 2 OIL BURNER SAFETY SWITCHES AS SHOWN ON PLANE-1.
 10. WATER ROOM F.F. ELEV. TO BE SAME AS MAIN FLOOR BUT SHALL BE FITTED TOWARD DRAINS.
 11. CONCRETE PIPER PAD SHALL BE LEVEL (BY G.C.).
- INSTALLING CONTRACTOR SHALL SET STEEVES AND WAGERS SUPPORTS FOR BOILER ON CONC. ROOF SLAB BEFORE POURING OF SLAB. NO OPENINGS INTO CONC. STUB ALLOWED.

REMOVE INDIVIDUAL PUMP MANIFOLD STRUCTURES W/ RECONNECT.


NO JOINTS IN LINES OVER ELECTRICAL PANELS.

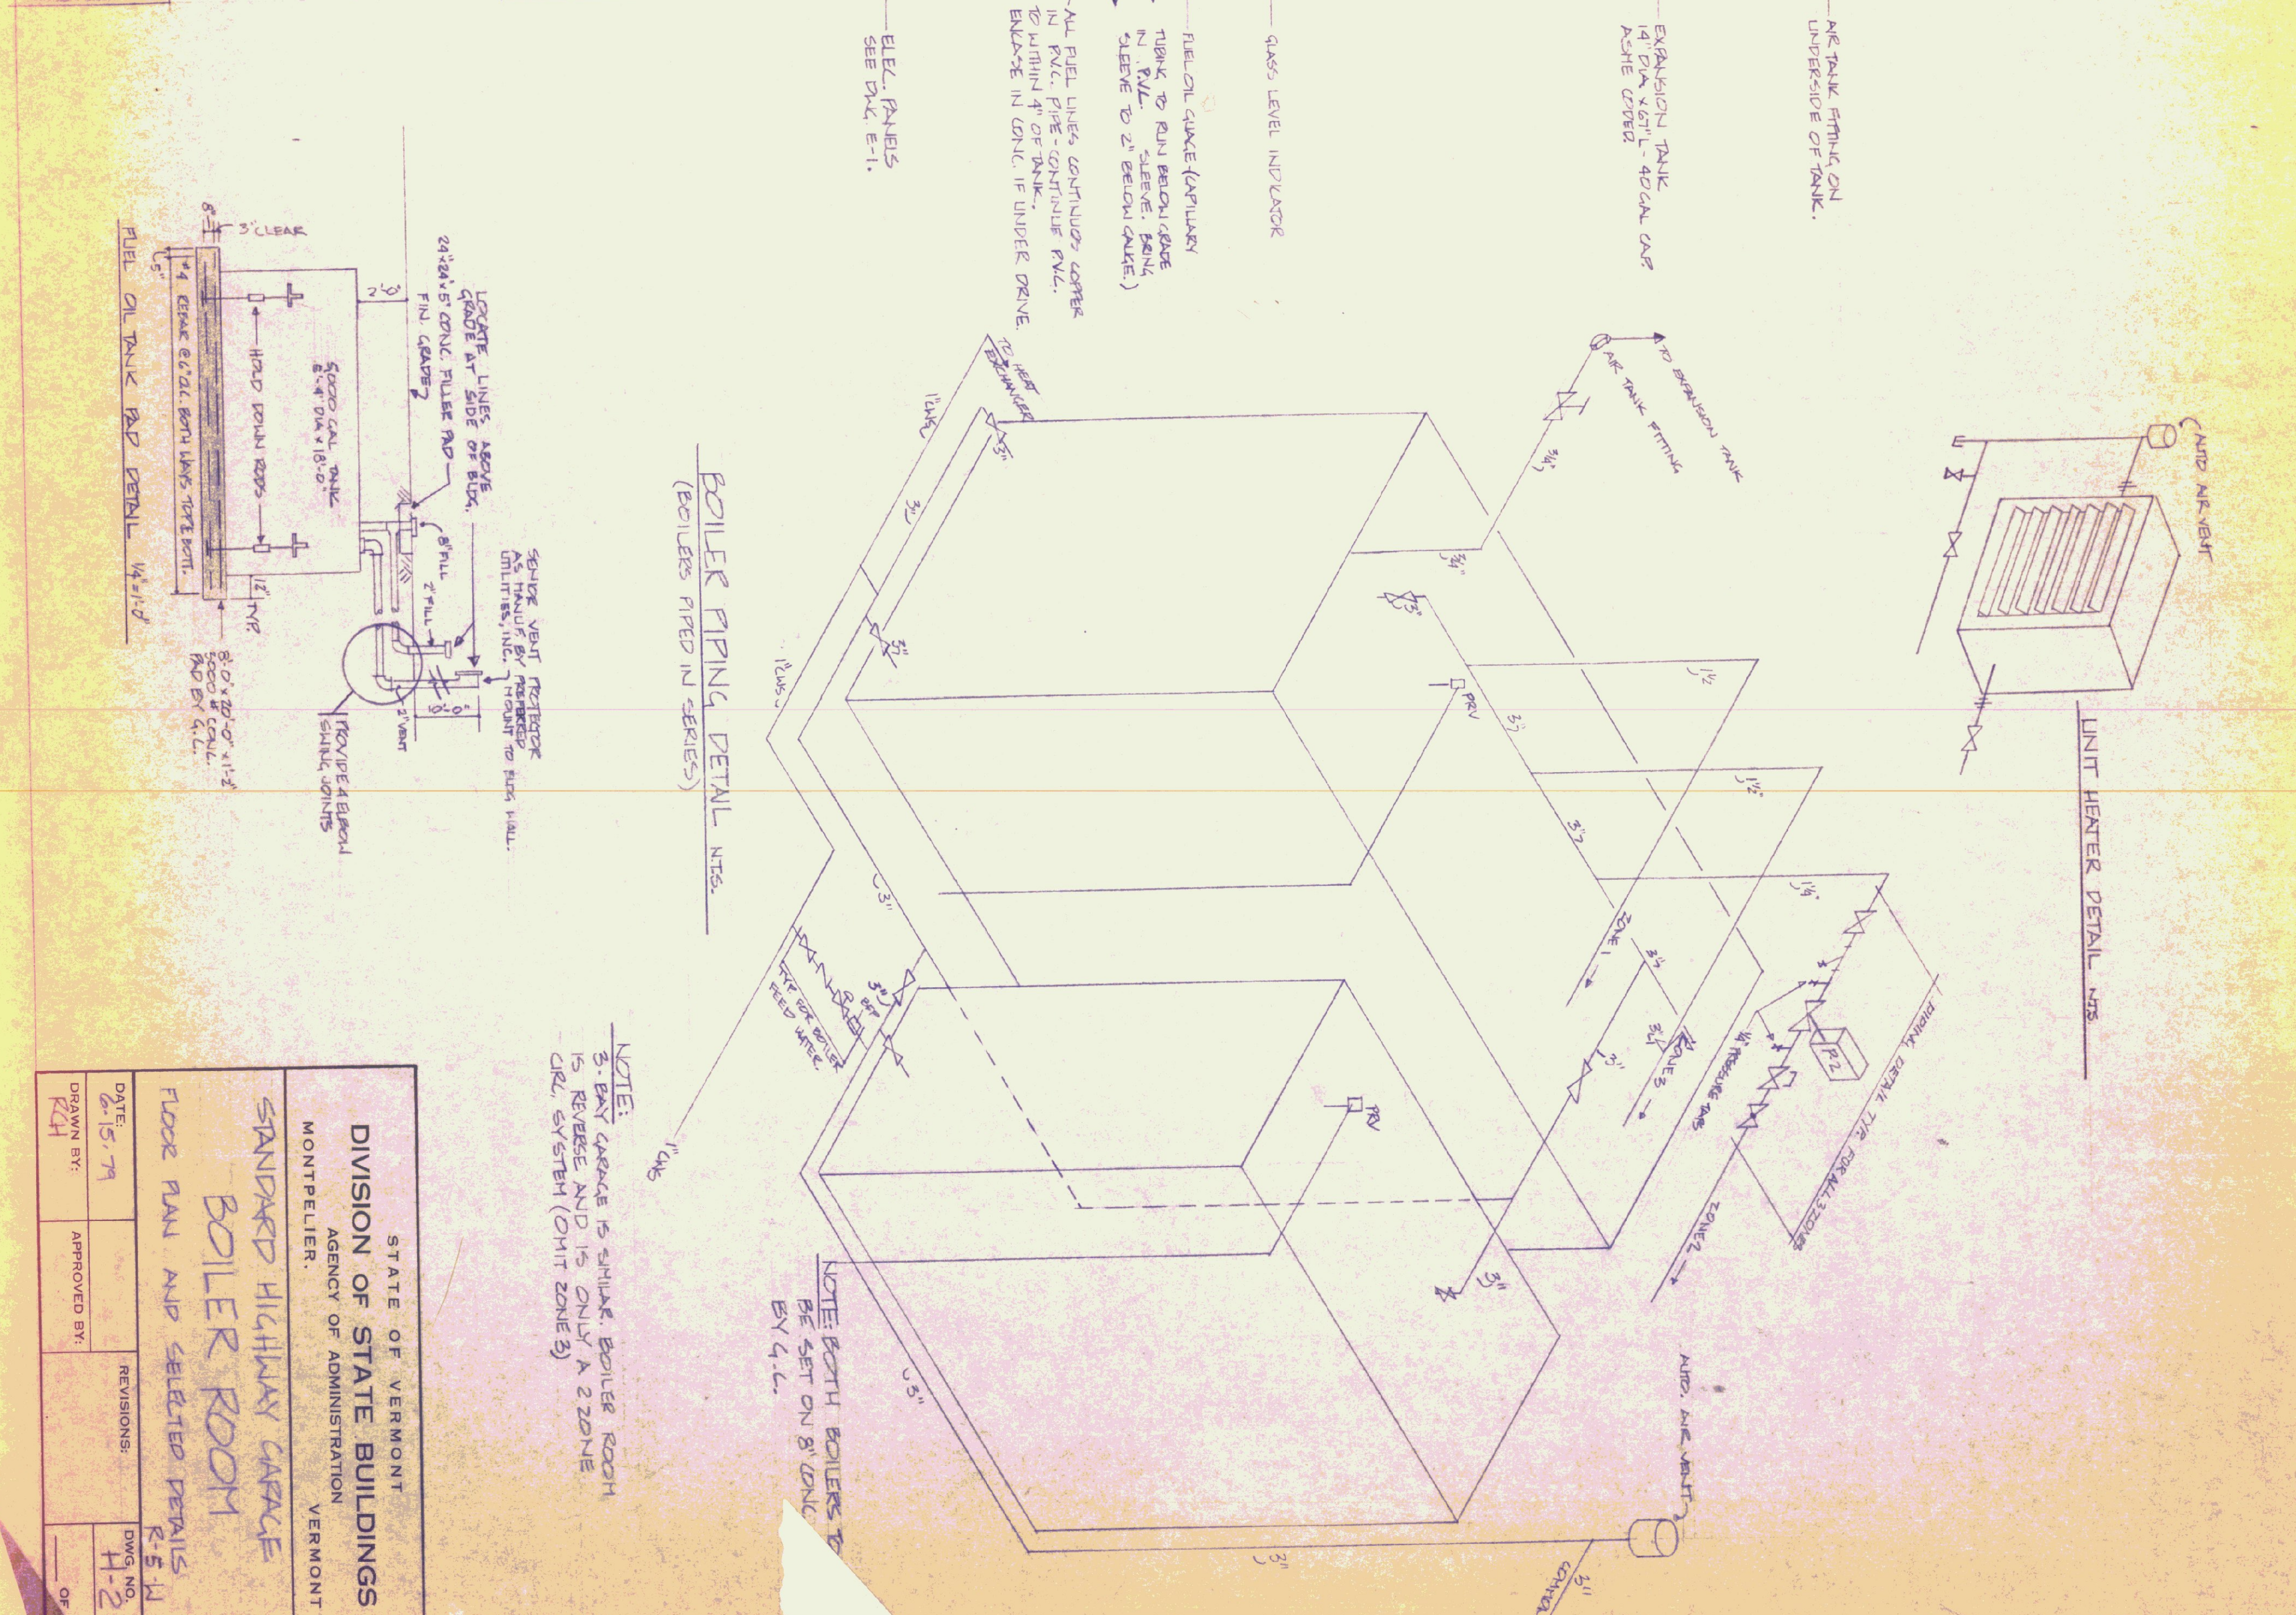

BOILER PIPING DETAIL NOTES
(BOILERS PIPED IN SERIES)

NOTE:
3. BAY GARAGE IS SIMILAR BOILER ROOM IS REVERSE AND IS ONLY A 2 ZONE DRL SYSTEM (OMIT ZONE 3)

NOTE BOTH BOILERS TO BE SET ON 8\"/>

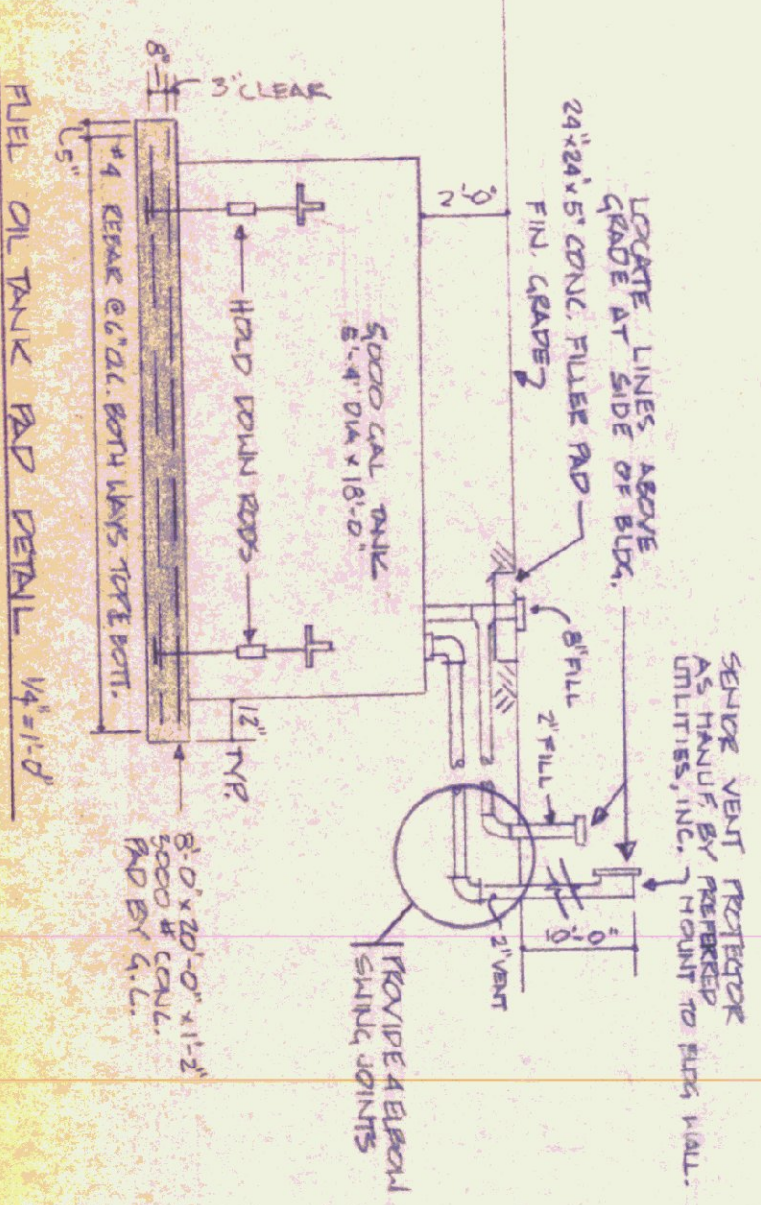

STATE OF VERMONT		DIVISION OF STATE BUILDINGS	
MONTPELIER		AGENCY OF ADMINISTRATION	
VERMONT		VERMONT	
STANDARD HIGHWAY GARAGE			
BOILER ROOM			
FLOOR PLAN AND SELECTED DETAILS			
DATE	6-15-79	REVISIONS	R-5 M
DRAWN BY	RZH	APPROVED BY	H-2
			OF