
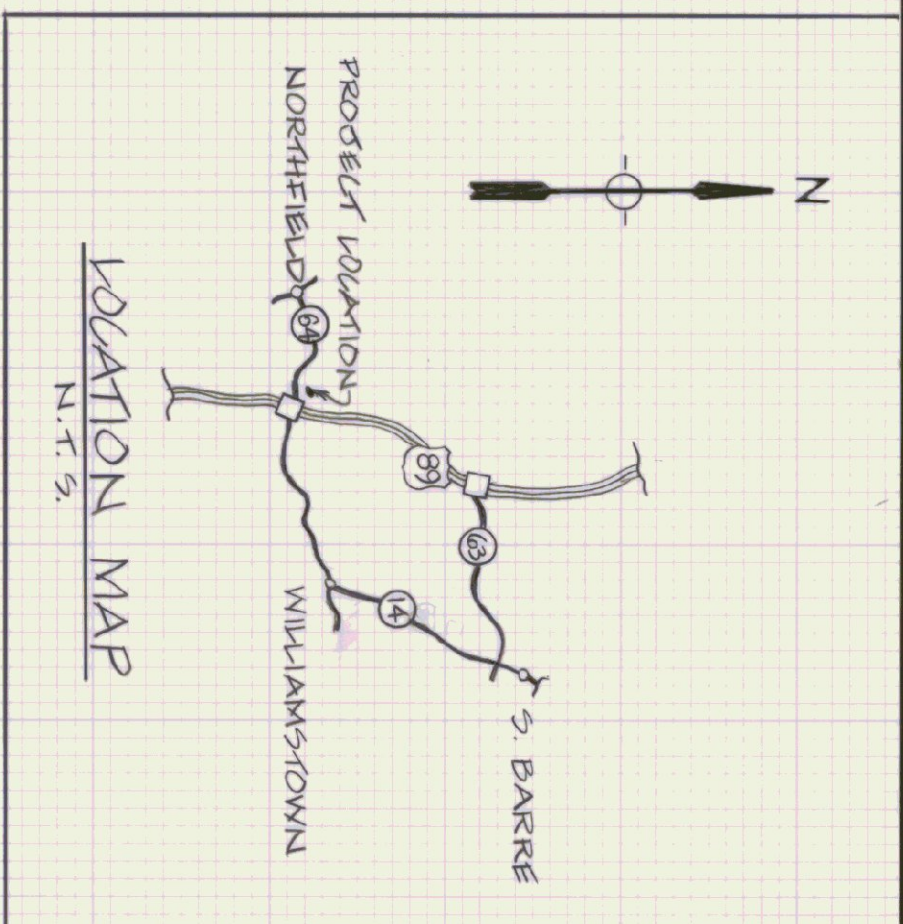
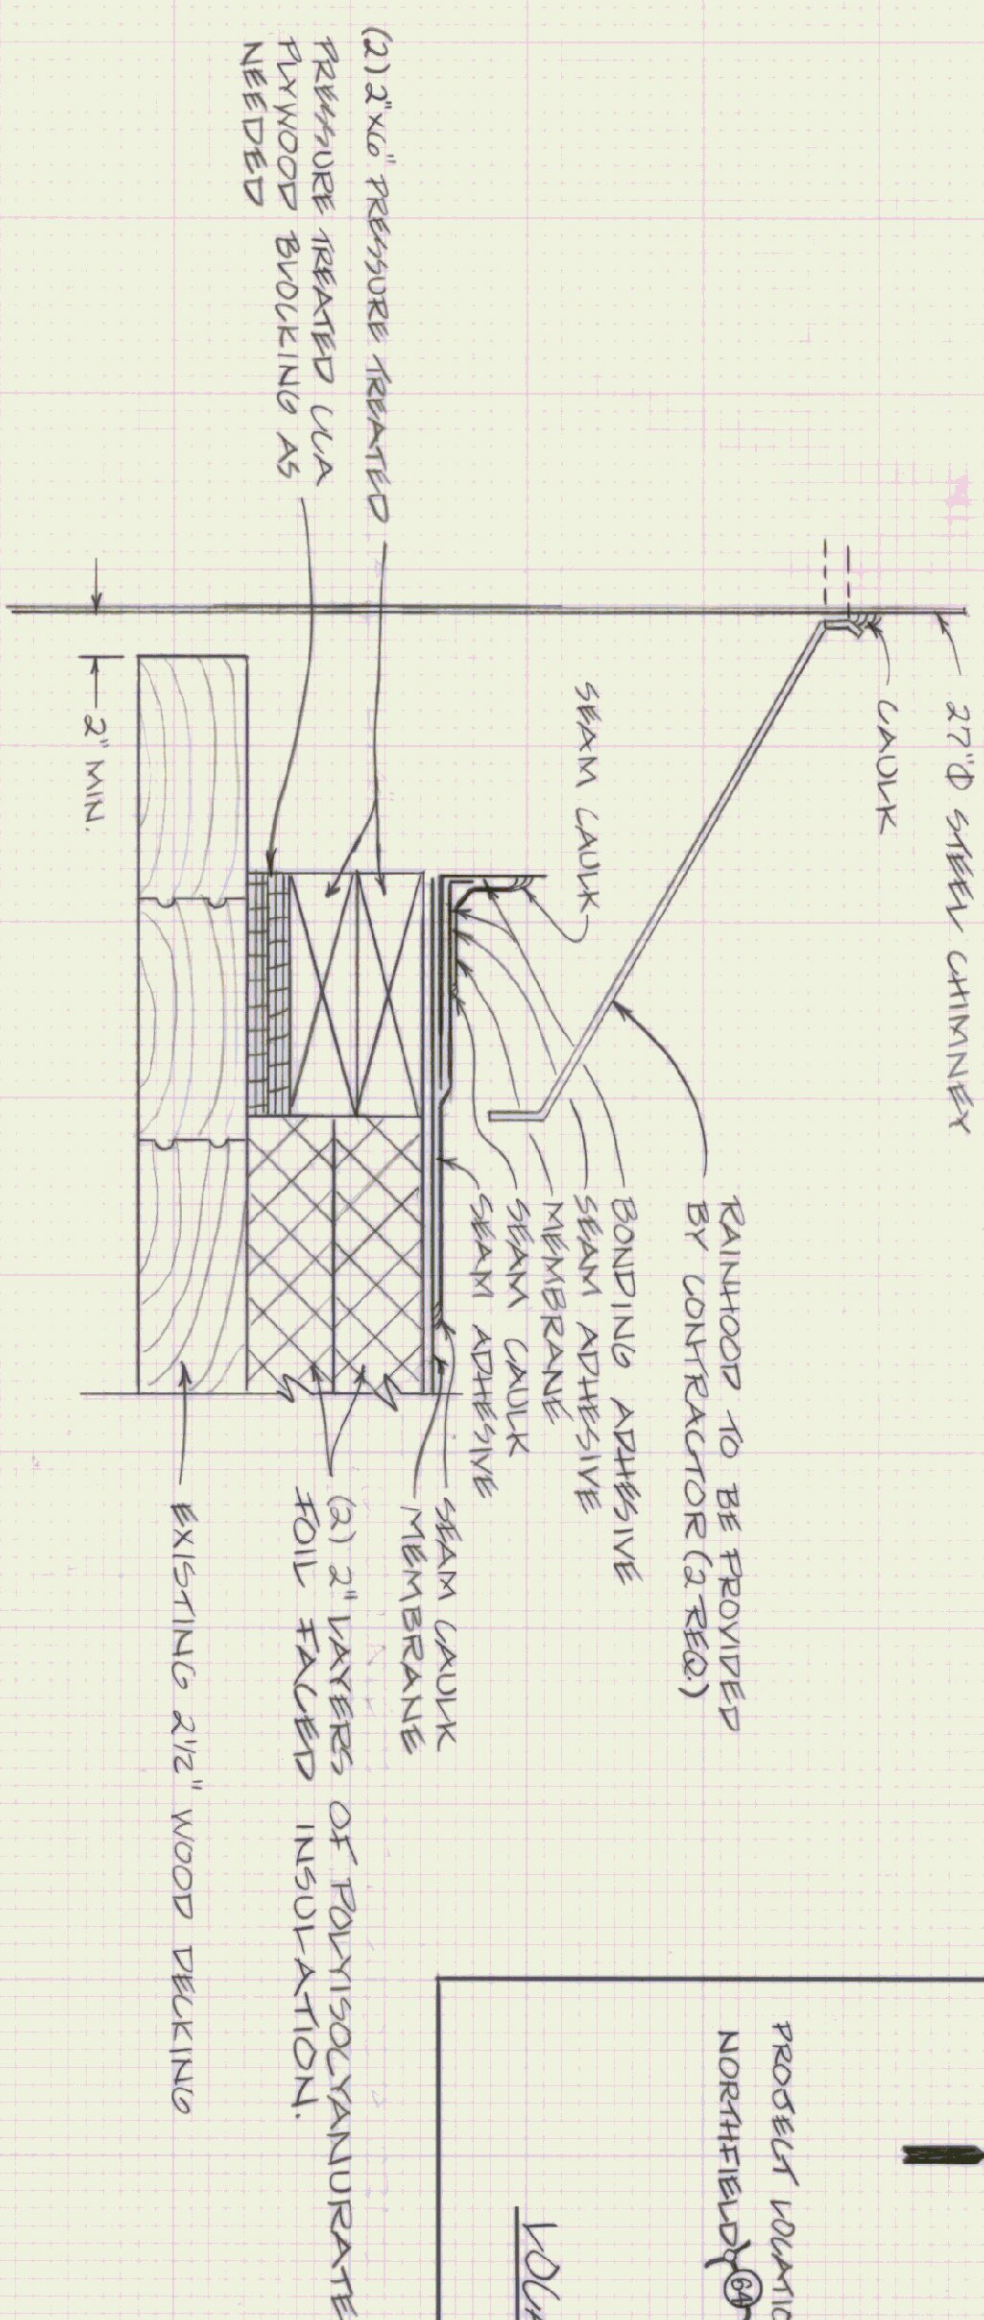



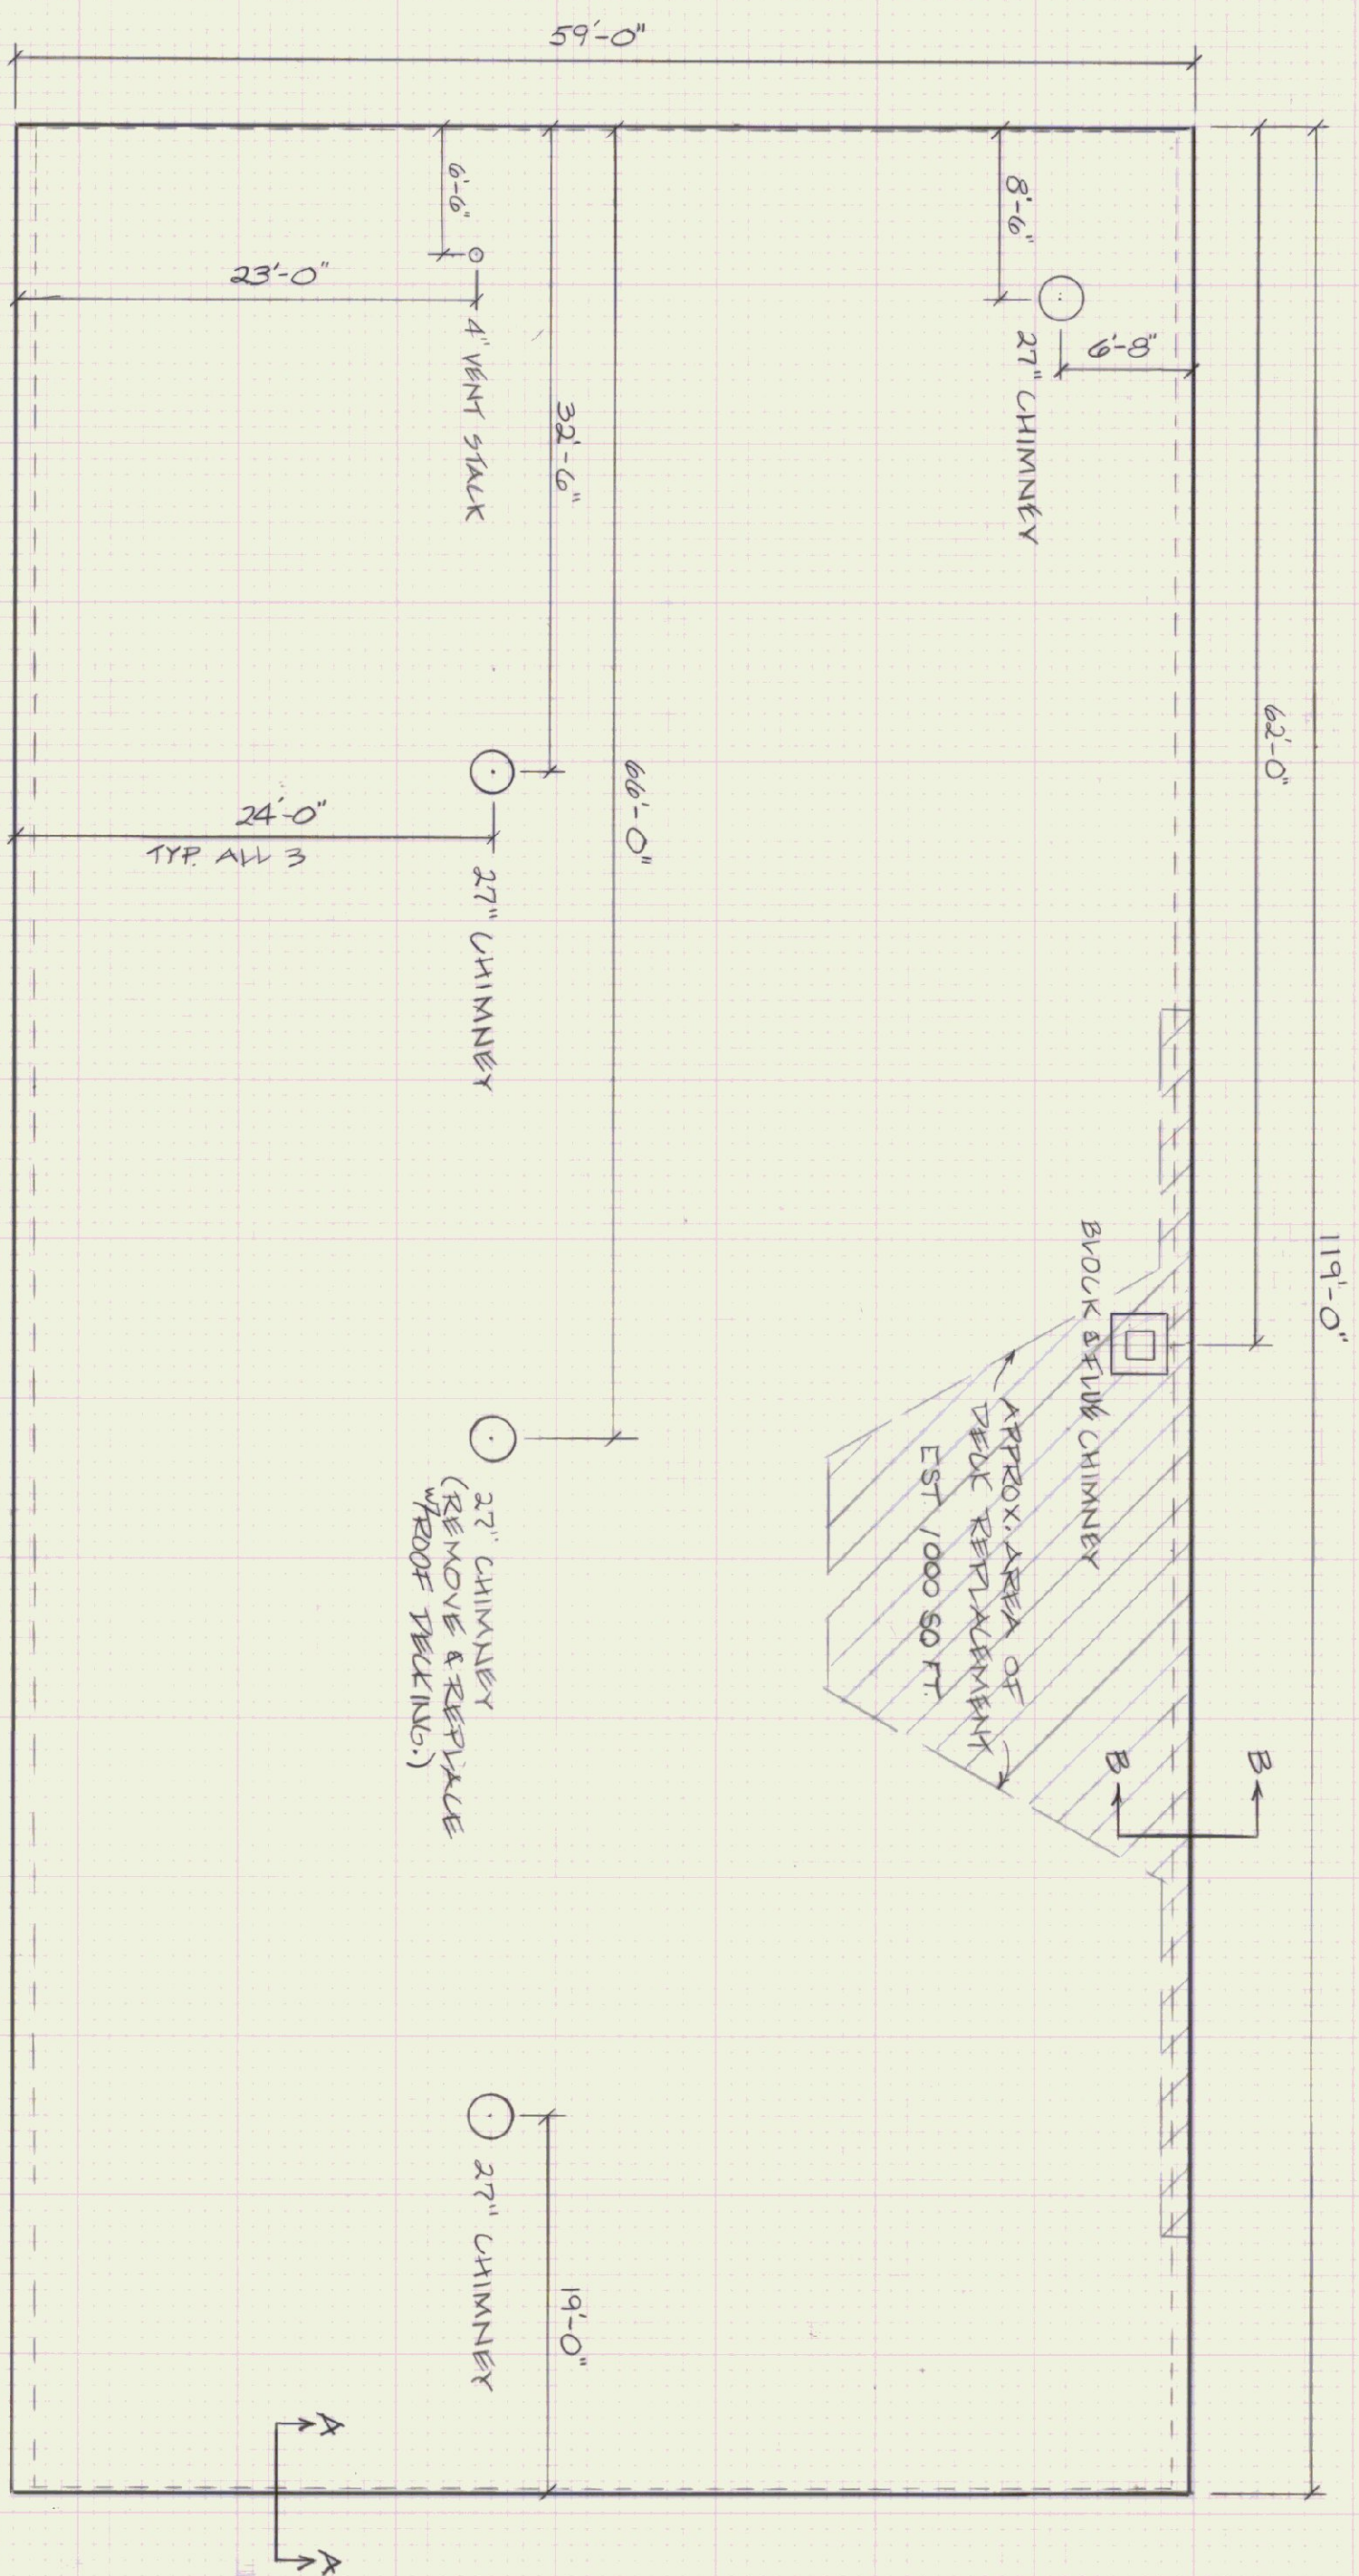


ROOF DESIGN LOADS

DECKING 100 PSF
60 PSF ± 50 PSF SNOW
60 PSF ± 10 PSF WIND

ROOF PLAN

SCALE 1/8" = 1'-0"

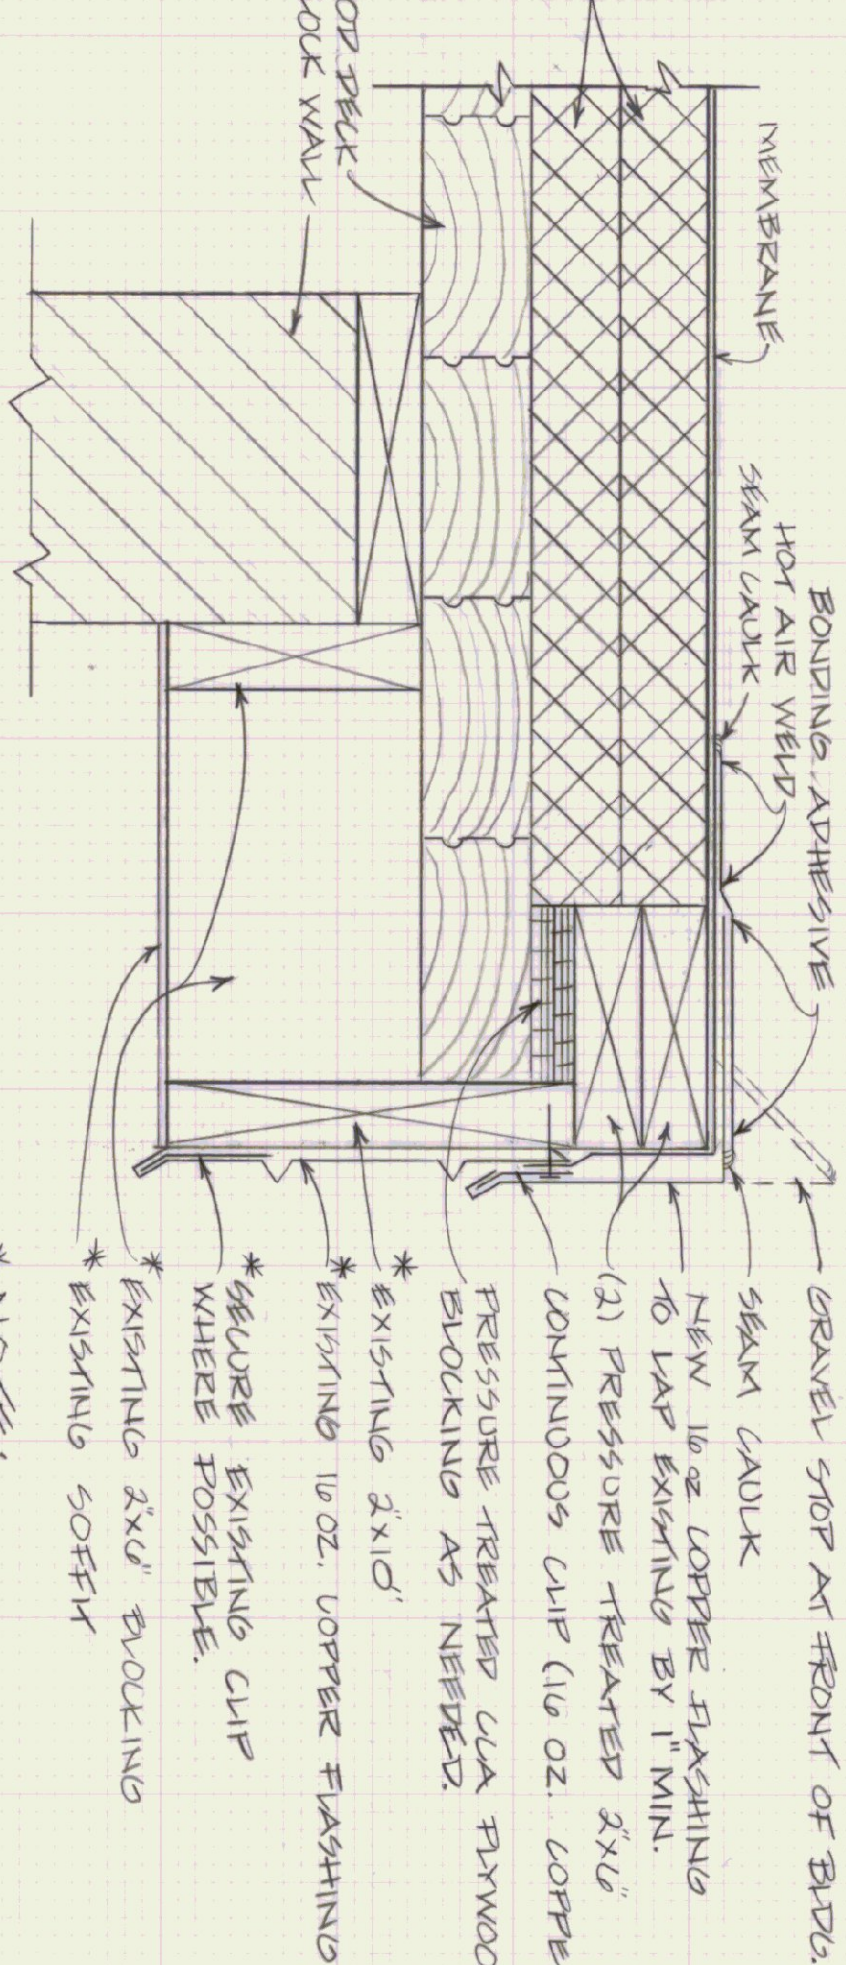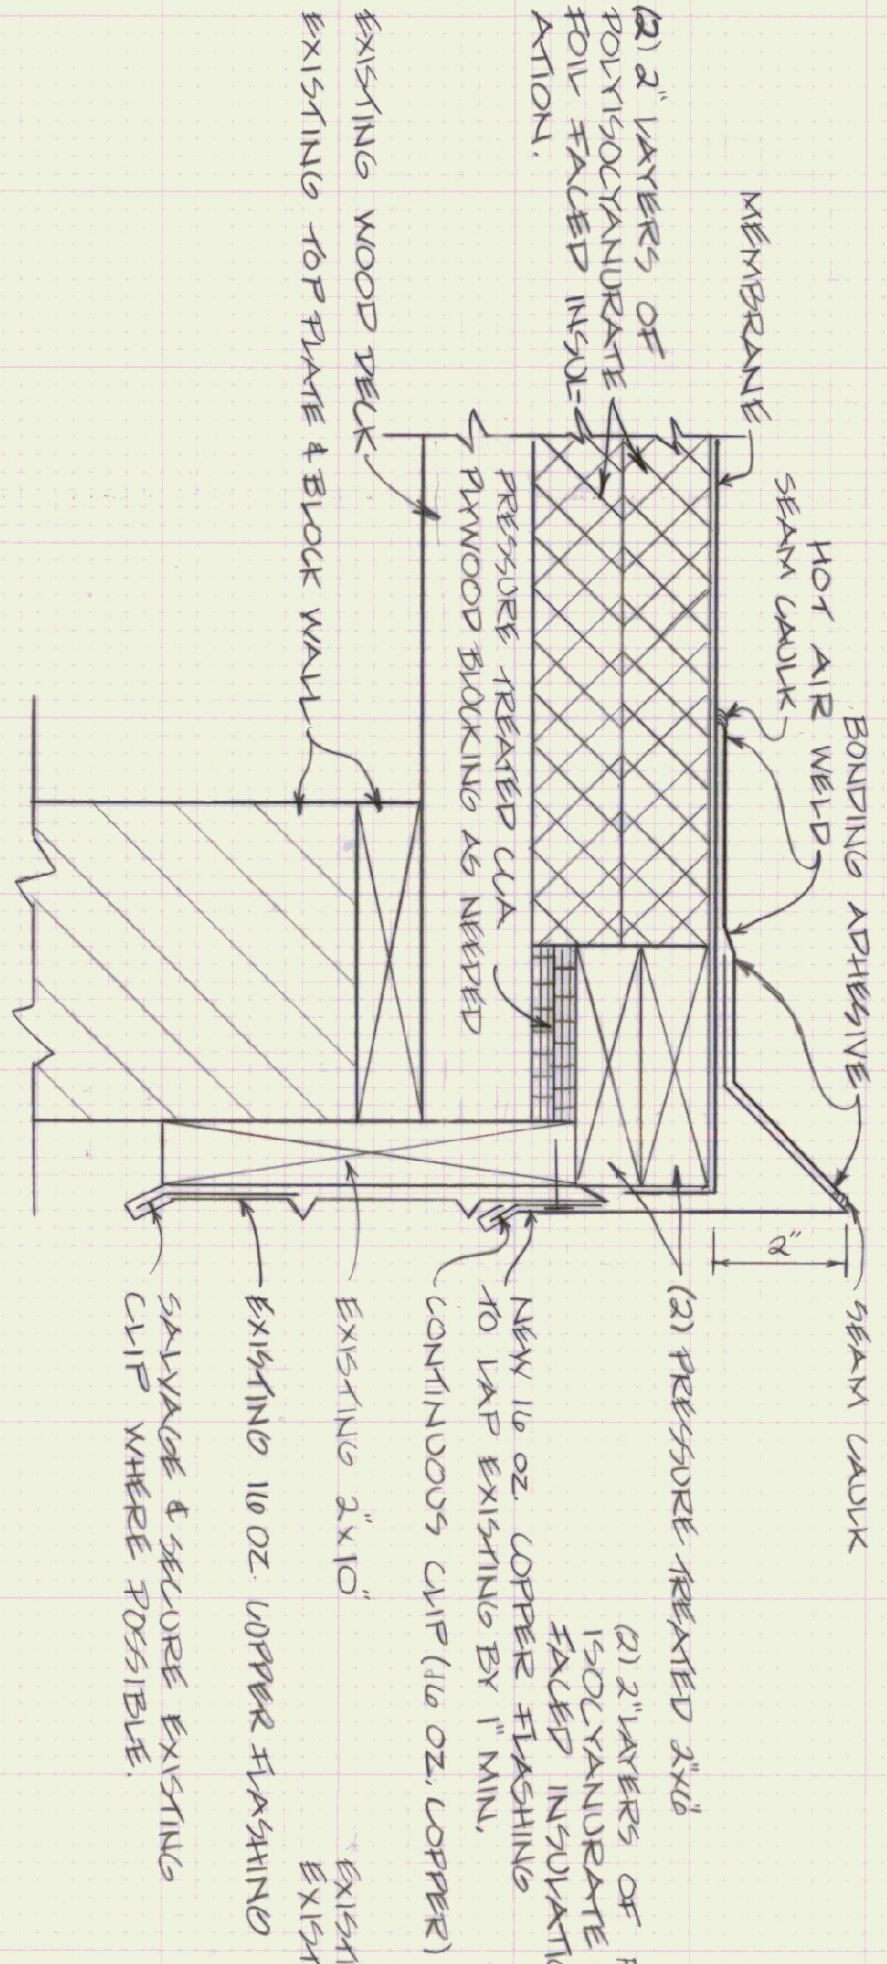

SECTION A-A ROOF RAKE EDGE

SCALE 3/8" = 1'-0"


SECTION B-B ROOF DRIP EDGE

SCALE 3/8" = 1'-0"

* NOTE:
DAMAGED AND DAMAGED SOFT
SHALL BE INCLUDED AND REPLACED
AS PART OF THIS CONTRACT.


NOTES:

- 1) MATCH EXISTING WOOD DECKING DAMAGED BY FIRE, REPLACE WITH: AMERICAN INSTITUTE OF TIMBER CONSTRUCTION SPECIFICATION.
- 2) DECKING TO BE SOLID HEAVY FIBER (GRADE 1) DOUGLAS FIR, 20' BELOW FINISH, OR WESTERN HEMLOCK, NOMINAL THICKNESS 3/4" MINIMUM, ALLOWABLE BENDING STRESS 1000 PSI AND A MODULUS OF ELASTICITY OF 1,200,000 PSI.
- 3) NEW WOOD DECKING SHALL NOT EXCEED 15% MOISTURE CONTENT AND SHALL HAVE A V-JOINT PATTERN.
- 4) DECKING SHALL EXTEND OVER AT LEAST ONE SUPPORT.
- 5) NAILING PATTERNS AND METHODS AS PER WTRF.
- 6) CONTRACTOR SHALL SECURE REPAIR, OR REPLACE ALL EXISTING LOOSE AND DAMAGED COPPER FLASHING.

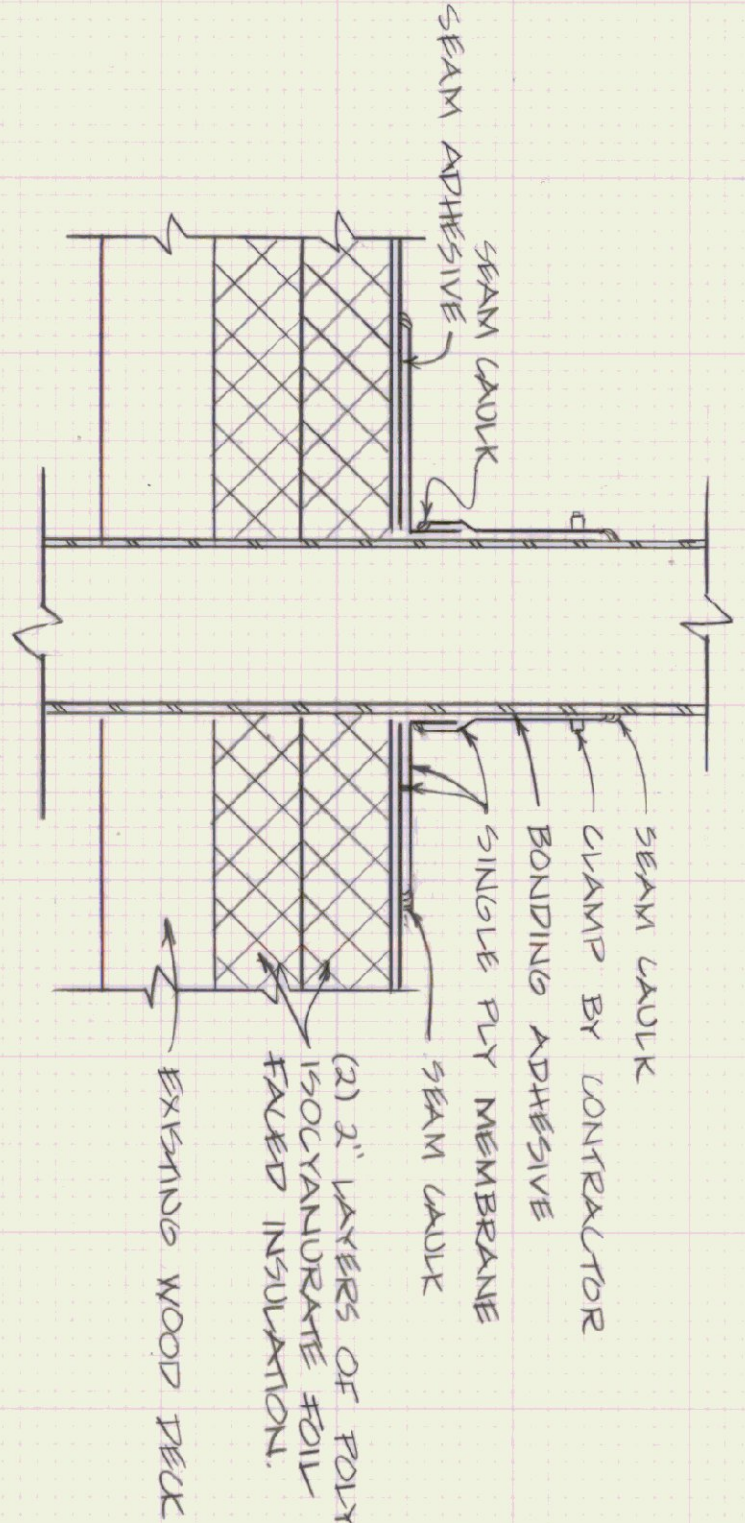

VENT STACK DETAIL

SCALE 3/8" = 1'-0"

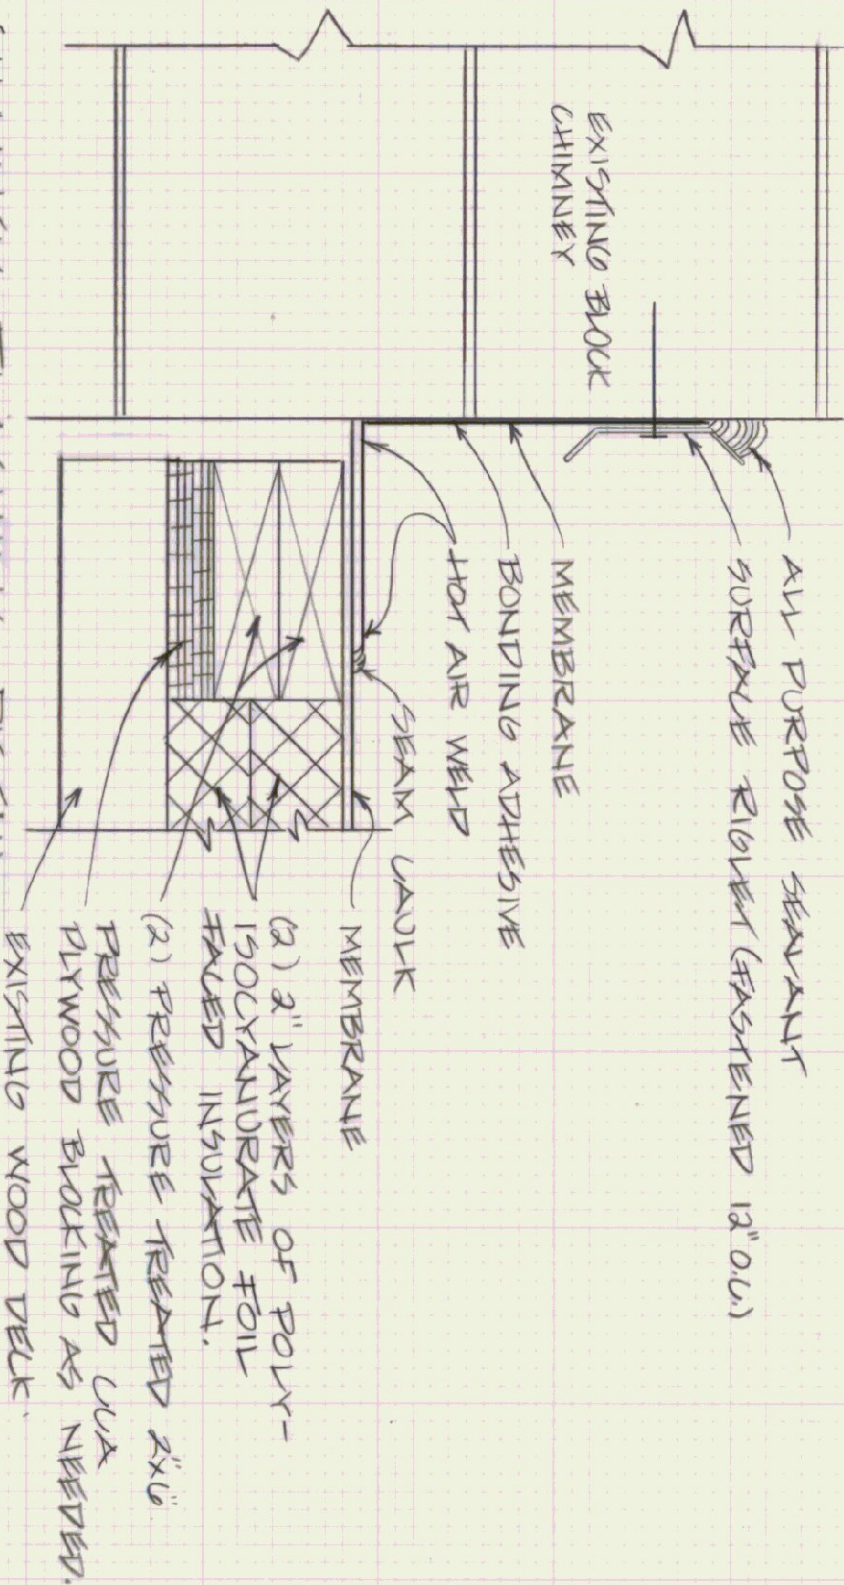

CHIMNEY FLASHING DETAIL

SCALE 3/8" = 1'-0"



STATE OF VERMONT			
DEPARTMENT OF STATE BUILDINGS			
AGENCY OF ADMINISTRATION			
MONTPELIER, VERMONT			
AGENCY OF TRANSPORTATION			
WILLIAMSTOWN & BAY GARAGE			
REEROOFING PROJECT			
WILLIAMSTOWN, VERMONT			
DATE: 4-19-05	SCALE: AS NOTED	REVISIONS:	DWG. NO.
DRAWN BY: J. BROWN	APPROVED BY: J. BROWN		
1 OF 11			