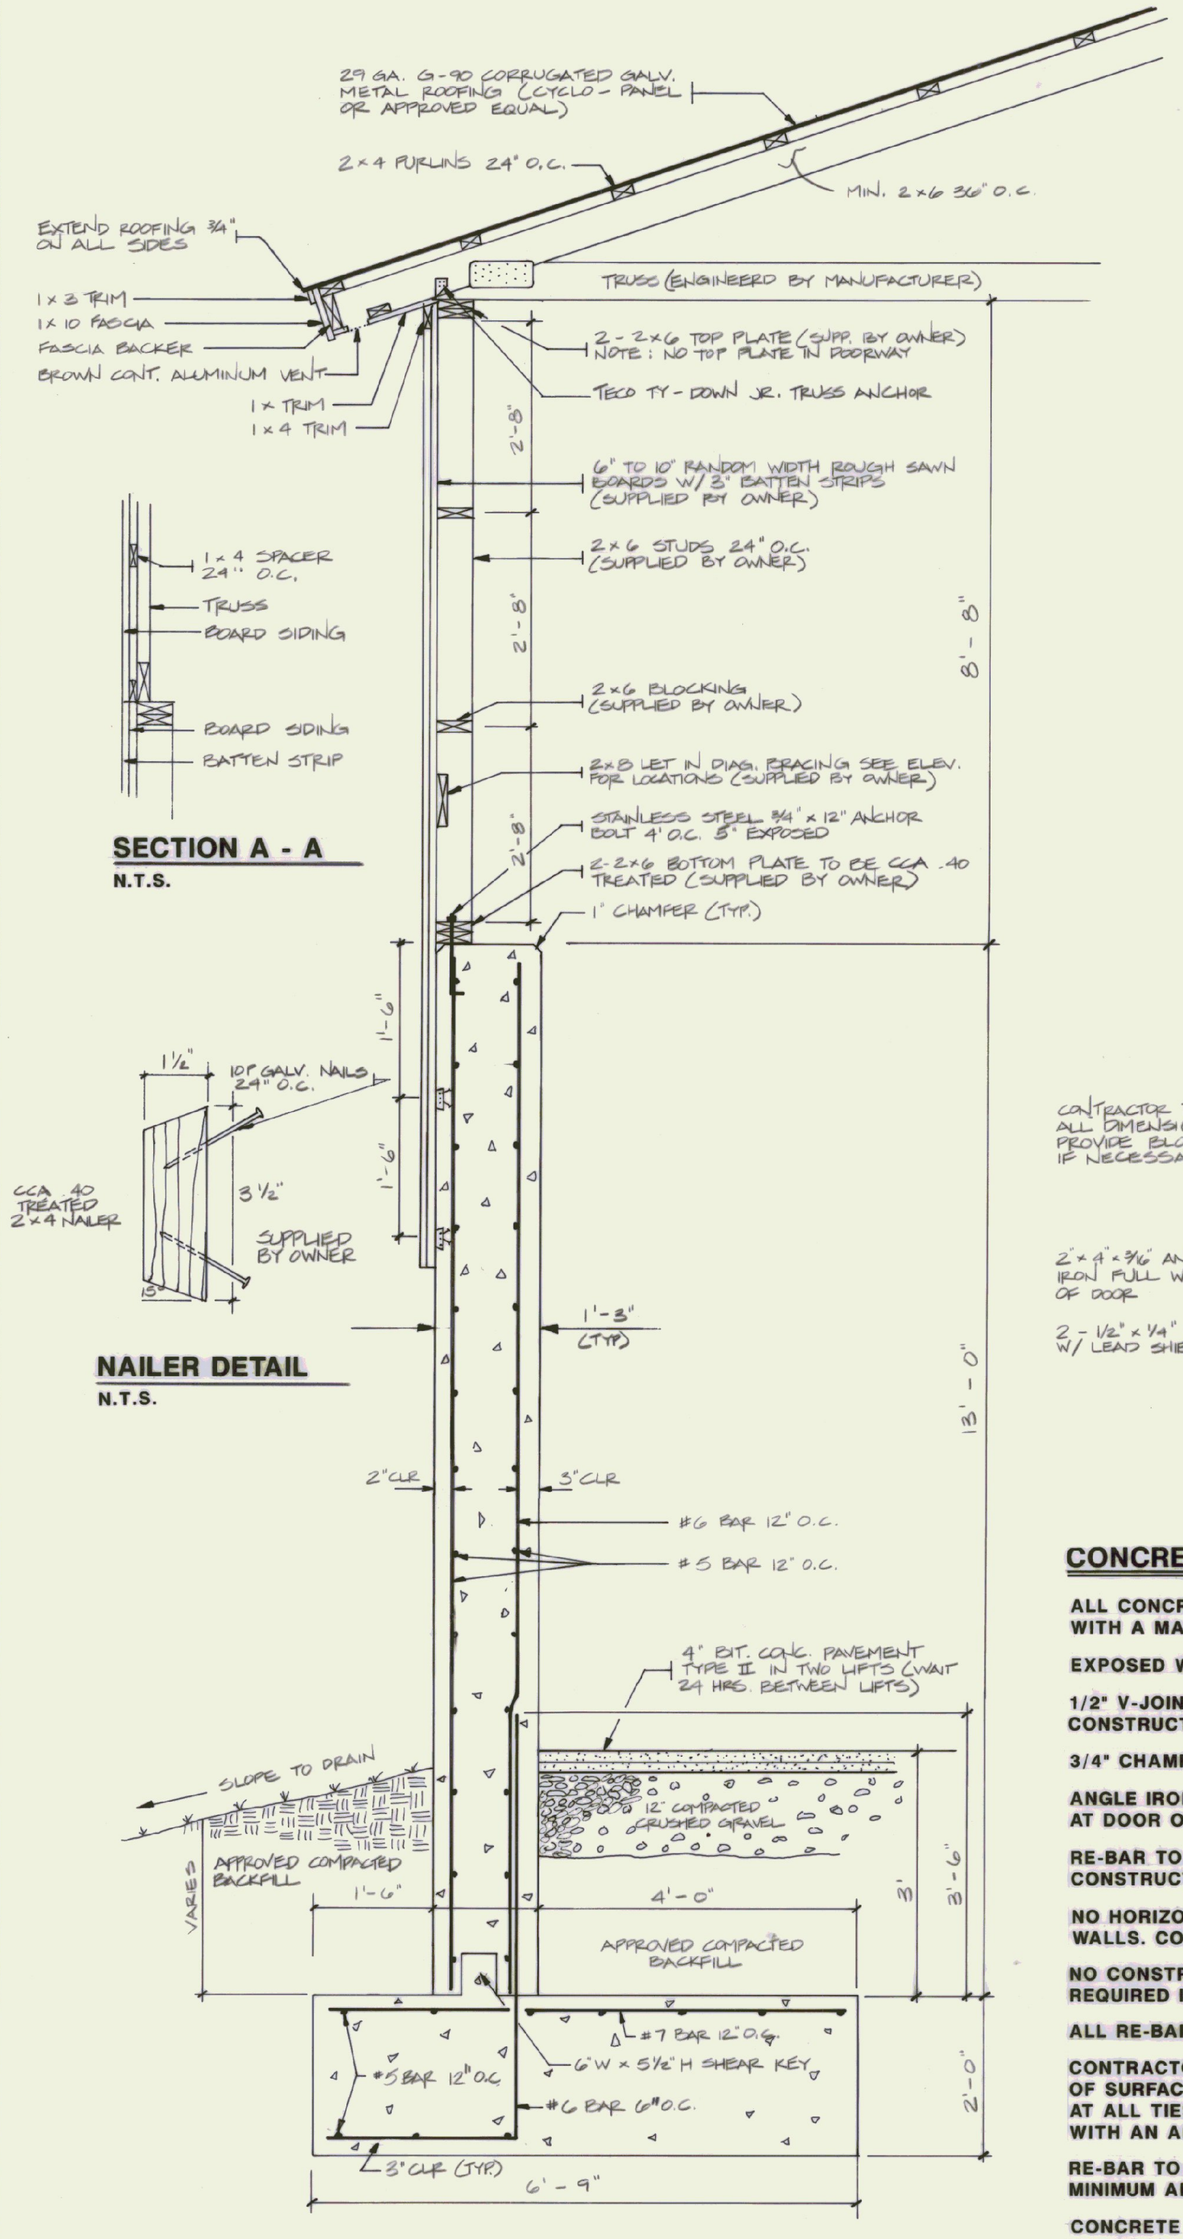

TYPICAL WALL SECTION

SCALE 3/4" = 1'-0"

SECTION A - A

N.T.S.

NAILER DETAIL

N.T.S.

TRUSS NOTES

TRUSS MANUFACTURER TO PROVIDE THE DEPT. OF STATE BUILDINGS ENGINEER A SET OF ENGINEERED & STAMPED DRAWINGS FOR APPROVAL PRIOR TO TRUSS MANUFACTURE

TRUSS MANUFACTURER TO PROVIDE THE CONTRACTOR WITH ALL NECESSARY INSTRUCTIONS FOR PROPER TRUSS INSTALLATION, ANCHORAGE, BRACING, LIFTING, ETC..

TRUSS DESIGN LOADS IN ACCORDANCE WITH THE 1987 B.O.C.A. FOR VERMONT

MINIMUM LOADS:

LIVE – PER 1987 B.O.C.A. FOR VT (50 PSF MIN.)

DEAD – AS CALC. FROM TRUSS & ROOF MATERIALS 5 LB SF ON BOTTOM CHORD

WIND – 25 PSF

DIAGONAL WIND BRACING PER TRUSS MANUFACTURER

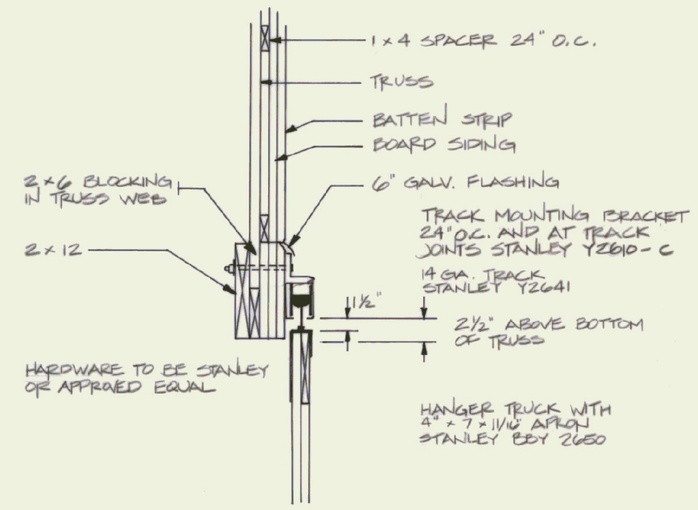

TRACK MOUNT DETAIL

N.T.S.

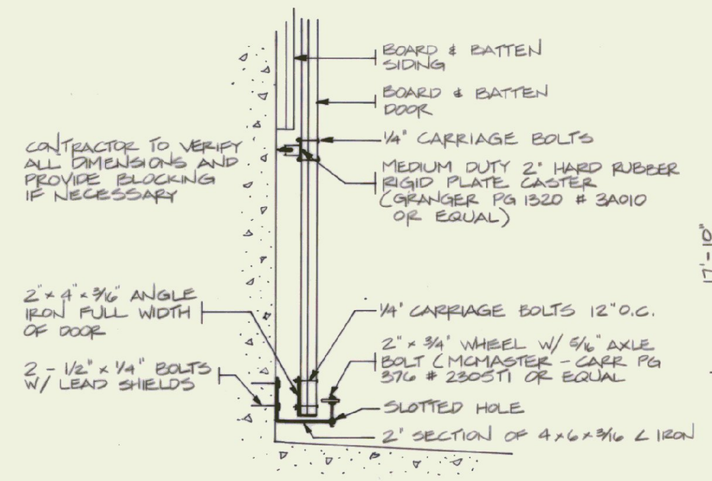

DOOR GUIDE DETAIL

N.T.S.

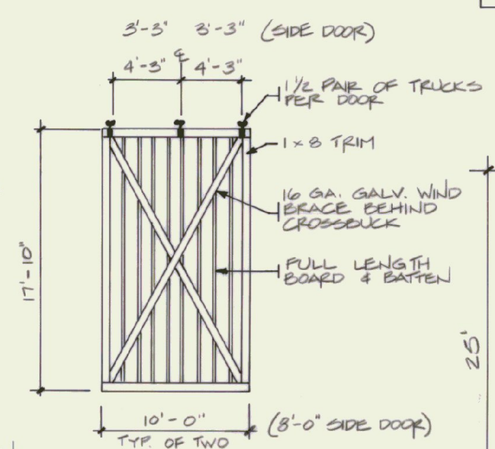

DOOR DETAIL

N.T.S.

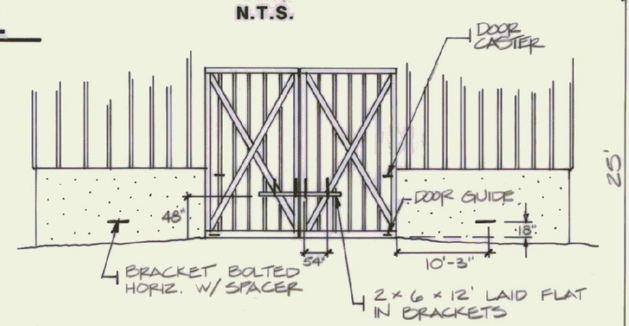

DOOR BRACKET LOCATIONS

N.T.S.

CONCRETE NOTES

ALL CONCRETE TO BE 3500 PSI @ 28 DAYS WITH A MAXIMUM SLUMP OF 4"

EXPOSED WALLS TO BE DRESS FINISHED

1/2" V-JOINTS IN EXPOSED FACE OF CONSTRUCTION JOINTS

3/4" CHAMFER IN OUTER FACE OF EXP. JOINTS

ANGLE IRON CAST INTO WALL CORNERS AT DOOR OPENINGS

RE-BAR TO BE CONTINUOUS THROUGH CONSTRUCTION JOINTS

NO HORIZONTAL CONSTRUCTION JOINTS IN WALLS. CONTINUOUS POUR

NO CONSTRUCTION OR EXPANSION JOINTS REQUIRED IN FOOTINGS

ALL RE-BAR TO BE GRADE 60

CONTRACTOR TO LEAVE NO METAL WITHIN 1" OF SURFACE. USE 1" DEEP PLASTIC CONES AT ALL TIES AND PLUG ALL TIE HOLES WITH AN APPROVED NON-SHRINK GROUT

RE-BAR TO BE STORED ON BLOCKING 4" MINIMUM ABOVE GROUND

CONCRETE SUPPLIER TO PROVIDE TEST CYLINDERS FOR TESTING BY OWNER

CONCRETE SUPPLIER TO CONDUCT ON SITE AIR TESTS

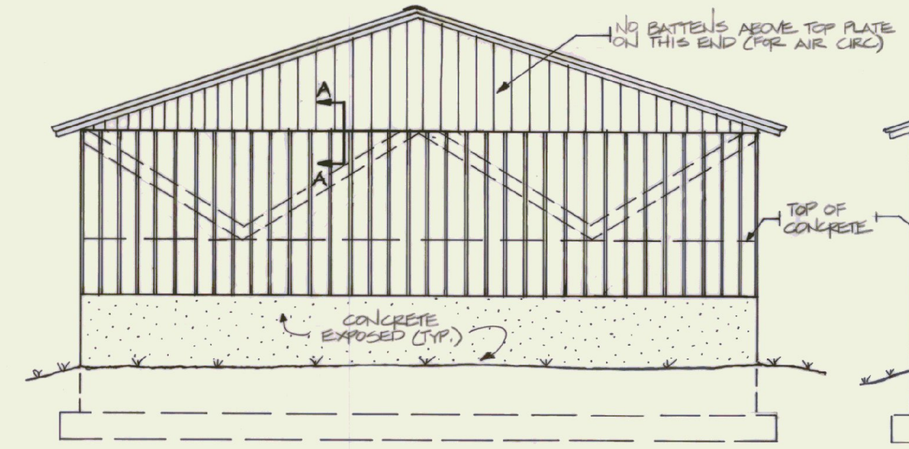

BACK ELEVATION

SCALE: 1/8" = 1'-0"

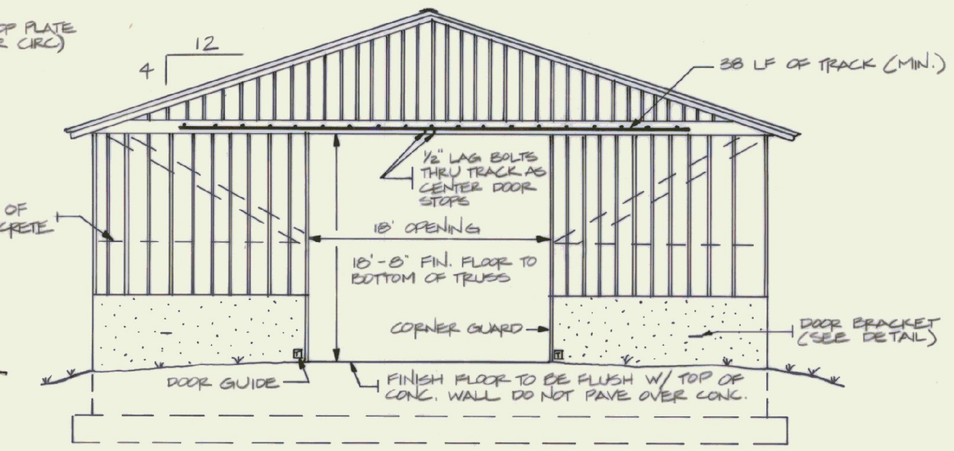

FRONT ELEVATION

SCALE: 1/8" = 1'-0"

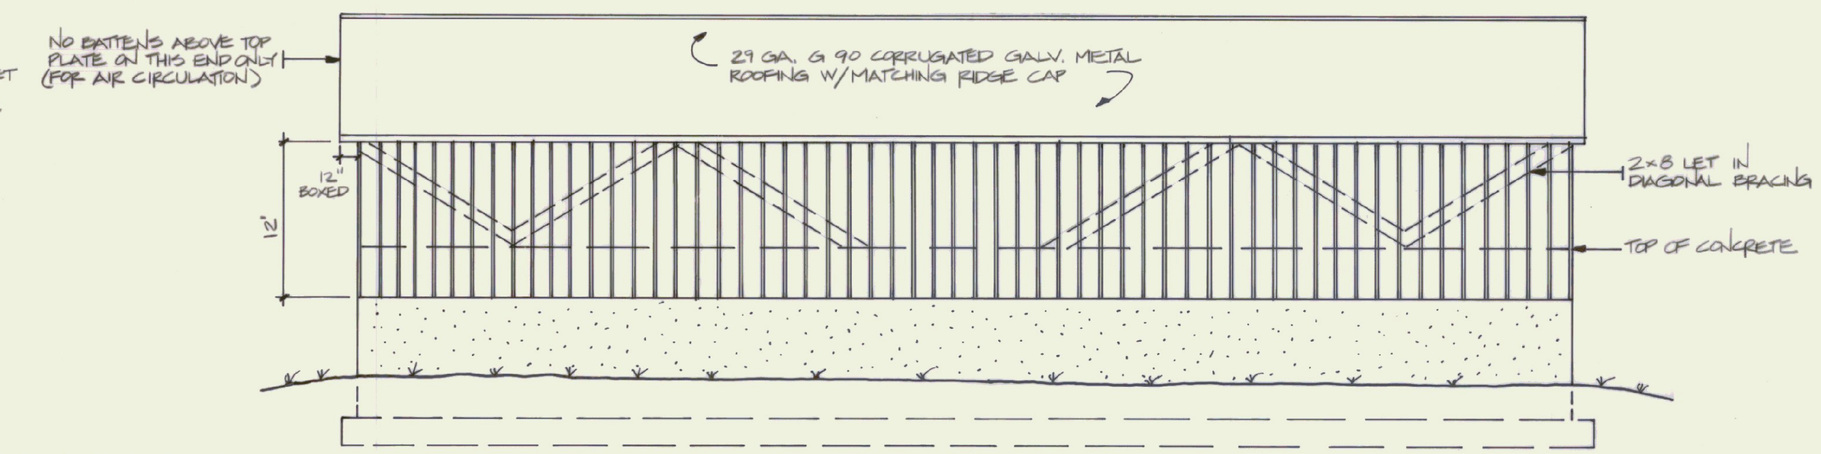

SIDE ELEVATION

SCALE: 1/8" = 1'-0"

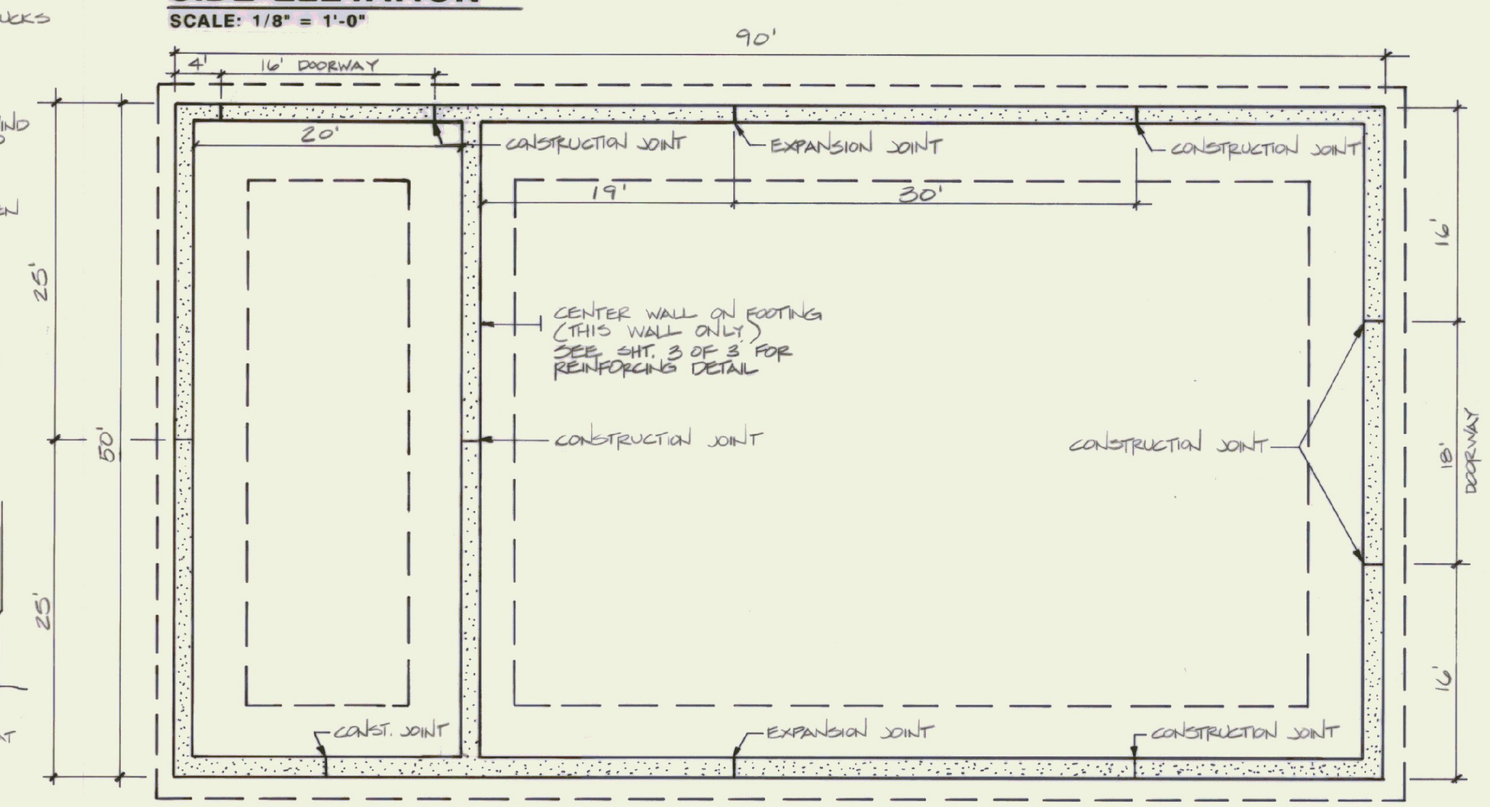

FOUNDATION PLAN

SCALE: 1/8" = 1'-0"

LUMBER NOTES

FRAMING MEMBERS TO BE KILN DRIED CONSTRUCTION GRADE SPRUCE S4S 19%

PLATES & NAILERS IN CONTACT WITH CONCRETE TO BE .40 CCA TREATED

BOARD & BATTEN SIDING TO BE NATIVE ROUGH SAWN WHITE PINE. BOARDS TO BE RANDOM WIDTHS 6" - 10" BATTEN WIDTH 3"

BOARD SIDING AND BATTEN STRIPS TO BE FULL LENGTH WITH NO HORIZONTAL JOINTS

ALL NAILS TO BE GALVANIZED

FINISH NOTES

ALL BOARDS AND BATTENS TO BE STAINED WITH ONE COAT ON ALL SIDES PRIOR TO INSTALLATION

AFTER INSTALLATION EXTERIOR SIDING TO RECEIVE ONE ADDITIONAL COAT OF STAIN

STAIN TO BE OLYMPIC OIL BASE SEMI-TRANSPARENT OXFORD BROWN #713

STATE OF VERMONT
DEPARTMENT OF STATE BUILDINGS
AGENCY OF ADMINISTRATION
MONTPELIER. VERMONT

50' X 90'
SALT/SAND SHED
GEORGIA MAINTENANCE FACILITY

GEORGIA VERMONT

DATE:	SCALE:	REVISIONS:	DWG. NO.
AUG. 1992	AS NOTED		A-1
DRAWN BY: B. MCGAVOY	APPROVED BY: JAAkkerson		2 OF 3