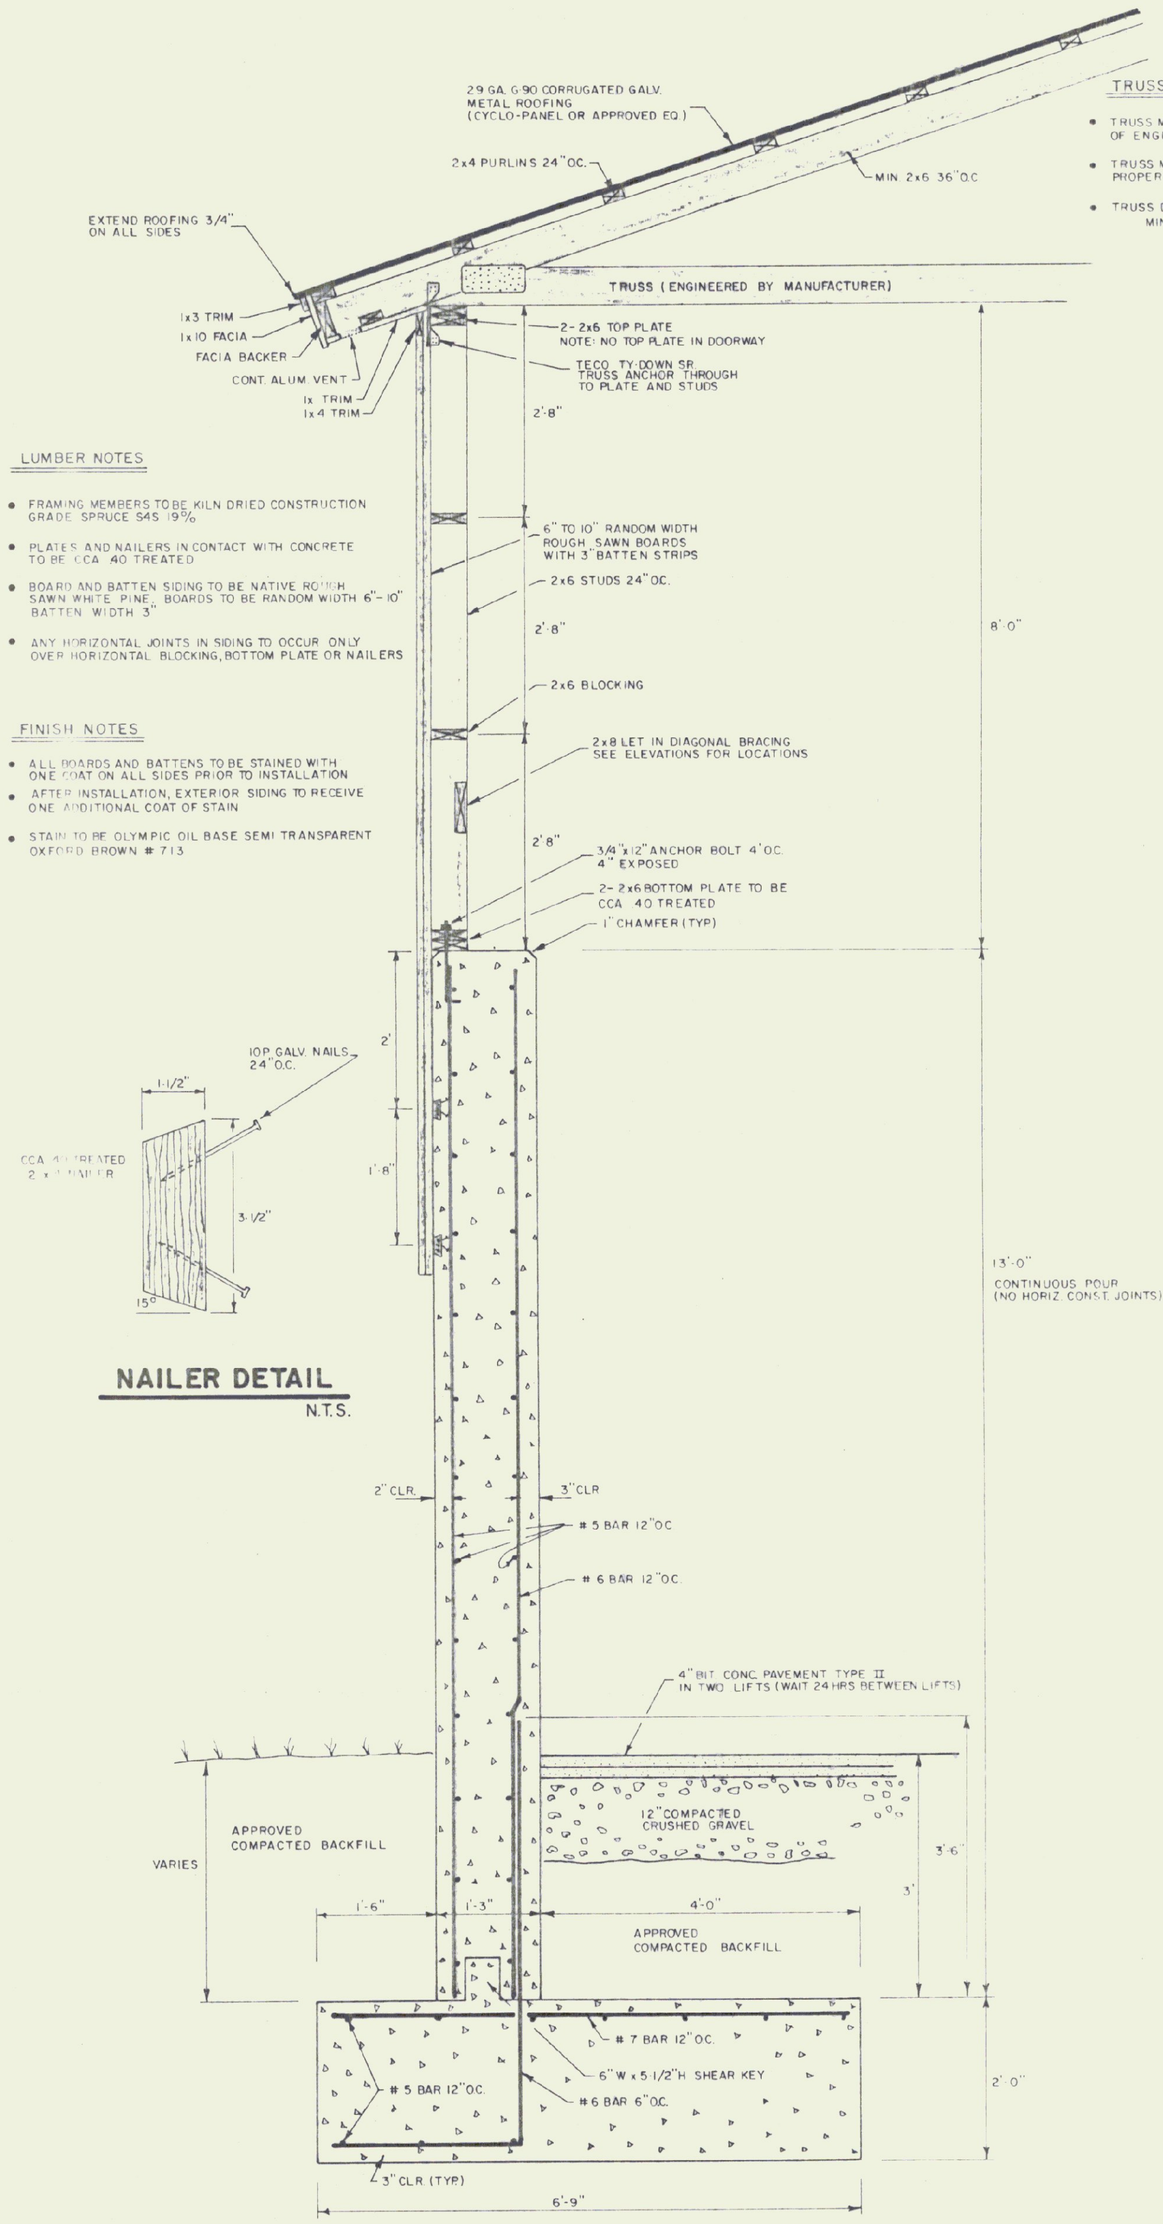

TYPICAL WALL SECTION
3/4"=1'-0"

NAILER DETAIL
N.T.S.

LUMBER NOTES
- FRAMING MEMBERS TO BE KILN DRIED CONSTRUCTION GRADE SPRUCE S4S 19%
- PLATES AND NAILERS IN CONTACT WITH CONCRETE TO BE CCA 40 TREATED
- BOARD AND BATTEN SIDING TO BE NATIVE ROUGH SAWN WHITE PINE, BOARDS TO BE RANDOM WIDTH 6"-10" BATTEN WIDTH 3"
- ANY HORIZONTAL JOINTS IN SIDING TO OCCUR ONLY OVER HORIZONTAL BLOCKING, BOTTOM PLATE OR NAILERS

FINISH NOTES
- ALL BOARDS AND BATTENS TO BE STAINED WITH ONE COAT ON ALL SIDES PRIOR TO INSTALLATION
- AFTER INSTALLATION, EXTERIOR SIDING TO RECEIVE ONE ADDITIONAL COAT OF STAIN
- STAIN TO BE OLYMPIC OIL BASE SEMI TRANSPARENT OXFORD BROWN # 713

TRUSS NOTES
- TRUSS MANUFACTURER TO PROVIDE THE DEPT OF STATE BUILDINGS ENGINEER A SET OF ENGINEERED & STAMPED DRAWINGS FOR APPROVAL PRIOR TO TRUSS MANUFACTURER
- TRUSS MANUFACTURER TO PROVIDE THE CONTRACTOR WITH ALL NECESSARY INSTRUCTIONS FOR PROPER TRUSS INSTALLATION, ANCHORAGE, BRACING ETC.
- TRUSS DESIGN LOADS IN ACCORDANCE WITH THE 1987 BOCA FOR VERMONT MINIMUM LOADS:
  - LIVE – PER 1987 BOCA FOR VT (50 PSF MIN.)
  - DEAD – AS CALCULATED FROM TRUSS & ROOF MATERIALS 5 LB. SF ON BOTTOM CHORD
  - WIND – 25 P.S.F.
  - DIAGONAL WIND BRACING REQUIRED

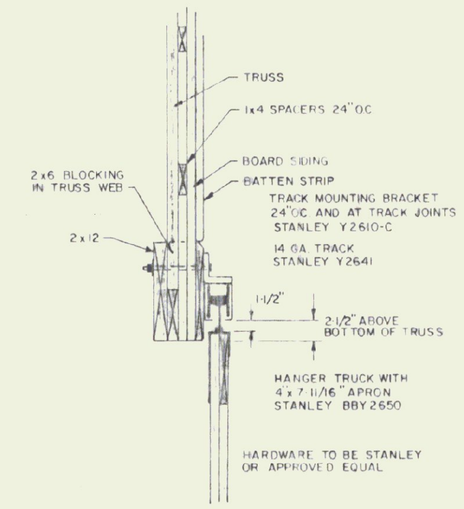

TRACK MOUNT DETAIL
N.T.S.

CONCRETE NOTES
- ALL CONCRETE TO BE 3500 PSI AT 28 DAYS WITH MAXIMUM SLUMP OF 4"
- EXPOSED WALLS TO BE DRESS FINISHED
- 1/2" V JOINTS IN EXPOSED FACE OF CONST. JOINTS
- 3/4" CHAMFER IN OUTER FACE OF EXPANSION JOINTS
- L IRON CAST INTO WALL CORNERS AT DOOR OPENINGS
- RE BAR TO BE CONTINUOUS THROUGH CONST. JOINTS
- NO HORIZONTAL CONST. JOINTS IN WALLS
- NO CONST. OR EXP. JOINTS REQUIRED IN FOOTINGS
- ALL RE-BAR TO BE GRADE 60
- CONTRACTOR TO LEAVE NO METAL WITHIN 1" OF SURFACE. USE 1" DEEP PLASTIC CONES AT ALL TIES AND PLUG ALL TIE HOLES WITH AN APPROVED NON-SHRINK GROUT
- RE BAR TO BE STORED ON BLOCKING 4" MIN. ABOVE GROUND
- CONCRETE SUPPLIER TO PROVIDE TEST CYLINDERS FOR TESTING BY OWNER
- CONCRETE SUPPLIER TO CONDUCT ON SITE AIR TEST

NOTE:
EXACT BUILDING LOCATION AND FLOOR ELEVATION TO BE DETERMINED IN THE FIELD BY THE ENGINEER.

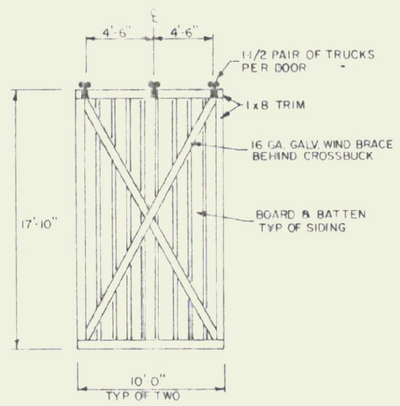

DOOR DETAIL
N.T.S.



CORNER DETAIL
N.T.S.

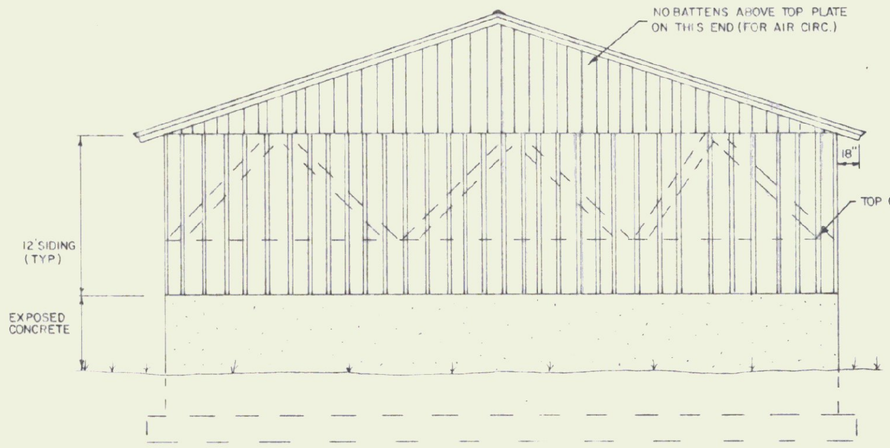

BACK ELEVATION
1/8"=1'-0"

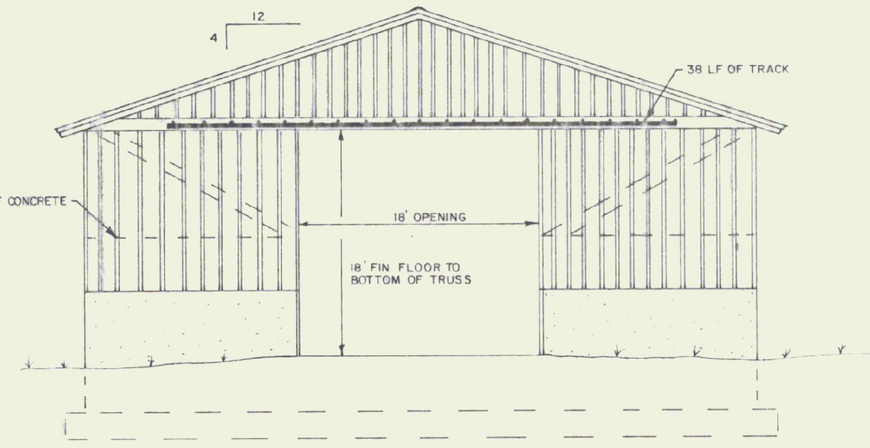

FRONT ELEVATION
1/8"=1'-0"

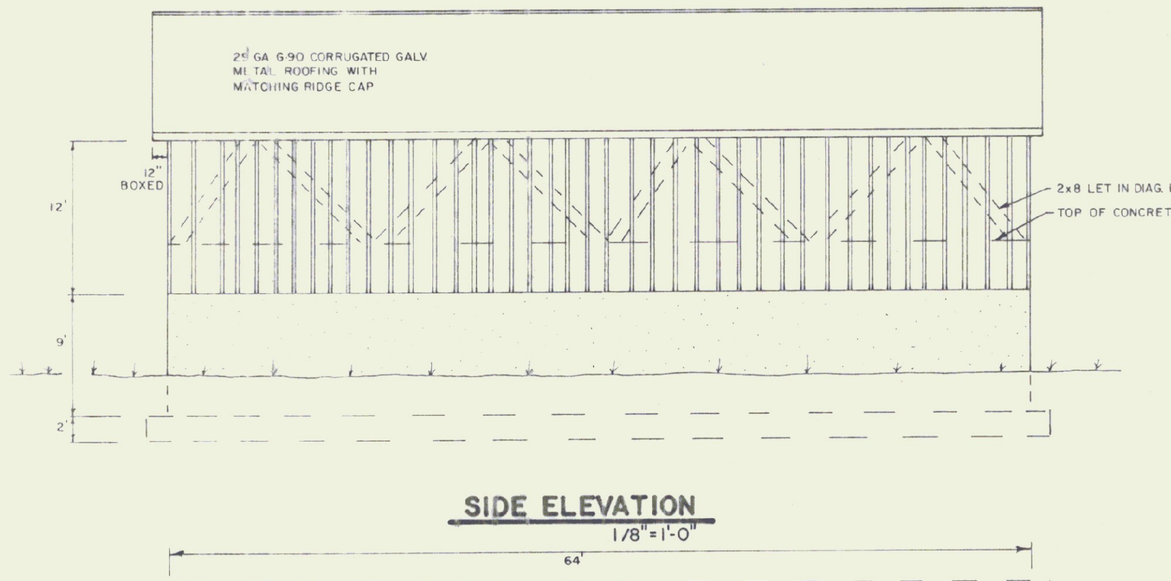

SIDE ELEVATION
1/8"=1'-0"

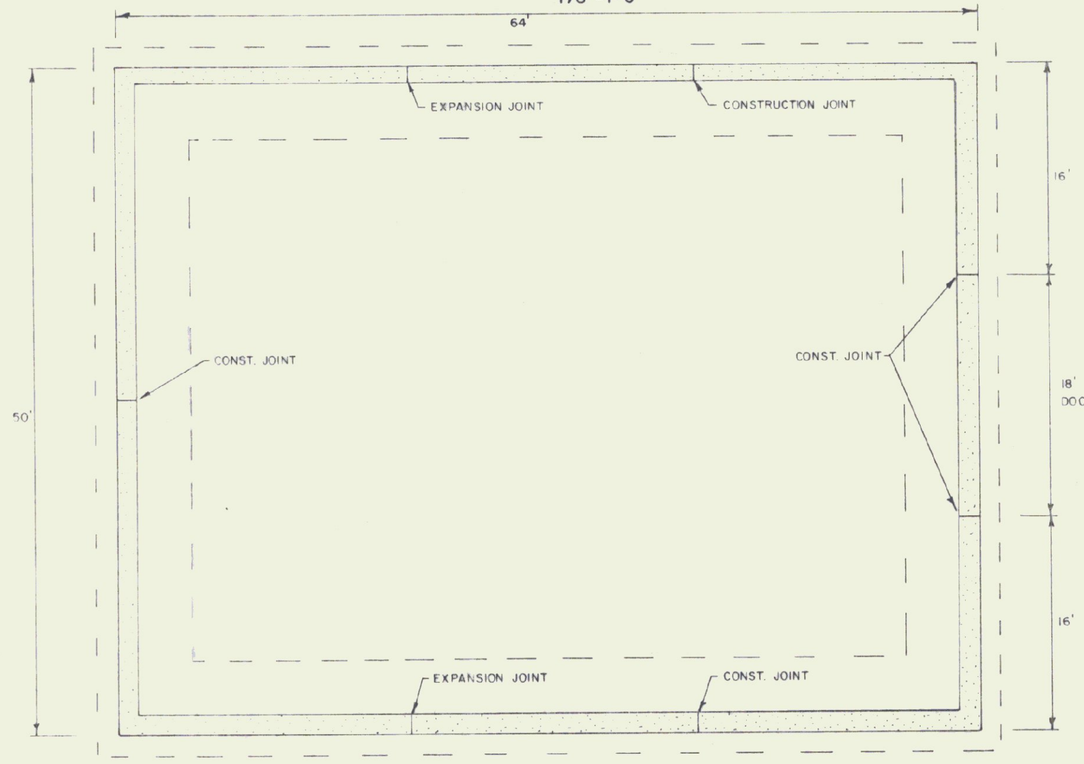

FOUNDATION PLAN
1/8"=1'-0"

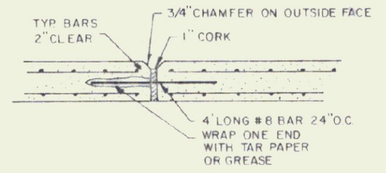

EXPANSION JOINT DETAIL
N.T.S.



CORNER GUARD
N.T.S.

STATE OF VERMONT
DEPARTMENT OF STATE BUILDINGS
AGENCY OF ADMINISTRATION
MONTPELIER, VERMONT

50'x 64'
SALT / SAND SHED
ST. ALBANS MAINTENANCE FACILITY
ST. ALBANS VERMONT

DATE: SEPT 5, 1991	SCALE: AS NOTED	REVISIONS:	DWG. NO.
DRAWN BY: S.K. JANAWICZ	APPROVED BY:		1 OF 1