


R-4	P-127-2-4/P108-4	1	RELAY
R-5	P-127-2-4/P108-4	1	RELAY
R-6	P-127-2-4/P108-4	1	RELAY

VAV BOX CONTROL: WHEN THE HOOD FAN IS TURNED ON BY OTHER MEANS THAN WAS SPECIFIED THE BOX WILL OPEN TO SUPPLY A FIXED CFM TO THE SPACE. THE BOX WILL BE BALANCED WITH THE EXISTING MVU SYSTEM ON.

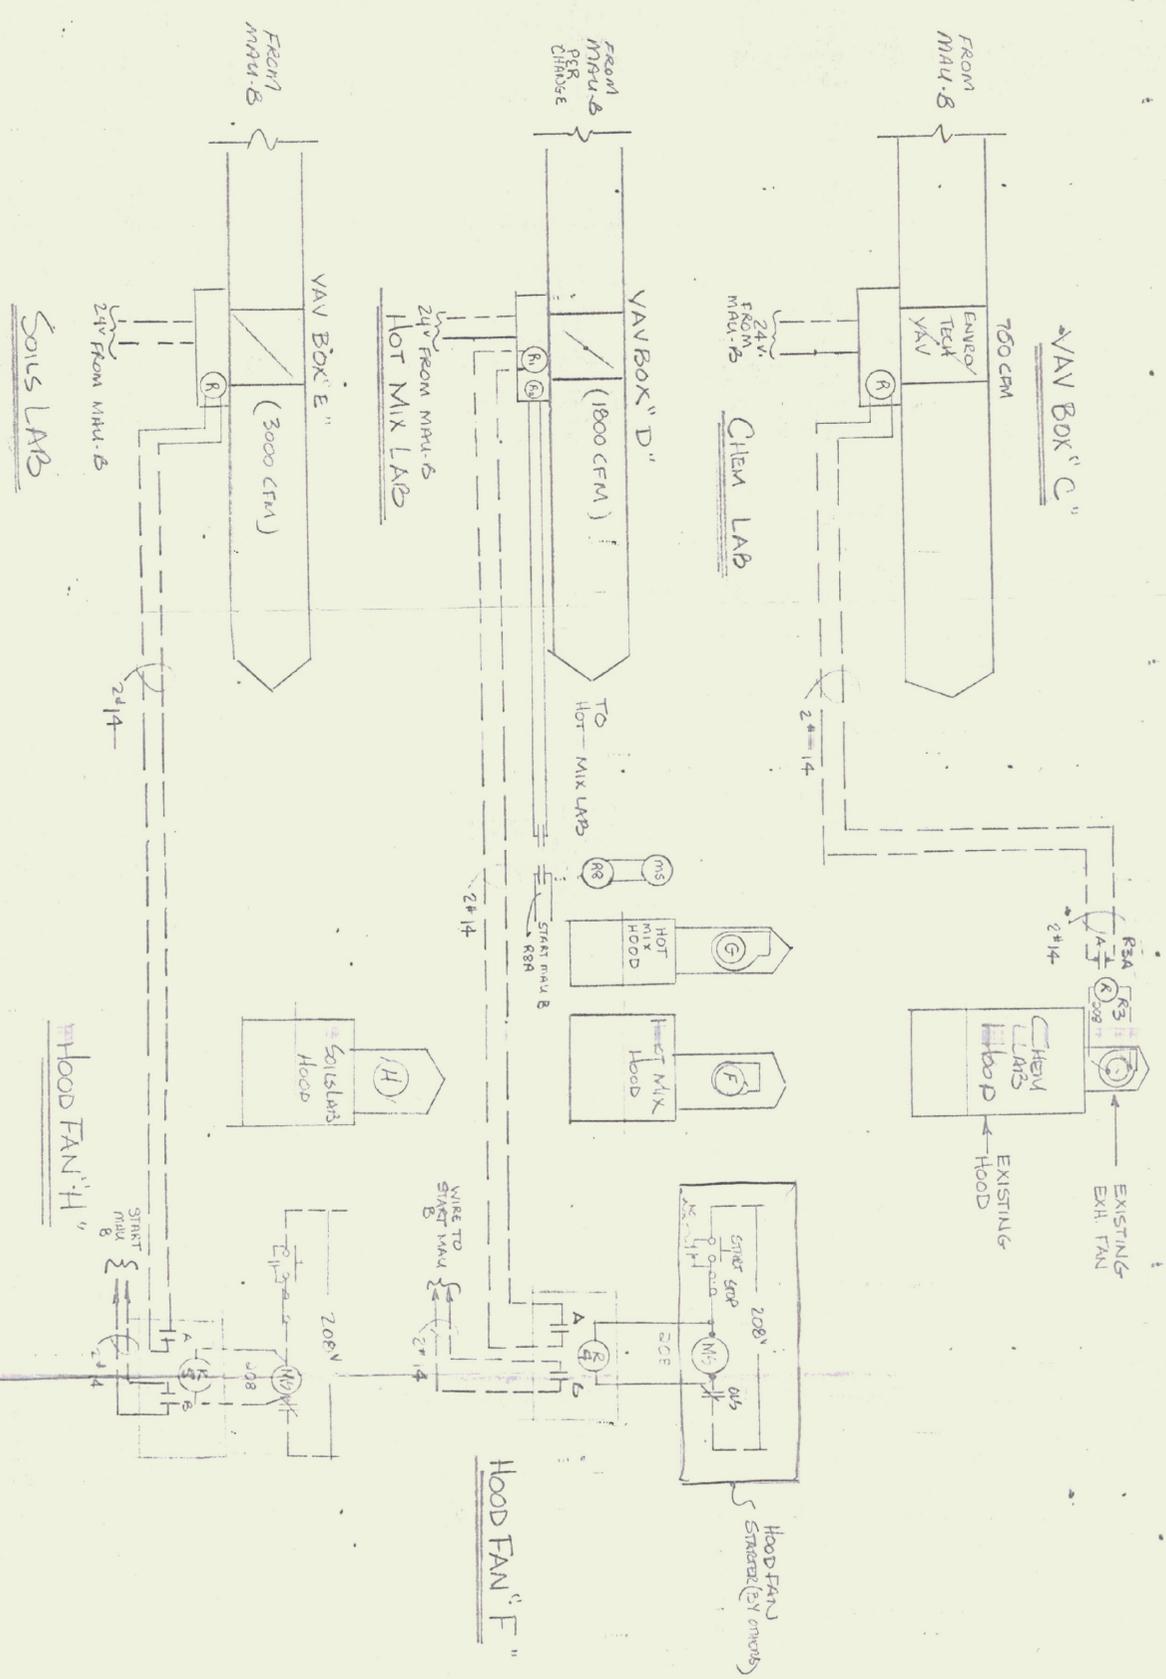

CONTROL TECHNOLOGIES
A Sola Company

ST. JE-VI - WATERIN & RESEARCH LAB PH. III

JOB NAME: BERLIN, VERMONT
 LOCATION: JENSEN DESIGN, INC.
 ACCOUNT: PAR ENGINEERING
 ENGINEER: ARNOLD EDWARDS ORP.
 CONTACT: JEN PATRISN
 DRAWN BY: CHELSEA BUTTSER
 CHECKED BY: JEN PATRISN
 DATE: 2/28/91

REVISIONS:

DATE	CHANGES
7-18-91	RS EOL-IT

DRAWING NO. **2 OF 2**
90145