




R-4	P-127-2-4/P108-4	1	RELAY
R-5	P-127-2-4/P108-4	1	RELAY
R-6	P-127-2-4/P108-4	1	RELAY

VAV BOX CONTROL: WHEN THE HOOD FAN IS TURNED ON BY OTHER MEANS THAN WAS SPECIFIED THE BOX WILL OPEN TO SUPPLY A FIXED CFM TO THE SPACE. THE BOX WILL BE BALANCED WITH THE EXISTING MVU SYSTEM ON.



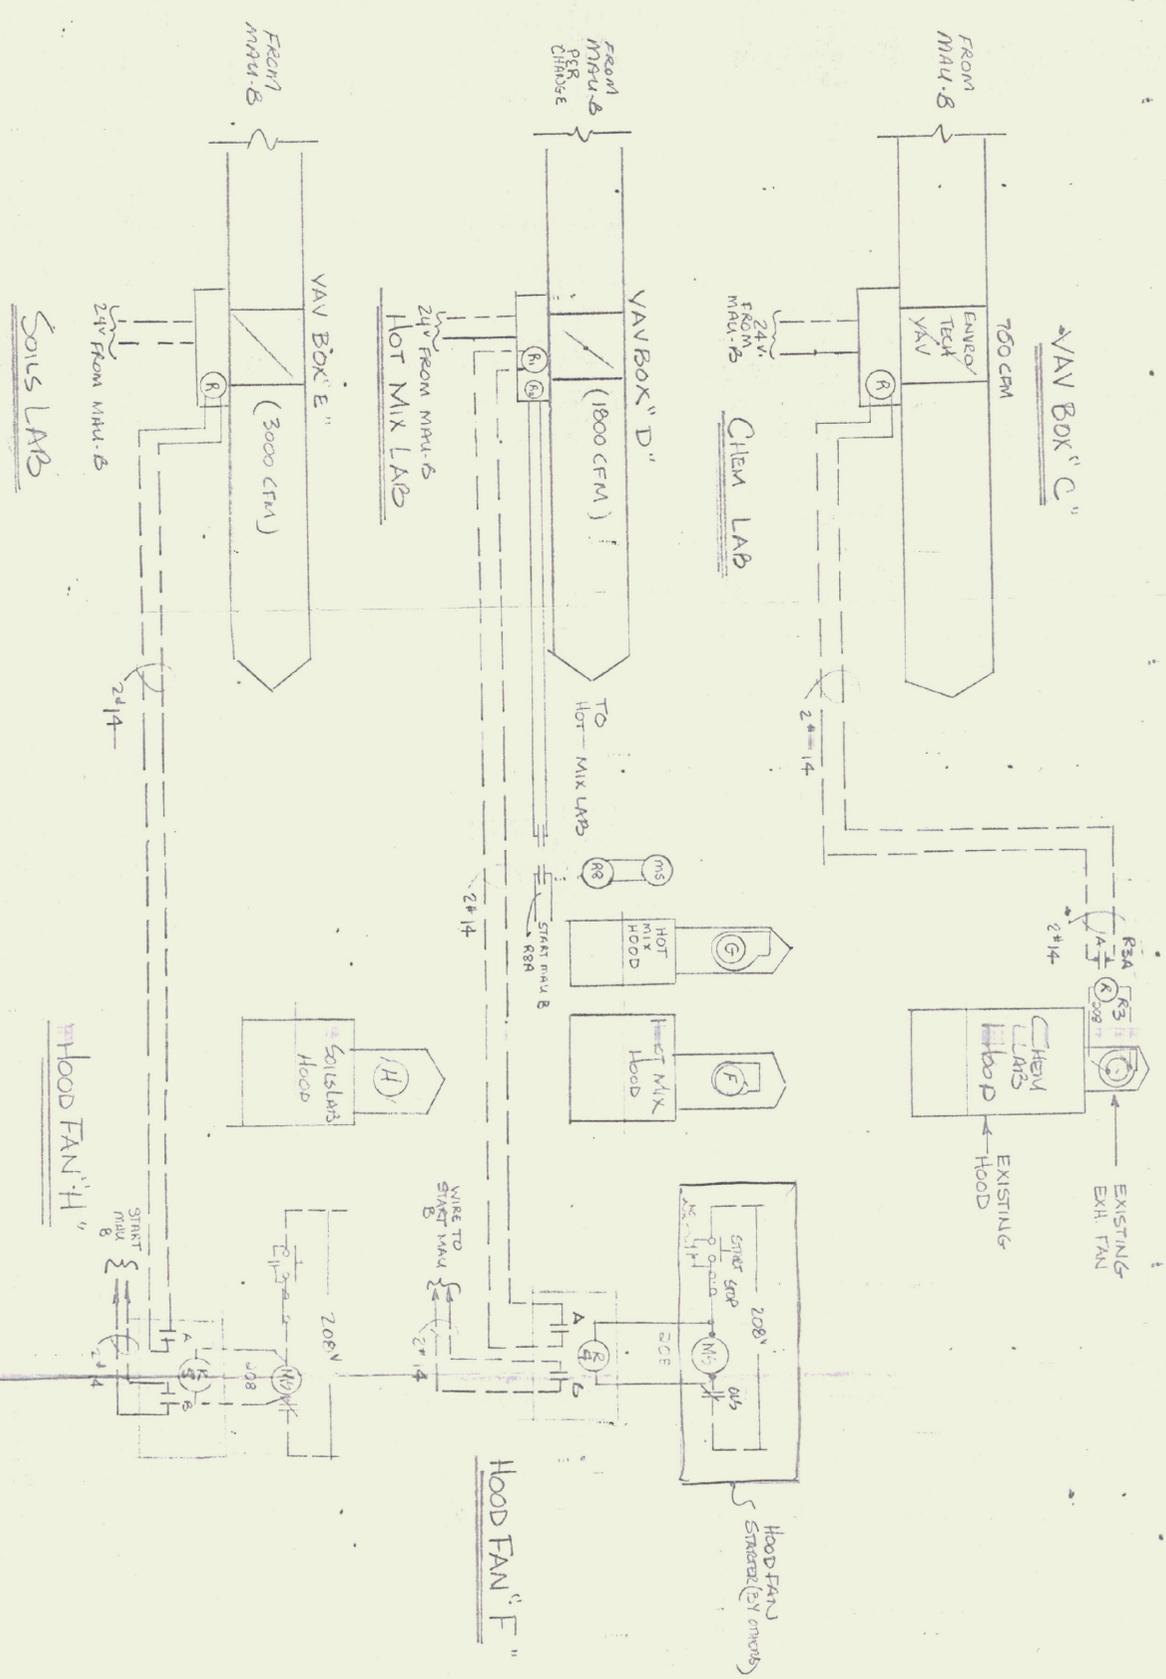

**CONTROL TECHNOLOGIES**  
A Sola Company  
2500 W. 10th Street  
Des Moines, IA 50319

**ST. JE-VI - WATERIN & RESEARCH LAB PH. III**

JOB NAME: BERLIN, VERMONT  
 LOCATION: JENSEN DESIGN, INC.  
 ACCOUNT: PAR ENGINEERING  
 ENGINEER: ARNOLD EDWARDS ORP.  
 CONTRACTOR: JEN PATRISON  
 DRAWN BY: CHELSEA BOUTISER  
 CHECKED BY: JEN PATRISON  
 DATE: 2/28/91

REVISIONS: —

DATE	CHANGES
7-18-91	RS EOL-IT

DRAWING NO. **2 OF 2**  
90145