
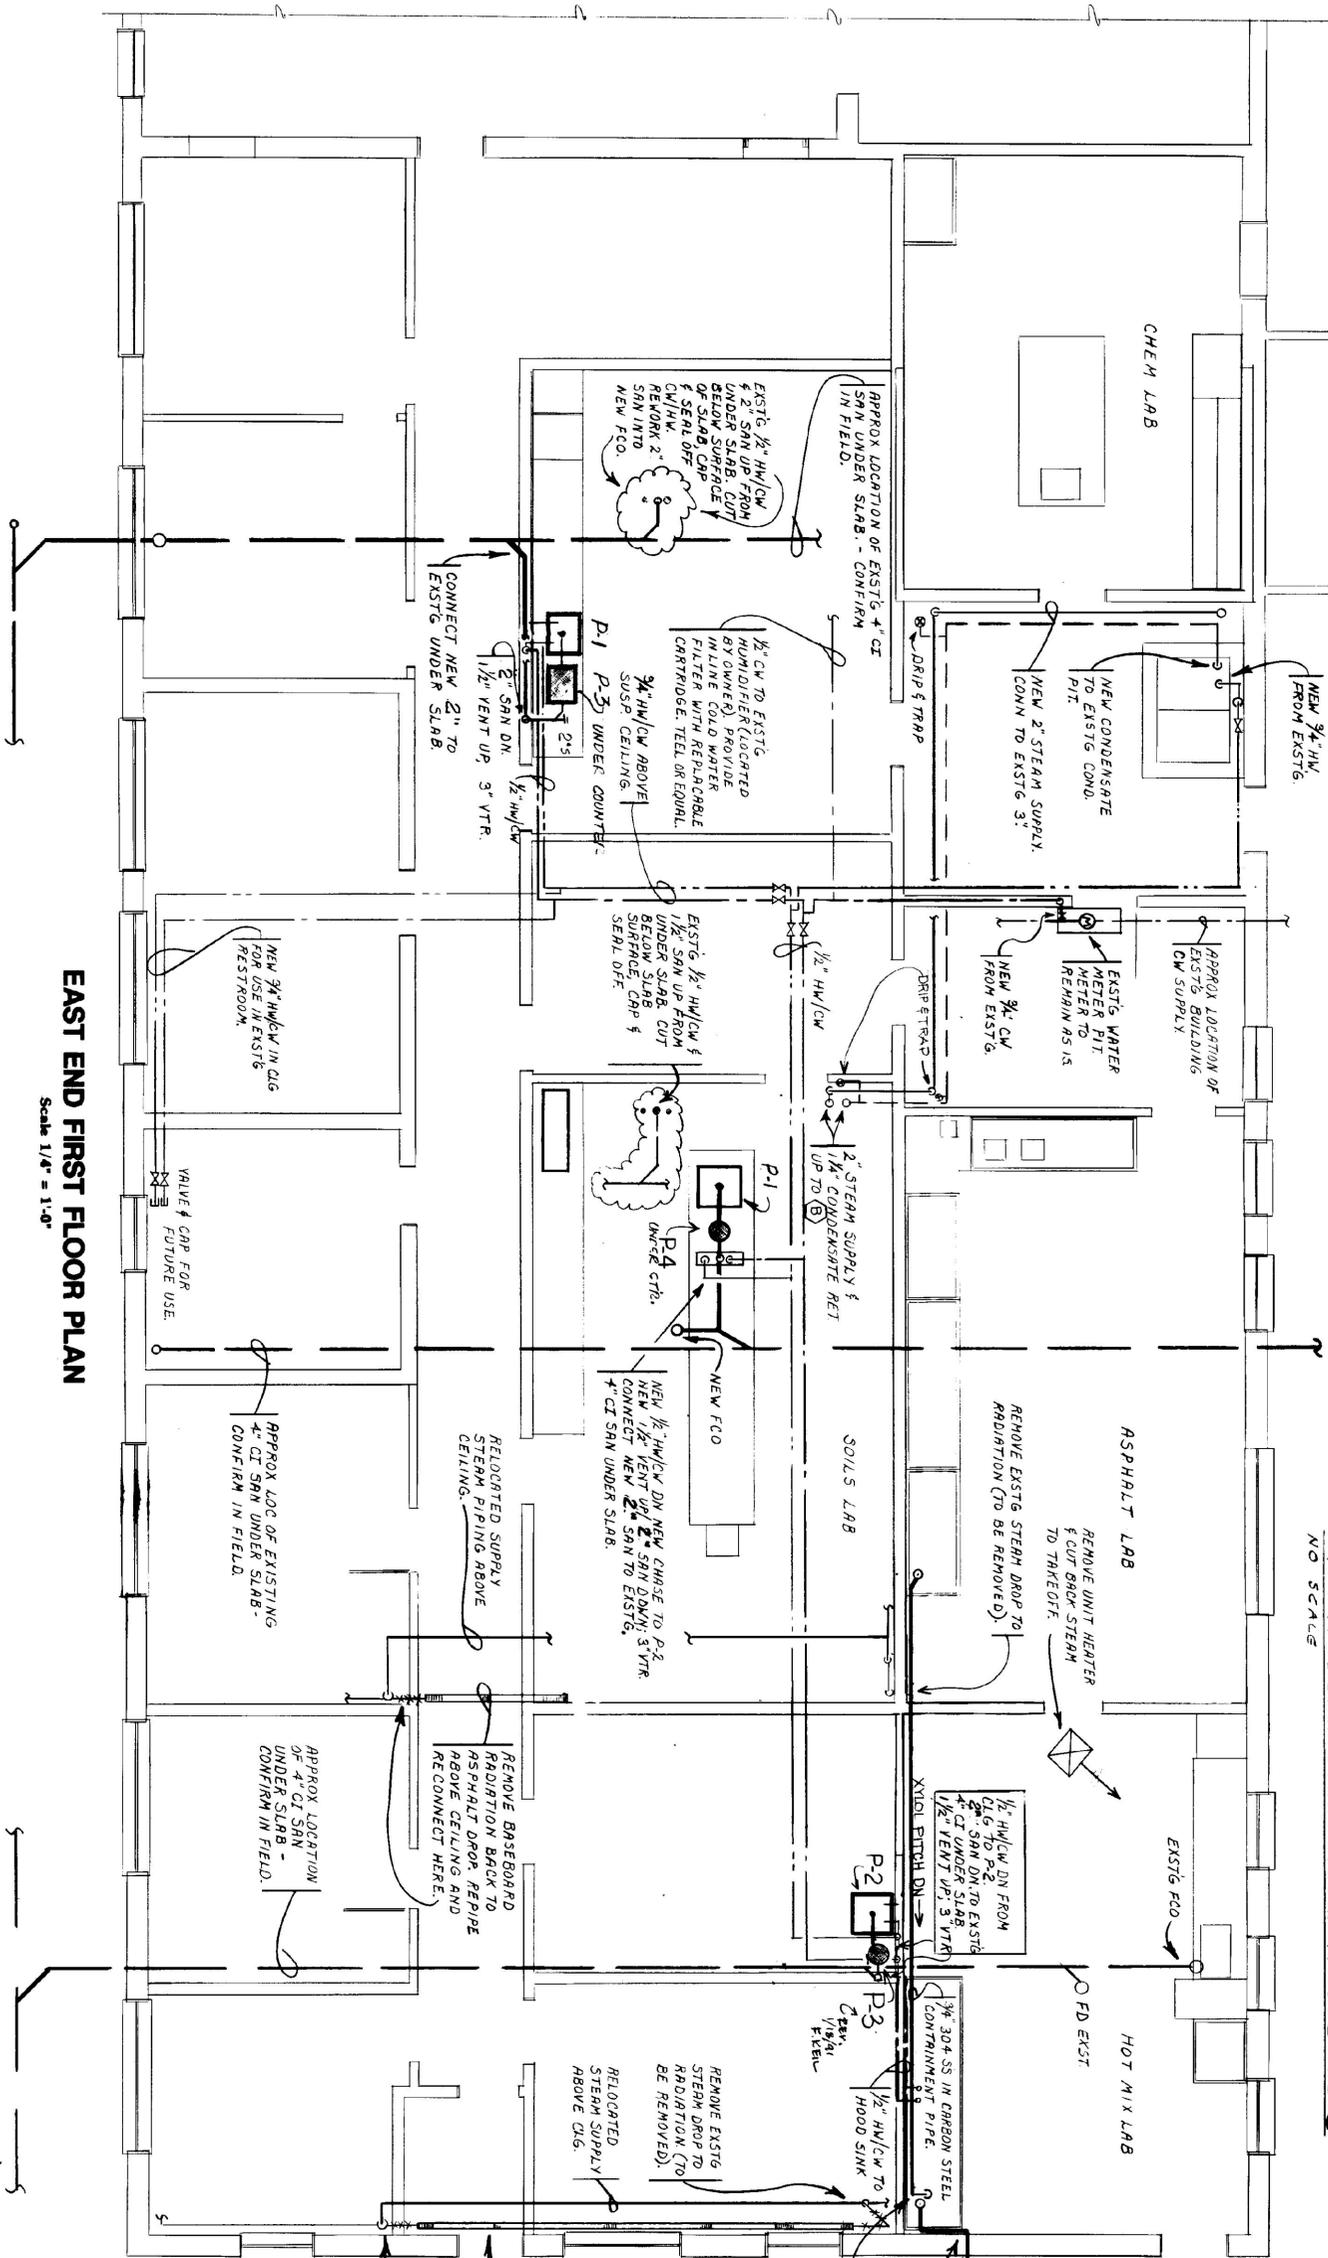


PLUMBING FIXTURE SCHEDULE

MARK	TYPE	MANUFACTURER	MODEL	CONNECTIONS					NOTES
				HW	CW	W	V	G	
P-1	COUNTERTOP SINK STAINLESS STEEL	ELKAY	DIR-2522-10	1/2"	1/2"	2"	1-1/2"		27" X 18-3/4" X 10" COMPARTMENT LK-4323 DECK MOUNT FACET.
P-2	FREE STANDING STAINLESS STEEL SINK	ELKAY	SS-8124	1/2"	1/2"	2"	1-1/2"		SINK COMPARTMENT 24" X 24" X 14" LK-47-C 10" BRASS FACET LK-38-RT WASTE FITTING W/ HANDLE 2" PIPE SIZE
P-3	SOLIDS INTERCEPTOR	ZURN	Z-1181	2"	1-1/2"				2" PIPES, REMOVABLE SEPARATE BASKET.
P-4	SOLIDS INTERCEPTOR	ZURN	Z-1180	2"	1-1/2"				2" PIPES, REMOVABLE SEPARATE BASKET.

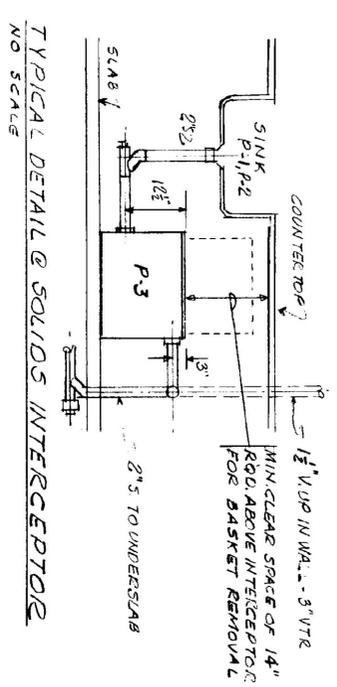

MARK	Type	Fluid Temp. Range	Minimum Pipe Insulation - R-values											
			1/2\"/>											
Heating Systems Steam & Hot Water	High Pressure	150-250	1.5	2.5	3.5	4.5	5.5	6.5	7.5	8.5	9.5	10.5	11.5	
	Medium Pressure	120-150	1.5	2.5	3.5	4.5	5.5	6.5	7.5	8.5	9.5	10.5	11.5	
Cooling Systems Chilled Water	High Pressure	40-50	1.5	2.5	3.5	4.5	5.5	6.5	7.5	8.5	9.5	10.5	11.5	
	Low Pressure	40-50	1.5	2.5	3.5	4.5	5.5	6.5	7.5	8.5	9.5	10.5	11.5	

Rating	Non-enclosing			Enclosing		
	Up to 1\"/>					
7.5-8.2	0.5	1.0	1.5	0.5	1.0	1.5
6.0-7.1	0.5	1.0	1.5	0.5	1.0	1.5
3.8-5.4	0.5	1.0	1.5	0.5	1.0	1.5

OWNER TO REMOVE ALL RADIATION ON OUTSIDE WALLS EXCEPT AS NOTED.

REMOVE EXISTG BASEBOARD RADIATION, REPIPE STEAM SUPPLY OVERHEAD AND RECONNECT HERE.



MECHANICAL CONSULTANT:
GWR Engineering, P.C.
 P.O. Box 157, The Courtyard Building
 Shelburne, VT 05482
 Tel: (802) 988-8081 FAX: (802) 988-8489

State of Vermont
 Department of State Buildings
 John Zampieri, Commissioner

Materials & Research
 Laboratory
 Berlin, Vt.

ARCHITECT:
 Jonson Design, Inc.
 750 VTL ARCHITECT
 P.O. BOX 55 - BOSTON ROAD, WATTSBORO, VT 05576
 (802) 244-3800

PHASE II FLOOR PLAN
 1-10-91
PLUMBING PLAN
M-11