
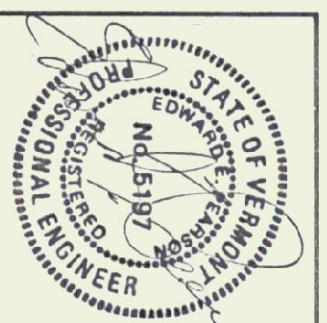
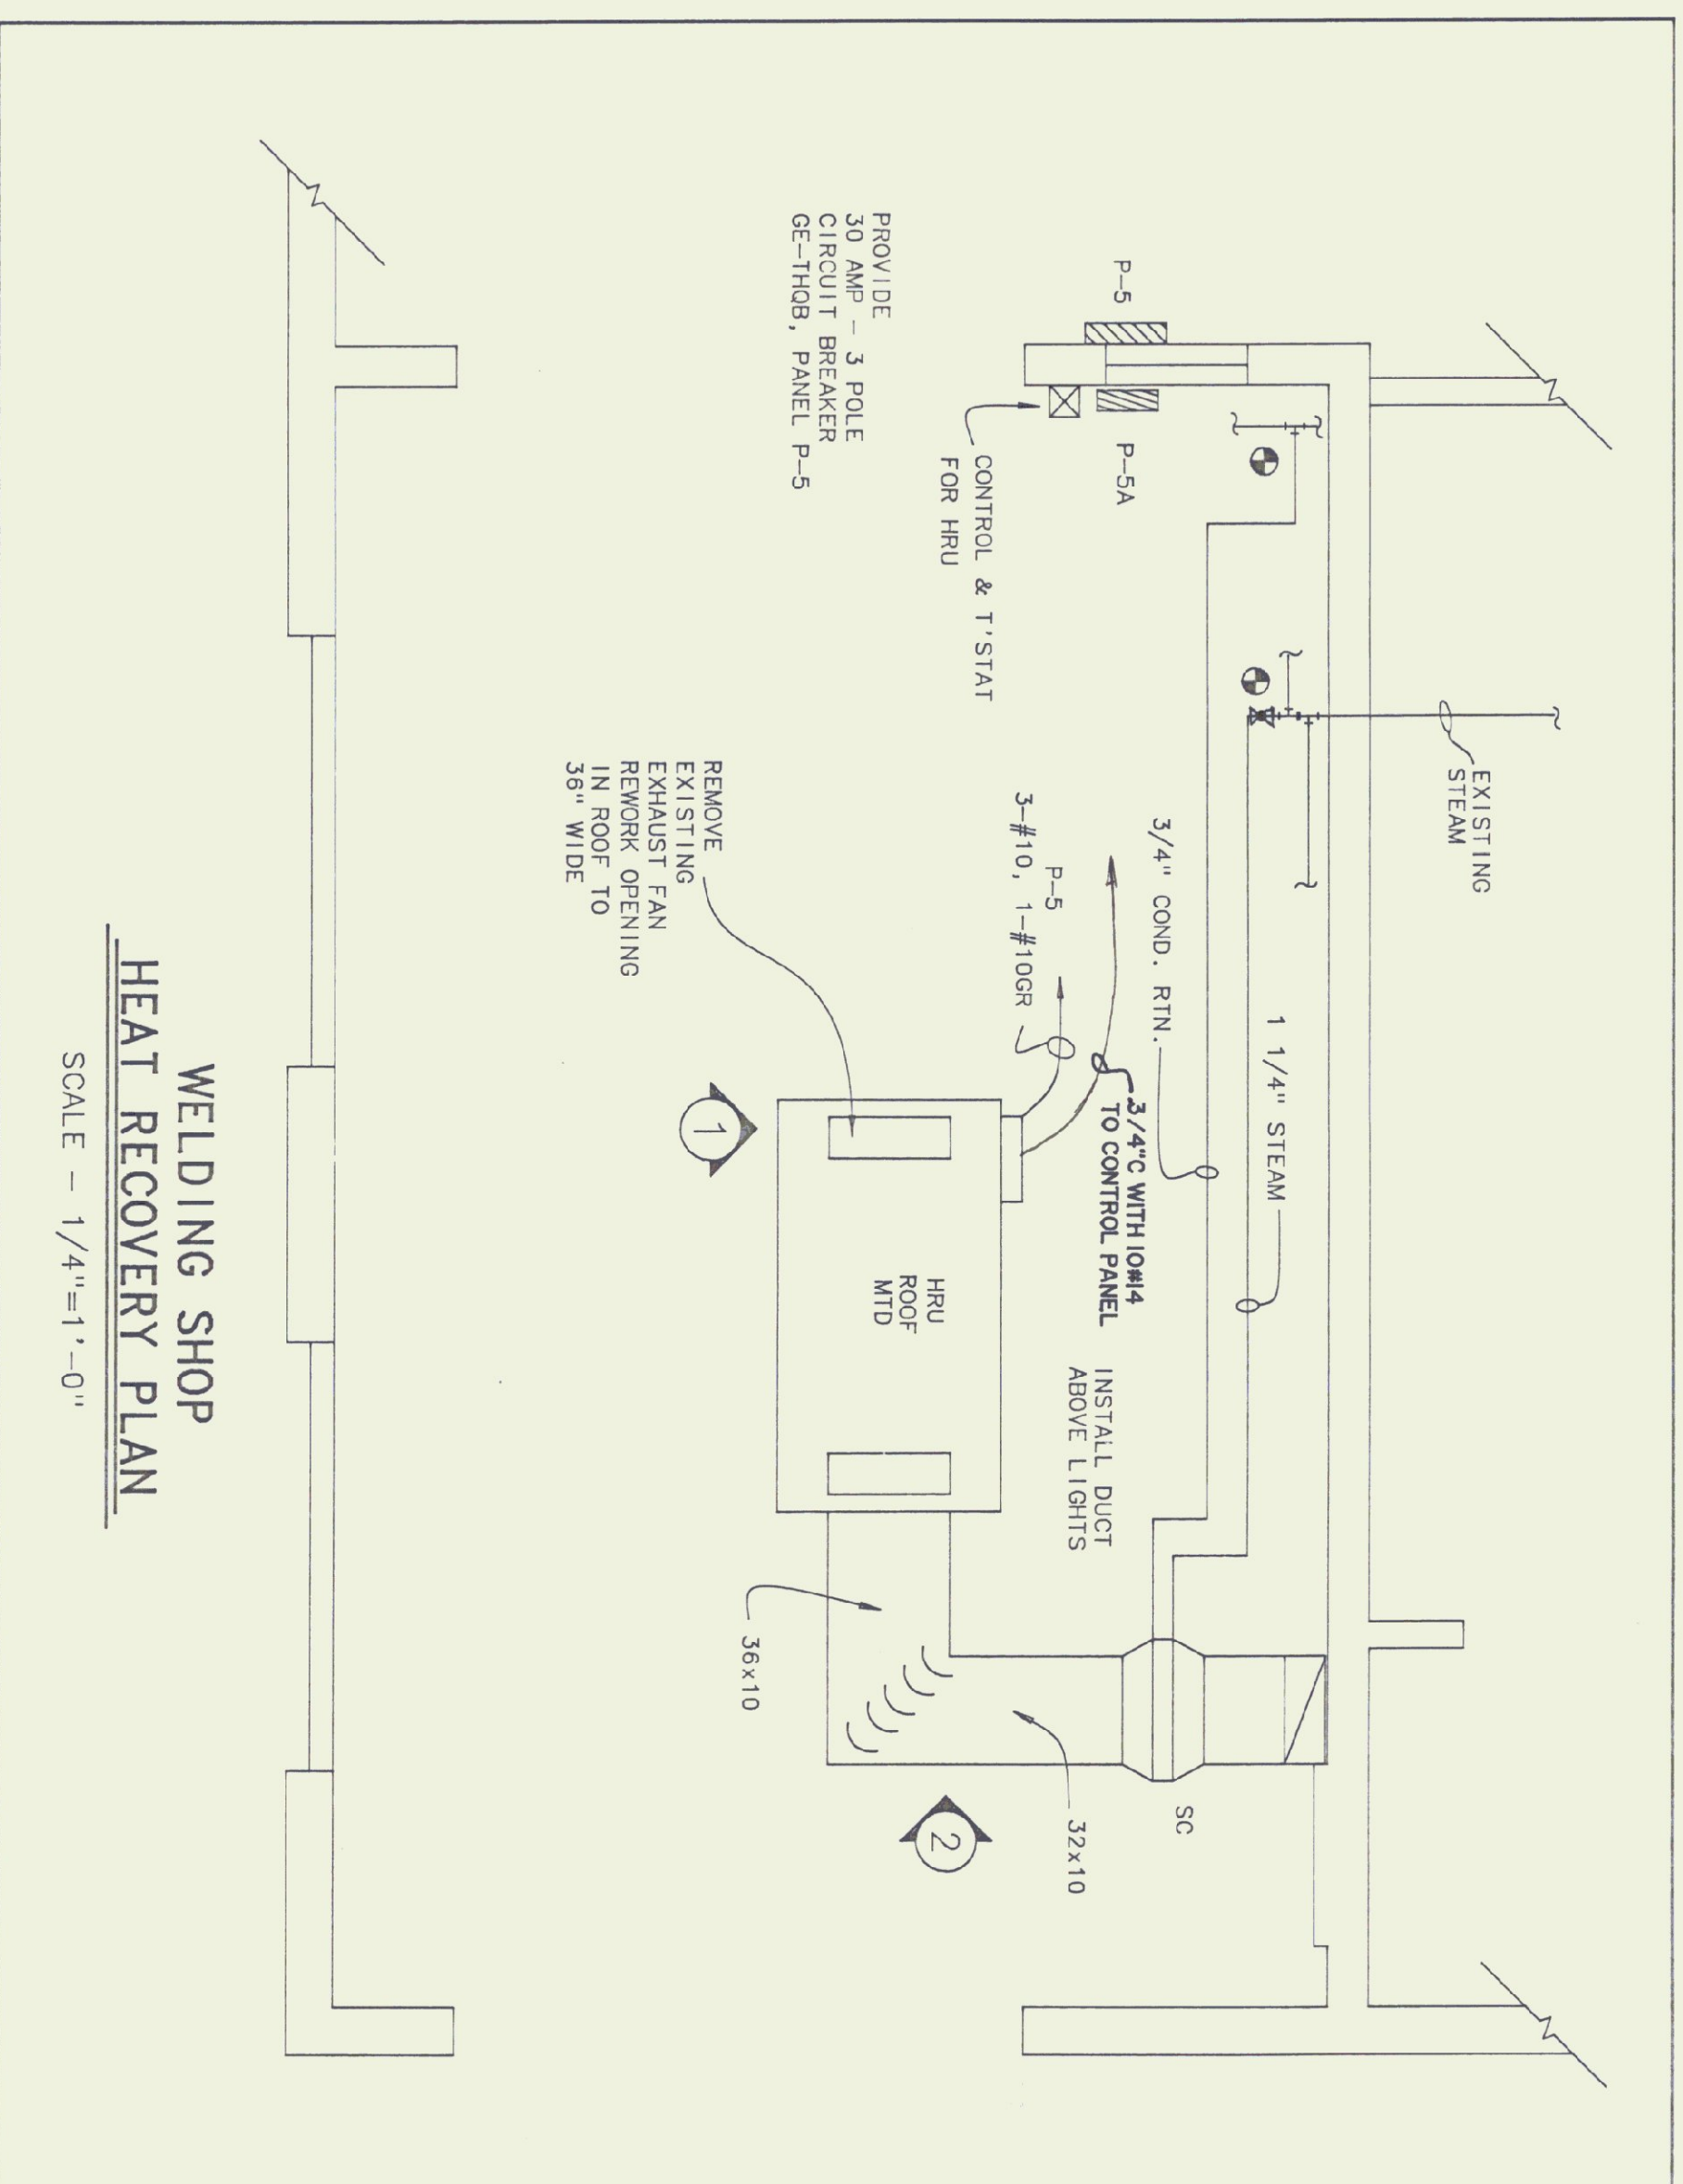
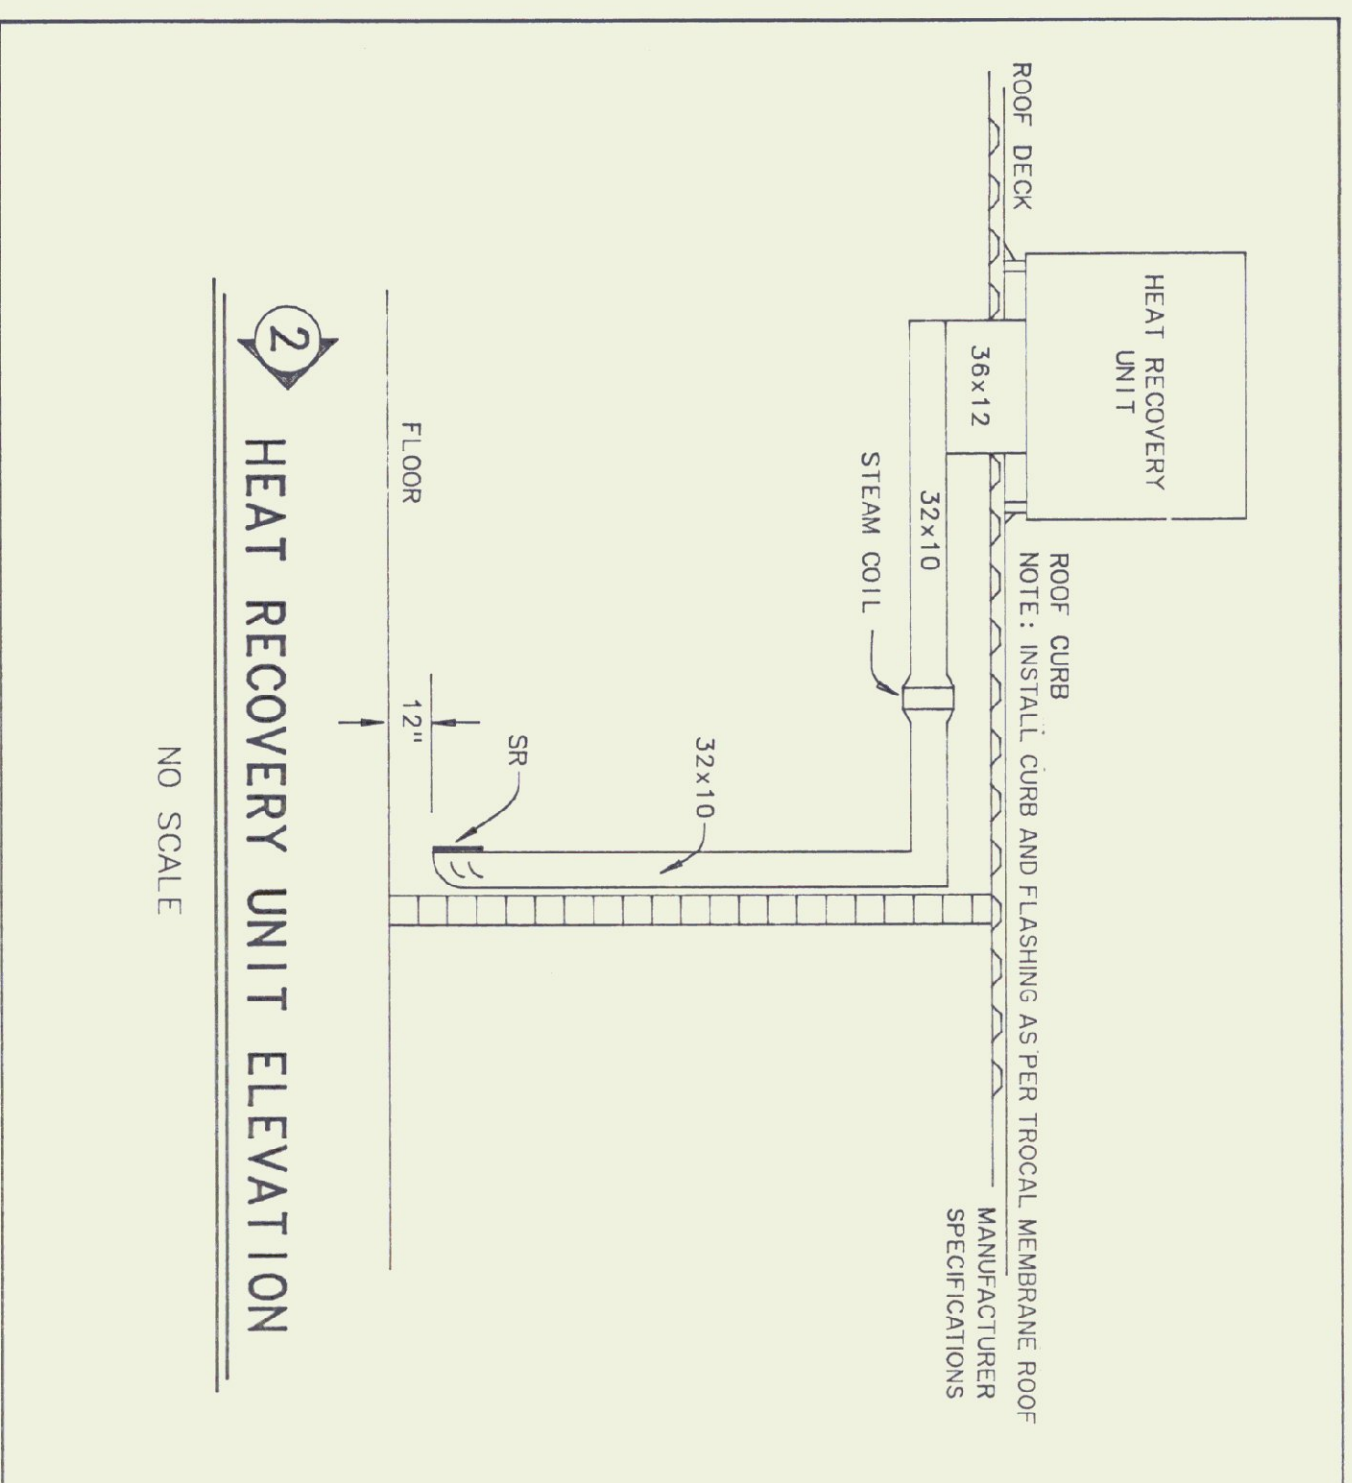
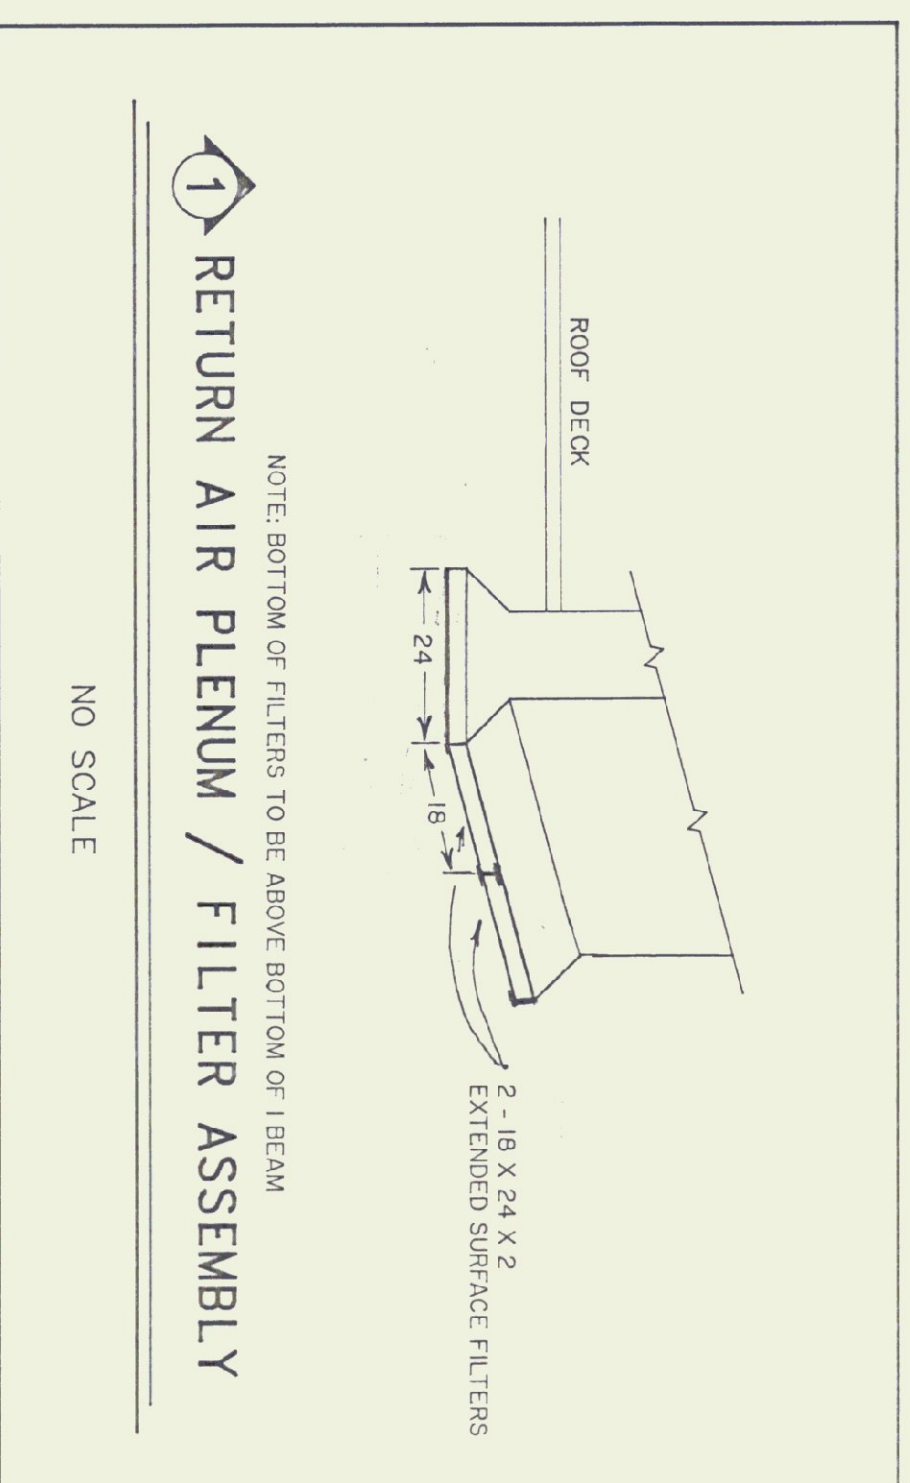


ITEM	DESCRIPTION
HRU	HEAT RECOVERY UNIT - 2,280 CFM SUPPLY AIR AT 7 ESP., 2 HP AT 208 VAC, 3 PHASE, 2,300 CFM RETURN AIR AT 6 ESP., 1.5 HP AT 208 VAC, 3 PHASE, MODULATING OUTSIDE AIR FACE AND BYPASS DAMPER, OUTSIDE AIR MOTORIZED SHUT OFF DAMPER, EXHAUST AIR GRAVITY BACKDRAFT DAMPER, FARRS 30030 SUPPLY AIR FILTERS, ROOF CURB, DES CHAMPS LABORATORIES INC. OR HEATEX
SC	STEAM COIL - EAT 40 DEGREES, LAT 95 DEGREES, CFM 2280, MAX., 10" P.D., STEAM AT 15 PSI
SR	SUPPLY REGISTER - METAL AIRE SERIES 4200, H45K, EXTRUDED ALUMINUM, SATIN FINISH, 1 1/2" WIDE AIR DEFLECTORS, 1 1/2" CENTERS, ADJUSTABLE DOUBLE DEFLECTION AIR EXTRACTOR, 30" W X 24" H

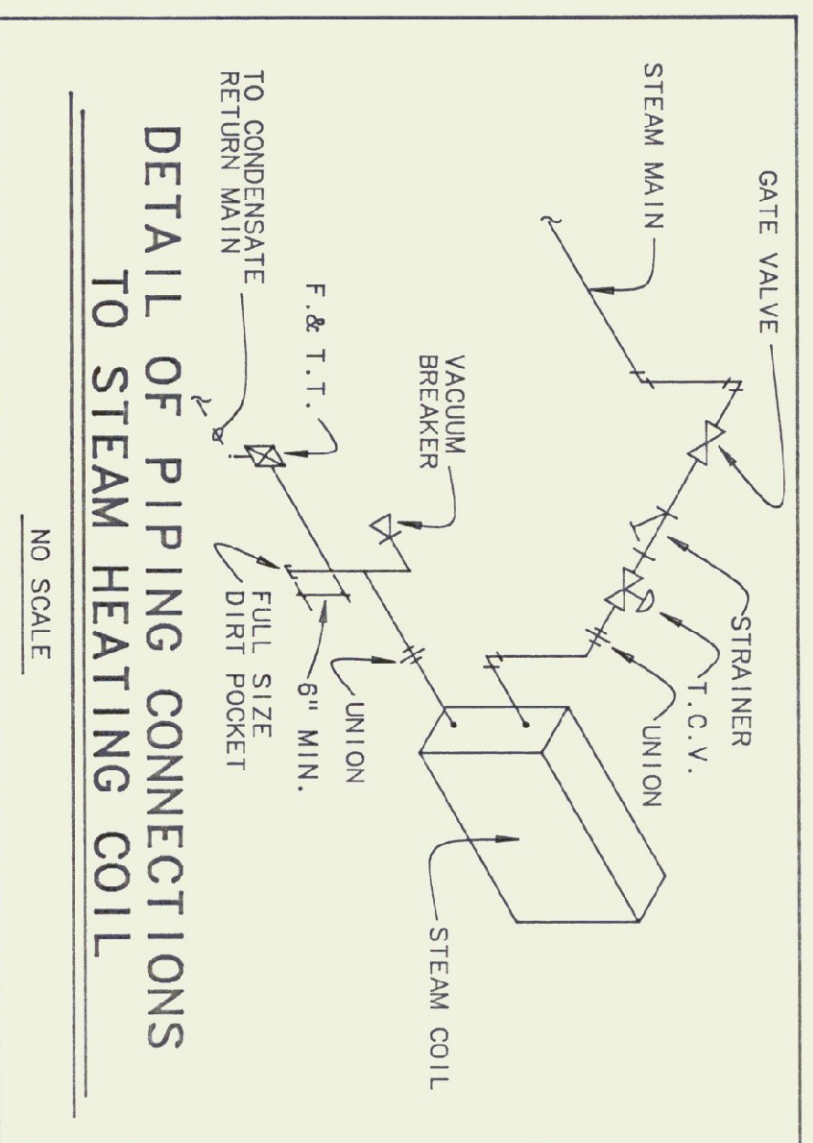

**Pearson & Associates**  
MECHANICAL & ELECTRICAL ENGINEERS  
P.O. BOX 610 STOWE, VERMONT 05672  
TEL. (802) 253-9607 FAX. (802) 253-9290

STATE OF VERMONT DEPARTMENT OF STATE BUILDINGS AGENCY OF ADMINISTRATION		VERMONT	
MONTPELLIER			
AGENCY OF TRANSPORTATION CENTRAL GARAGE BERLIN, VERMONT			
BARRE - MONTPELLIER ROAD			
WELDING SHOP VENTILATION			
DATE: 07/24/92	SCALE: AS SHOWN	REVISIONS:	CAD FILE: PSWELNDG
DRAWN BY: B.W.M.	APPROVED BY: [Signature]		SHEET: 1 OF 1
			DWG NO.: 1