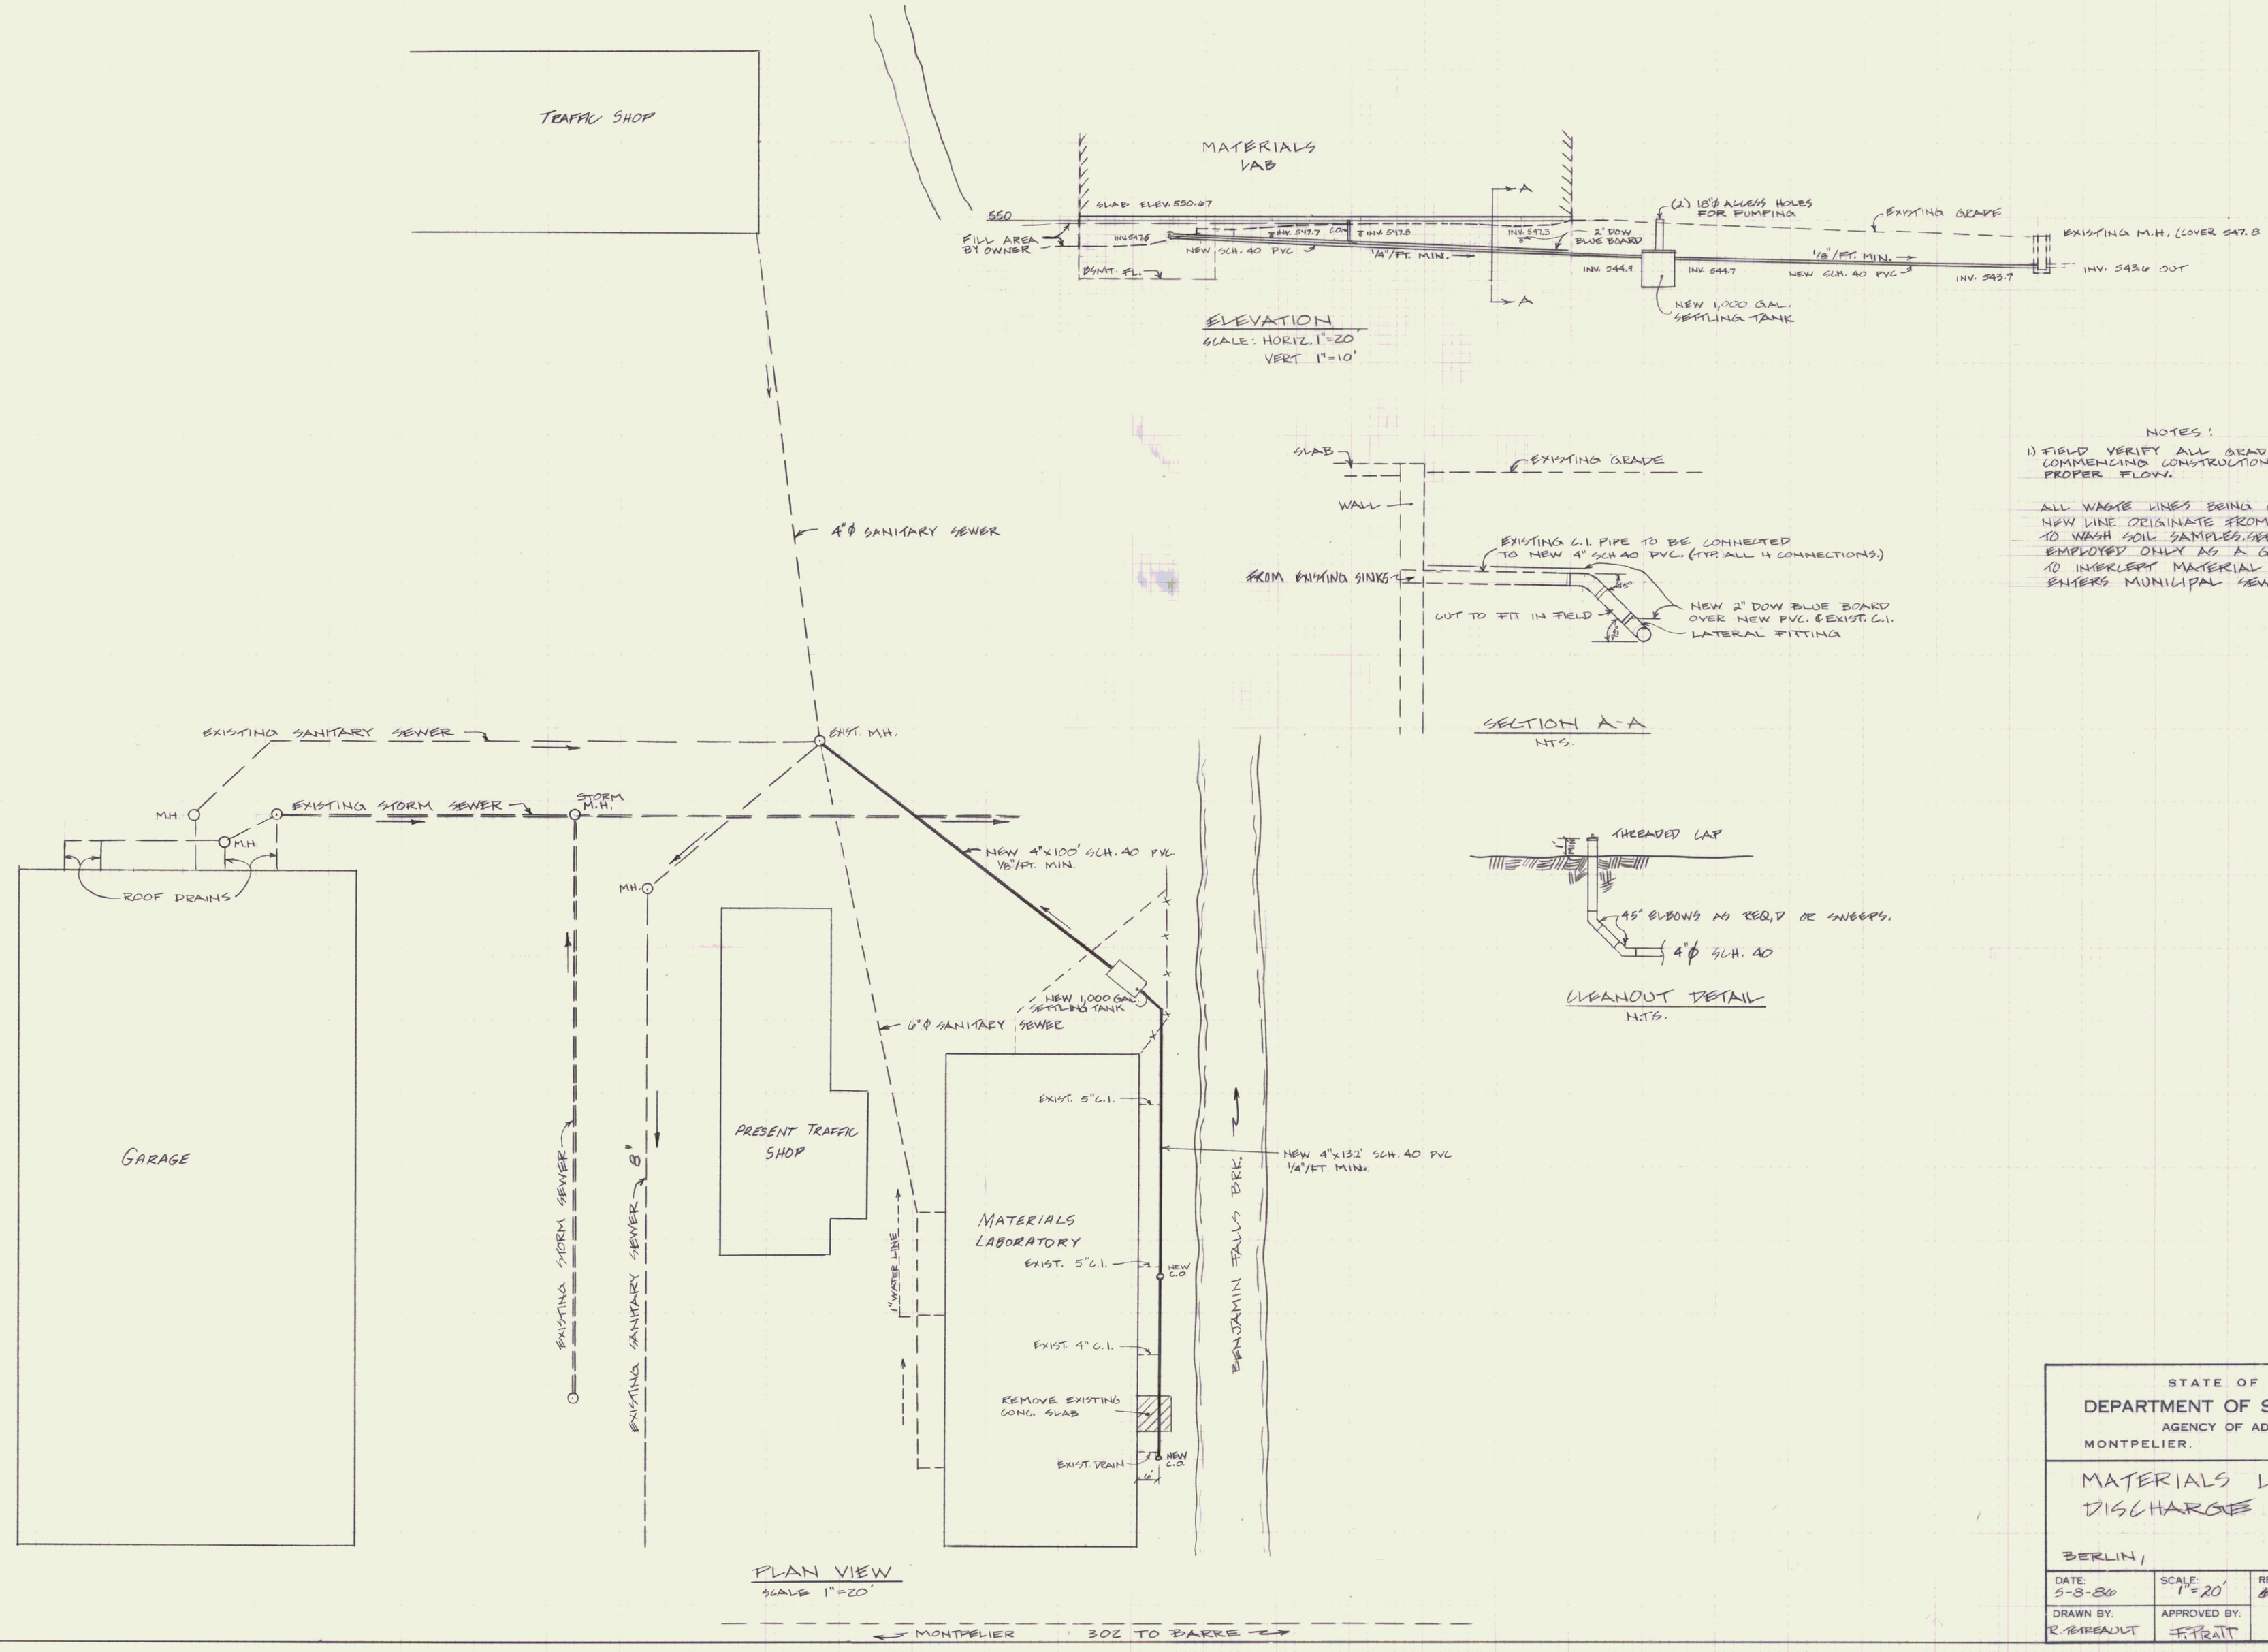

NOTES:

1) FIELD VERIFY ALL GRADES BEFORE COMMENCING CONSTRUCTION TO ASSURE PROPER FLOW.

ALL WASTE LINES BEING CONNECTED TO NEW LINE ORIGINATE FROM SINKS USED TO WASH SOIL SAMPLES. SEPTIC TANK IS EMPLOYED ONLY AS A GRIT CHAMBER TO INTERCEPT MATERIAL BEFORE IT ENTERS MUNICIPAL SEWER.

STATE OF VERMONT
DEPARTMENT OF STATE BUILDINGS
AGENCY OF ADMINISTRATION
MONTPELIER, VERMONT

MATERIALS LABORATORY
DISCHARGE PLAN

BERLIN, VERMONT

DATE:	SCALE:	REVISIONS:	DWG. NO.
5-8-86	1"=20'	8-11-86	5-1
DRAWN BY: R. BERREAULT	APPROVED BY: F. FIFRAIT		1 OF 1