

SITE PLAN
SCALE: 1" = 40'
CONTOUR INTERVAL = 2'


PERCOLATION TEST DATA - 8/22/79

P-1	2 MIN./INCH	35.0 DEEP
P-2	1 MIN./INCH	3.0 "
P-3	7 MIN./INCH	3.8 "
P-4	5 MIN./INCH	3.8 "


TEST PIT DATA -

0'-4.8'	Brown Silty Sand
4.8'-9.0'	Red Sandy Gravel, Moist
NO WATER TO DEPTH.	
NO LEAKS TO DEPTH.	


NOTE: Design based on water flow of 2.5 GPM per 100 SF. Seepage pit area (minimum) of one seepage pit = 178 SF.

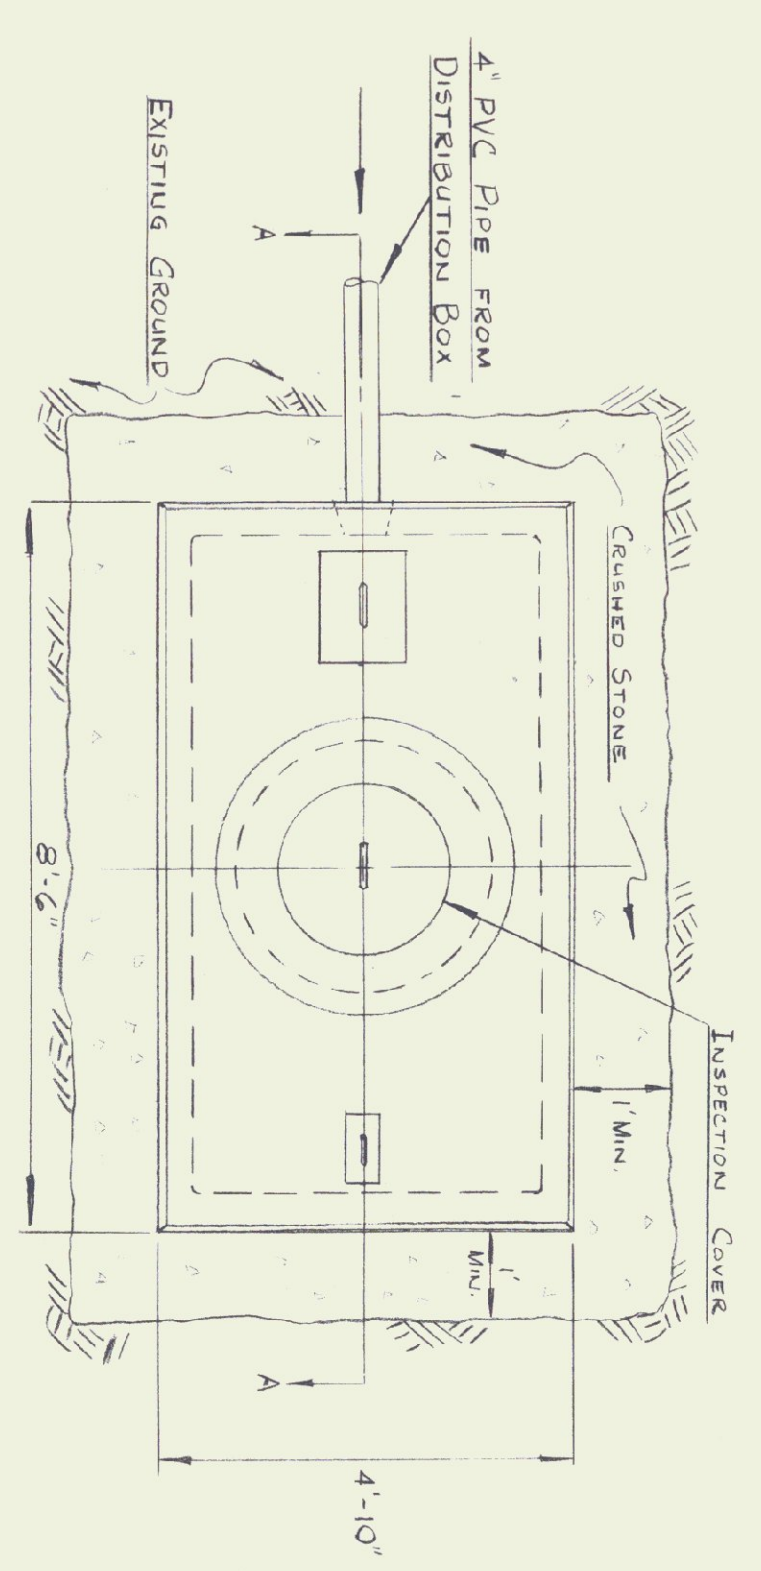

SEEPAGE PIT
TOP VIEW
N.T.S.

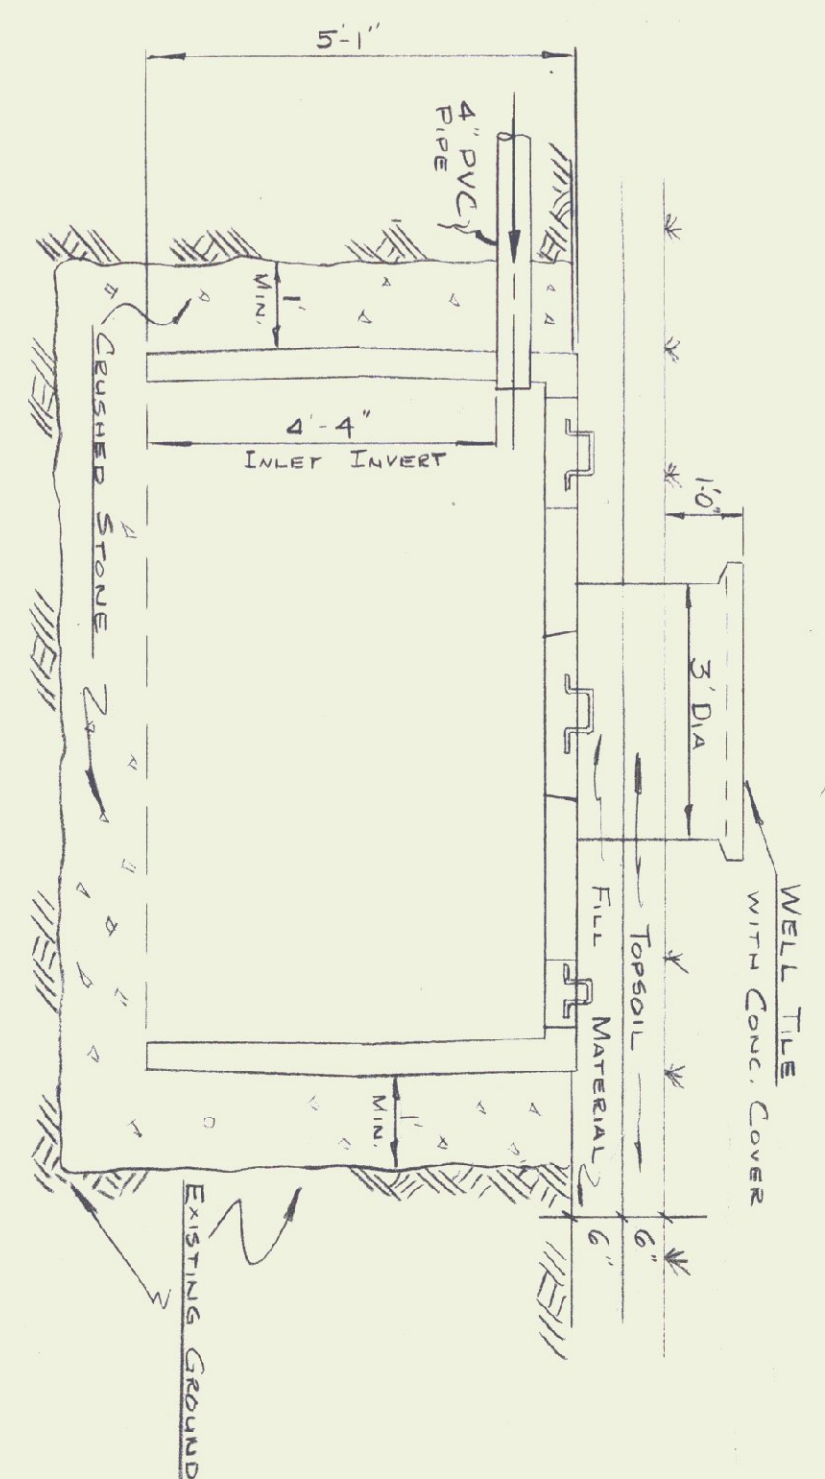

SEEPAGE PIT
SECTION A-A
N.T.S.

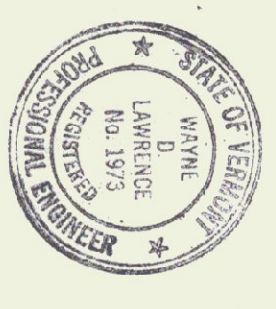

Note: U.S. ELEVATIONS NOTED OCT 11, 1979

JORDAN - MILTON MACH. INC. ROUTE 12 BERLIN, VERMONT		WAYNE D. LAWRENCE, P.E. BARRE, VERMONT	
DESIGN W/DL DRAWN/PMP		SCALE: NOTED SURVEY/ROA./SDL	
SITE PLAN		APPROVED W/DL DATE: SEP 1, 1979	

79067