



- NOTES
1. "DIPPER" DISTRIBUTION BOX TO BE BY UNITED CONCRETE PRODUCTS OR APPROVED EQUAL.
 2. PIPES IN LEACH BED TO SLOPE 1 INCH IN THE LENGTH OF THE LEACH LINE(7/8 IN.).
 3. USE 3/4" TO 1 1/2" CRUSHED STONE IN THE LEACH BED.

PLAN(SCHEMATIC)-LEACH BED
NOT TO SCALE

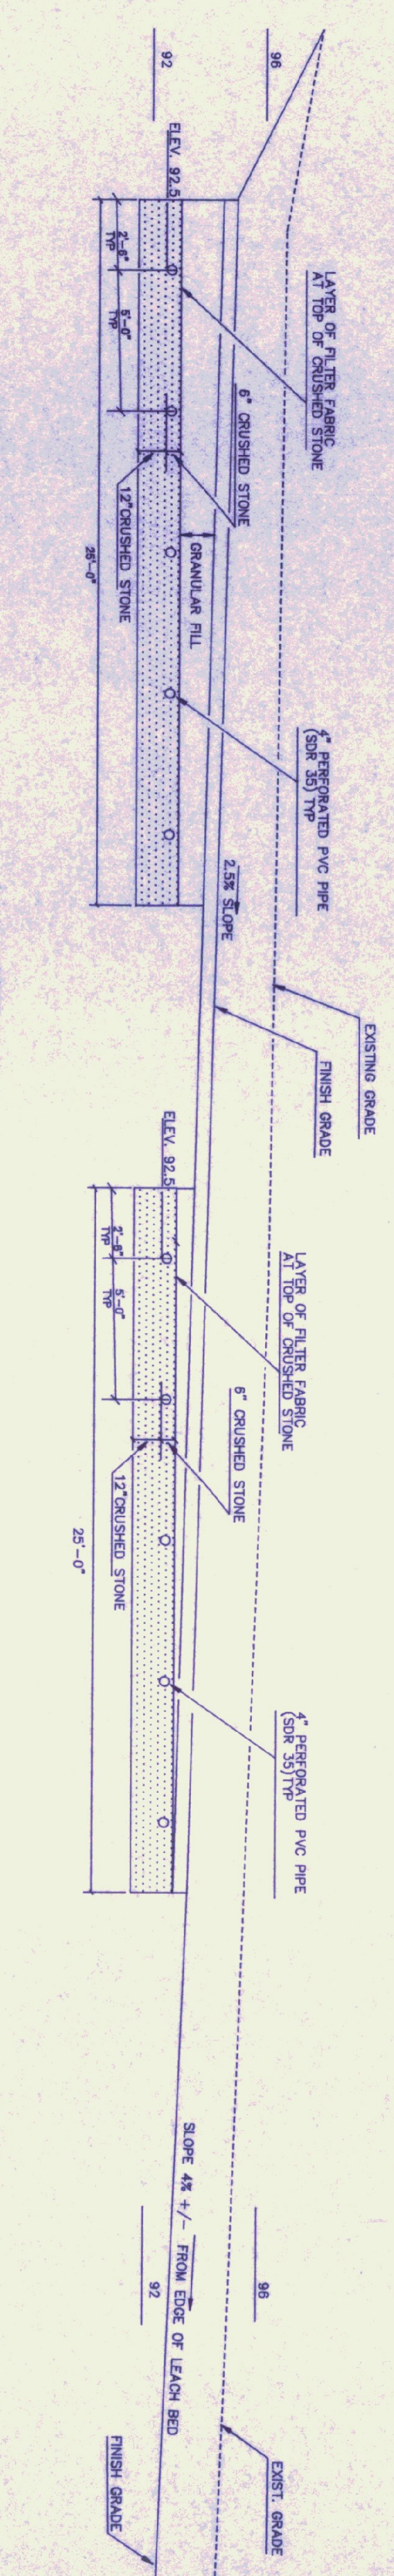


SECTION A-A
SCALE: 1/4"=1'-0"


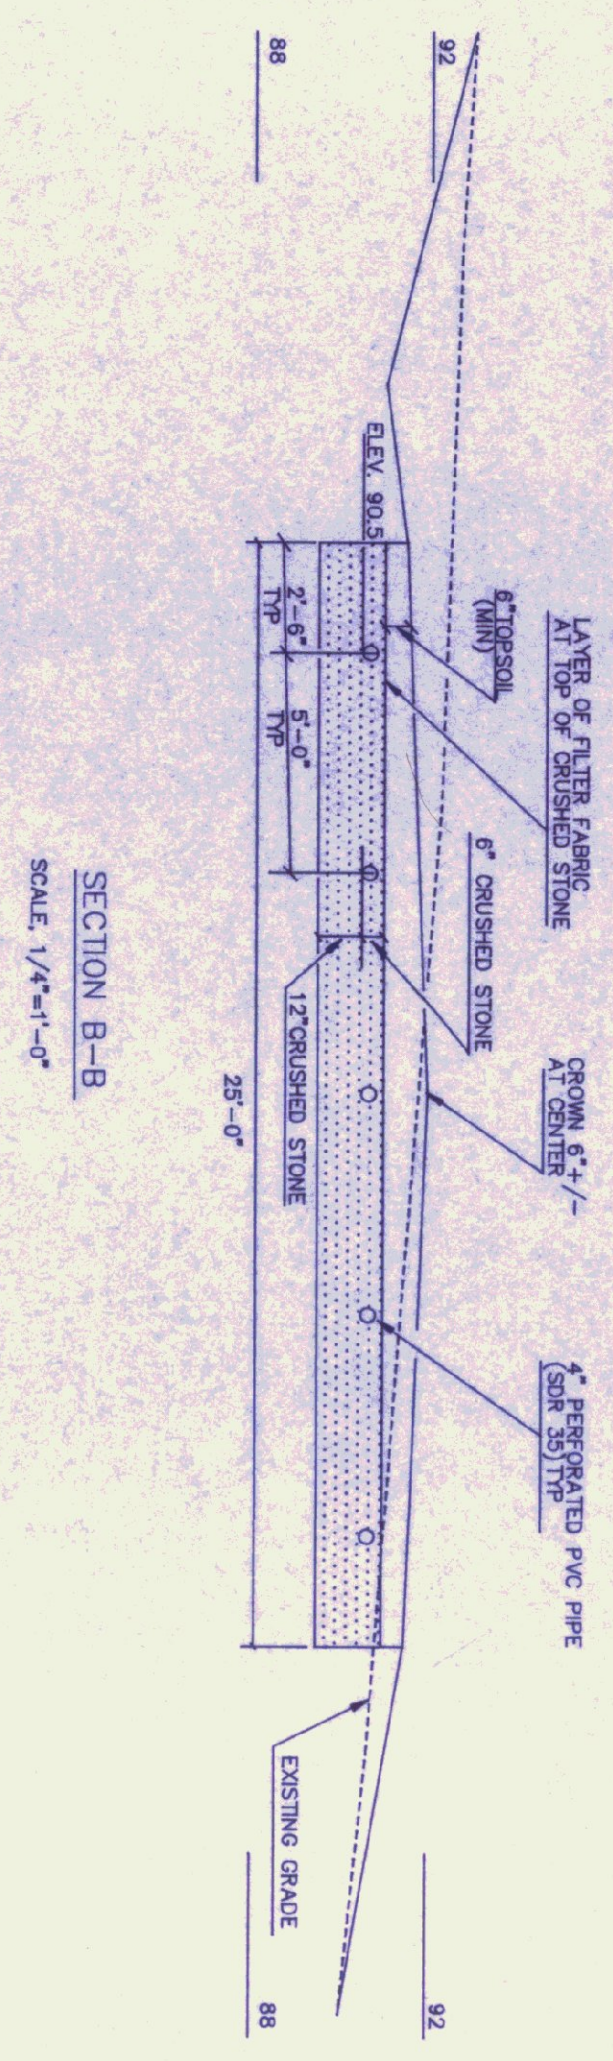


SECTION B-B
SCALE: 1/4"=1'-0"

SCHEMATIC-SEPTIC TANK ACCESS
N.T.S.

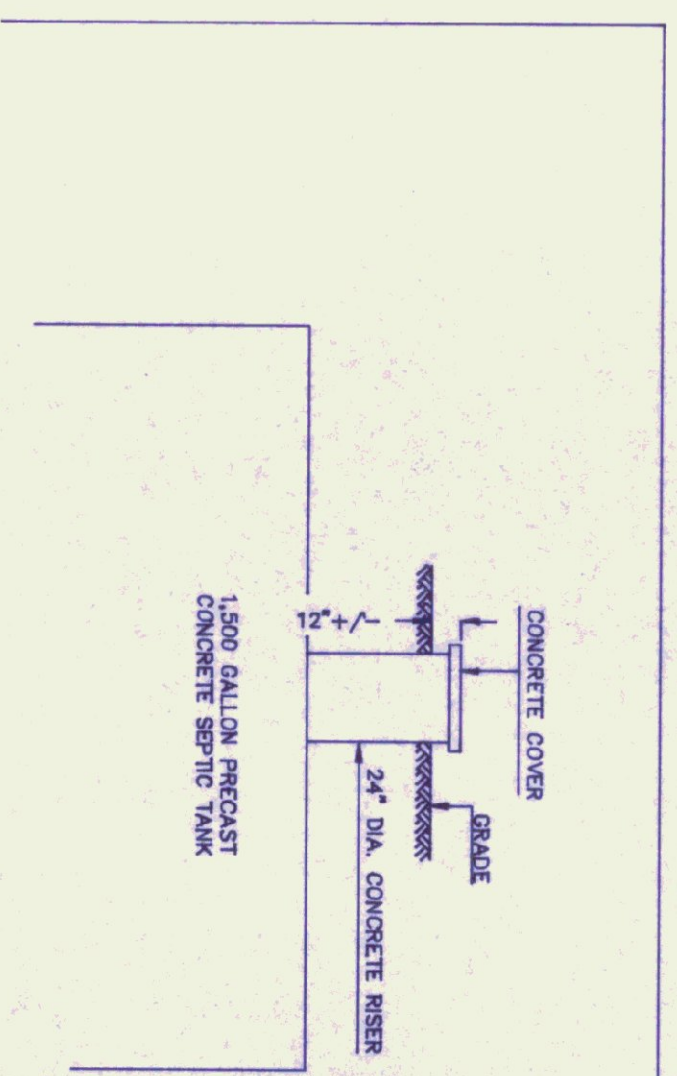

SECTION-OBSERVATION WELL
NOT TO SCALE

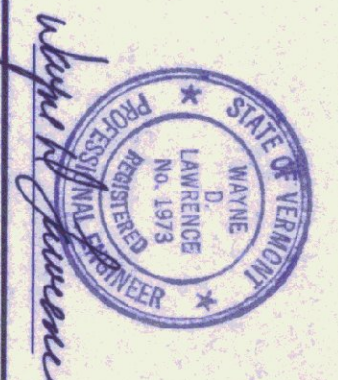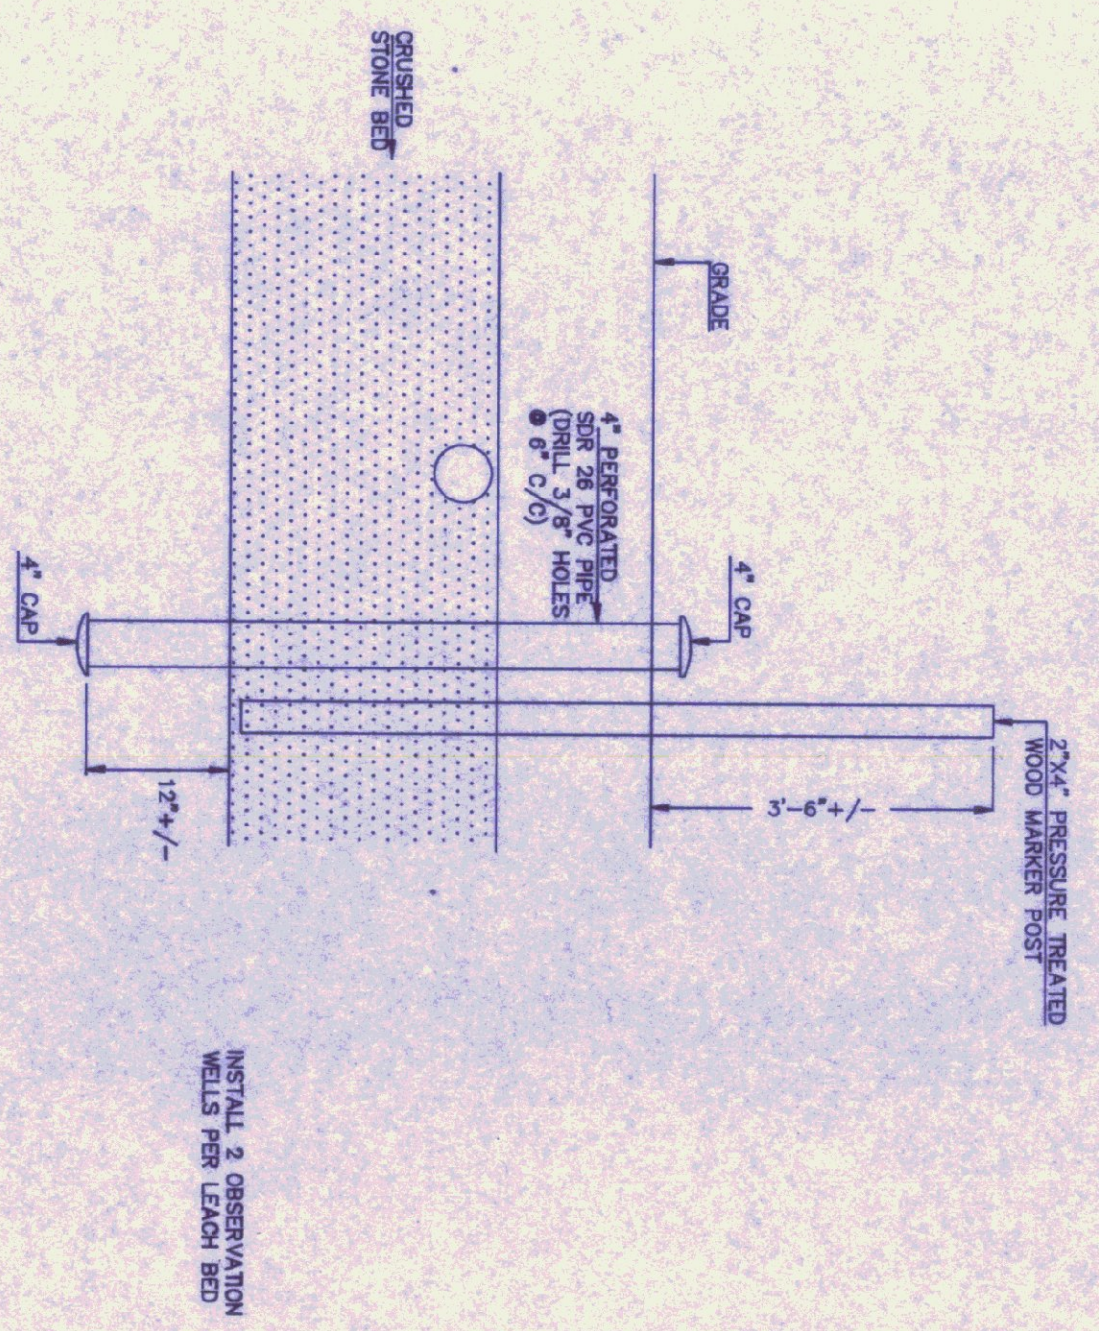

PROJECT NO. 30097	SHEET 2 OF 2	FILED IN 2-89
STATE OF VERMONT		WAYNE D. LAWRENCE, P.E.
SHARON I-89 REST AREA(S)		
SHARON, VERMONT		BARRE, VERMONT
SEPTIC SYSTEM DESIGN		
DESIGN: WDL	SCALE: AS NOTED	APPROVED: WDL
DRAWN: WDL	SUPVX: PSM/KAD	DATE: 11/20/90