FOR ELECTRICAL INSTALLATION NOTES
SEE DRAWING E1sb PROJECT NO. 10215.00
BY HALLAM ASSOCIATES

LIGHT POLE & LUMINAIRE
EXISTING LIGHTING (TYPICAL)

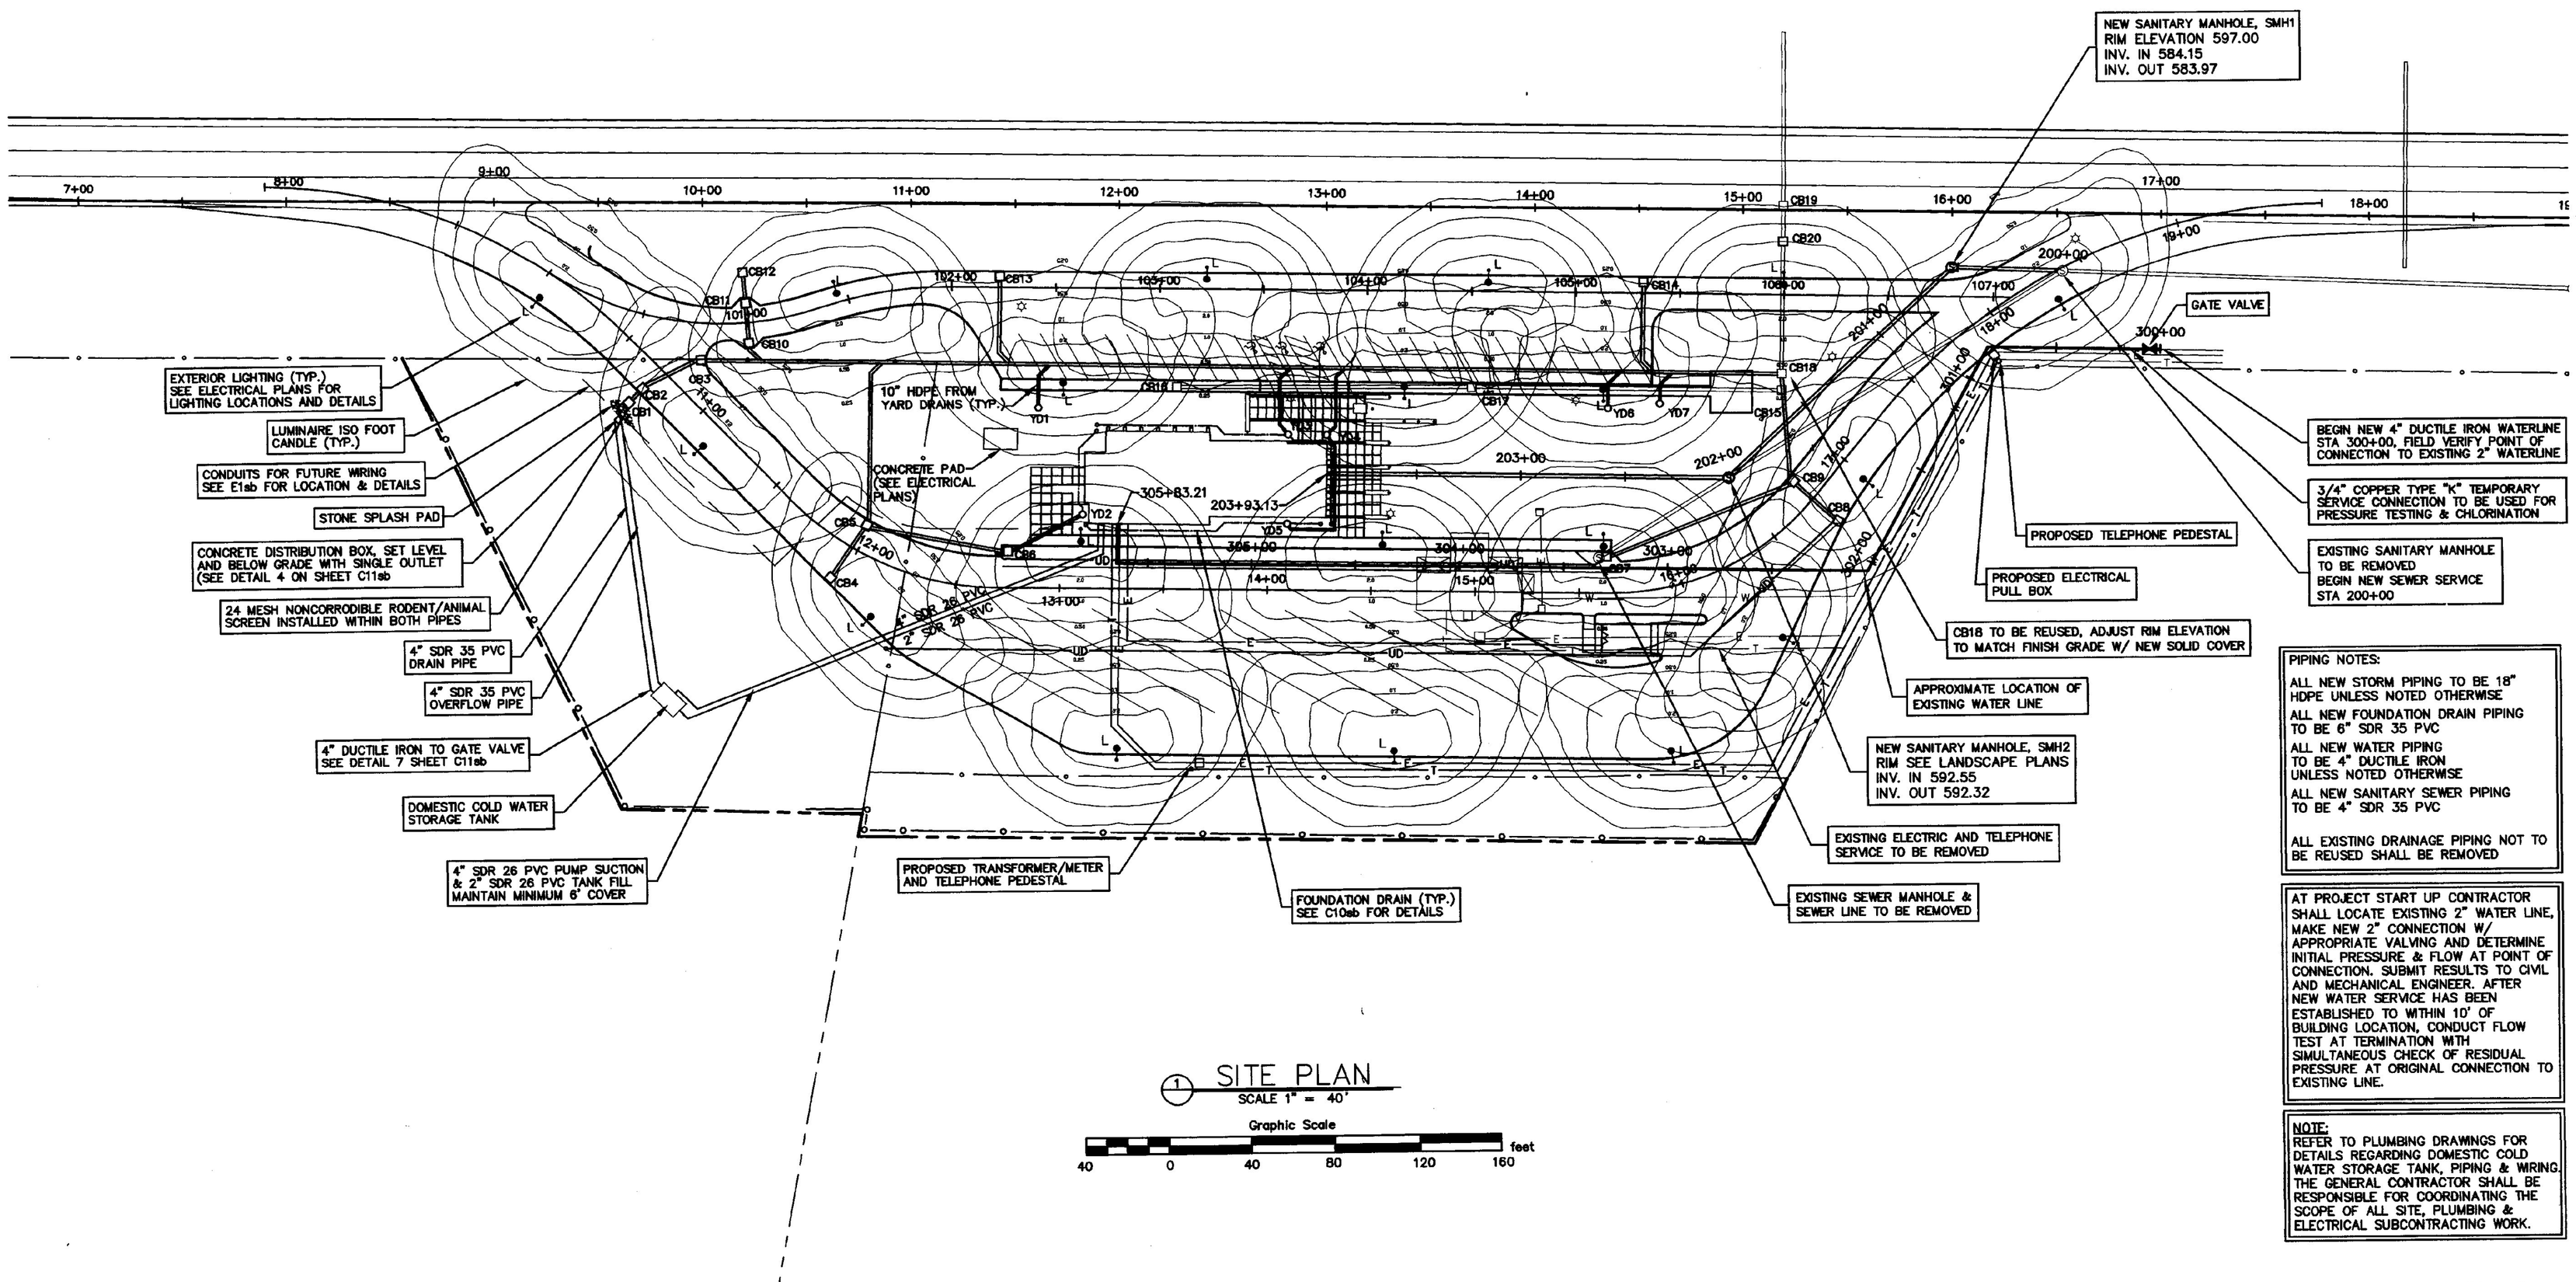

1 SITE PLAN
SCALE 1" = 40'

Graphic Scale
40 0 40 80 120 160 feet

PIPING NOTES:

ALL NEW STORM PIPING TO BE 18" HDPE UNLESS NOTED OTHERWISE

ALL NEW FOUNDATION DRAIN PIPING TO BE 6" SDR 35 PVC

ALL NEW WATER PIPING TO BE 4" DUCTILE IRON UNLESS NOTED OTHERWISE

ALL NEW SANITARY SEWER PIPING TO BE 4" SDR 35 PVC

ALL EXISTING DRAINAGE PIPING NOT TO BE REUSED SHALL BE REMOVED

AT PROJECT START UP CONTRACTOR SHALL LOCATE EXISTING 2" WATER LINE, MAKE NEW 2" CONNECTION W/ APPROPRIATE VALVING AND DETERMINE INITIAL PRESSURE & FLOW AT POINT OF CONNECTION. SUBMIT RESULTS TO CIVIL AND MECHANICAL ENGINEER. AFTER NEW WATER SERVICE HAS BEEN ESTABLISHED TO WITHIN 10' OF BUILDING LOCATION, CONDUCT FLOW TEST AT TERMINATION WITH SIMULTANEOUS CHECK OF RESIDUAL PRESSURE AT ORIGINAL CONNECTION TO EXISTING LINE.

NOTE:
REFER TO PLUMBING DRAWINGS FOR DETAILS REGARDING DOMESTIC COLD WATER STORAGE TANK, PIPING & WIRING. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE SCOPE OF ALL SITE, PLUMBING & ELECTRICAL SUBCONTRACTING WORK.

REVISIONS	BY

COPYRIGHT © 2001
CHAMPLAIN CONSULTING ENGINEERS
ALL RIGHTS RESERVED

CHAMPLAIN CONSULTING ENGINEERS
85 PRIM ROAD, P.O. BOX 453
COLCHESTER, VERMONT 05446
(802) 863-8060
(802) 864-1878 FAX

STATE OF VERMONT
PAUL DUCHESNEAU
No. 3567
PROFESSIONAL ENGINEER

INTERSTATE 89 SOUTHBOUND
WILLISTON INFORMATION CENTER
UTILITY PLAN
WILLISTON VERMONT
PROJECT # IM-BLDG(4)

DRAWN	CCE
CHECKED	PD
SCALE	1" = 40'
DATE	01/16/01
JOB NO.	93114
SHEET	C3sb

OF 19 SHEETS

CCE/MAC File: C:\SOX\PROJ\93114-S89\SB-33sheet.dwg Plotted: 2001-01-15 13:11:02