





REFER TO 1/2" SCALE DRAWING BELOW

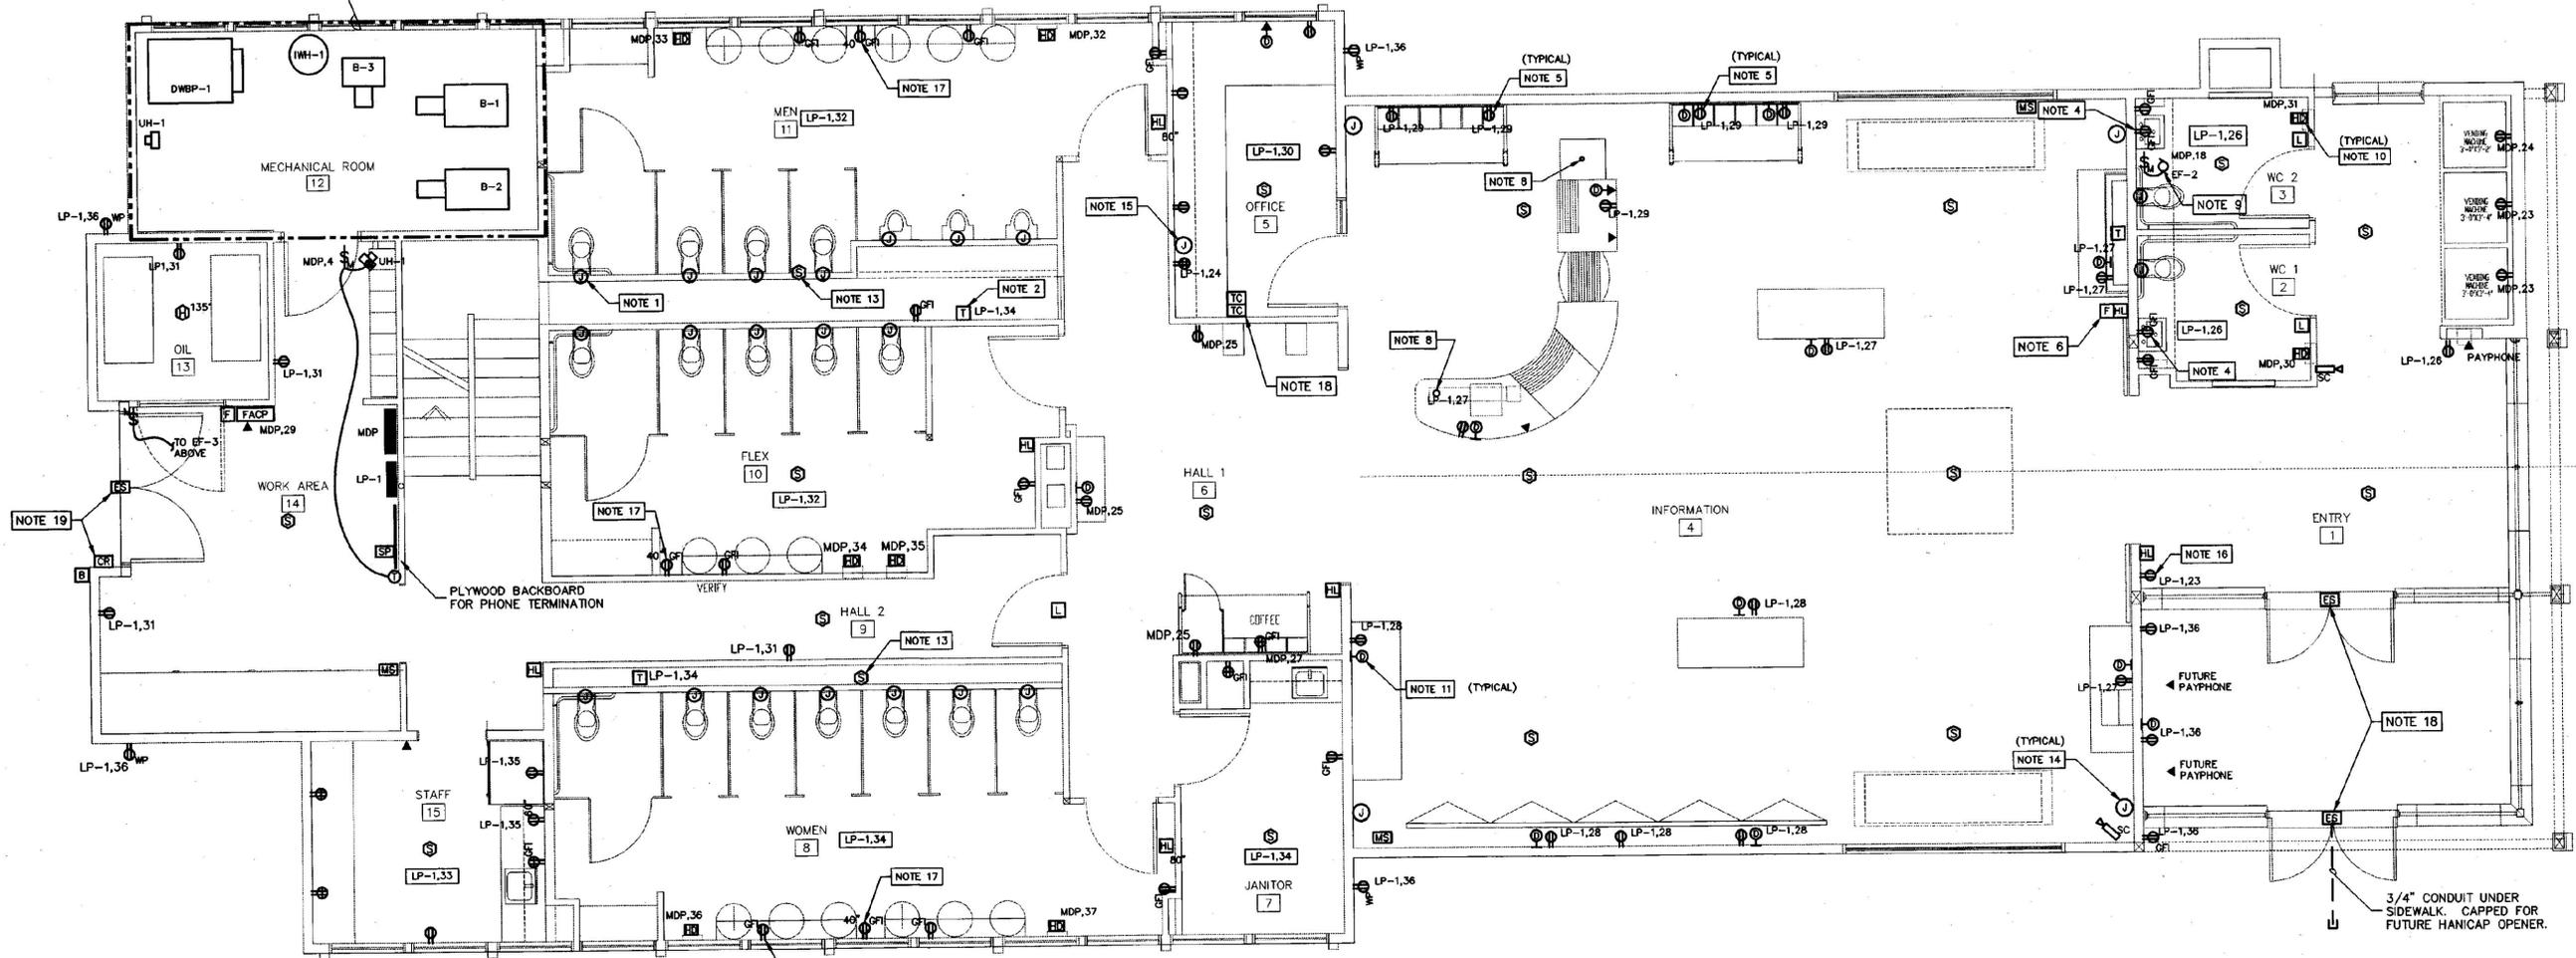

MAIN FLOOR POWER PLAN
SCALE: 1/4"=1'-0"

- NOTES:**
- FURNISH AND INSTALL 4" SQUARE x 2-1/8" DEEP OUTLET BOX WITH 4" SQUARE, 3/4" HIGH PLASTER RING. COORDINATE WITH PLUMBING LOCATION. TYPICAL FOR ALL J-BOXES SHOWN AT WATER CLOSETS AND URINALS. INFRARED SENSORS SHALL BE FURNISHED BY MECHANICAL CONTRACTOR AND INSTALLED AND WIRED BY ELECTRICAL CONTRACTOR.
 - FURNISH AND INSTALL 120VAC TO 24VAC TRANSFORMER, 100VA FOR INFRARED FLUSH CONTROL. TYPICAL FOR ALL TRANSFORMERS SHOWN ON THIS SHEET. REFER TO WIRING DIAGRAM ON E-7 FOR WIRING DETAILS.
 - FURNISH AND INSTALL JUNCTION BOX FOR CONTROL POWER.
 - FURNISH AND INSTALL RECEPTACLE FOR INFRARED SINKS. COORDINATE MOUNTING LOCATION WITH MECHANICAL CONTRACTOR. TYPICAL FOR ALL SINKS IN ROOMS 8, 10, 11, WC1 AND WC2.
 - COORDINATE LOCATION OF RECEPTACLES AND DATA OUTLETS MOUNTED BEHIND CABINETS IN THE FIELD WITH ARCHITECT.
 - PULL STATION SHALL HAVE PLASTIC COVER WITH LOCAL TAMPER RESISTANT ALARM.
 - FURNISH AND INSTALL BOILER SHUTOFF SWITCH WIRED TO CONTROL CIRCUIT FOR EACH BOILER.
 - ALL POWER AND COMMUNICATIONS WIRING SHALL BE INSTALLED WITHIN ARCHITECTURAL PEDESTALS FROM CRAWL SPACE BELOW.
 - EF-2 SHALL BE CONTROLLED BY OCCUPANCY SENSORS MOUNTED ON CEILING OF WC1 AND WC2. FAN SHALL BE WIRED SUCH THAT WHEN EITHER OCCUPANCY SENSOR IS ACTIVATED THE FAN SHALL RUN.
 - ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL HAND DRYERS IN LOCATIONS SHOWN. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND MOUNTING HEIGHT. REFER TO ELECTRICAL SPECS FOR MODEL.
 - AT ALL DATA AND TELEPHONE LOCATIONS, CONTRACTOR SHALL PROVIDE A 4" SQUARE DEVICE BOX WITH 3/4" CONDUIT TO CABLE MANAGEMENT IN CRAWL SPACE. CONTRACTOR SHALL PROVIDE ALL CABLING AND OUTLETS FOR THE PHONE SYSTEM PER SPECIFICATIONS. DATA CABLING SHALL BE DONE BY OWNER AT A LATER DATE. WHERE FUTURE PAY PHONES ARE SHOWN, PROVIDE BOX AND CONDUIT TO CRAWL SPACE ONLY.
 - FURNISH AND INSTALL FIROMATIC MOUNTED ABOVE EACH BOILER AND WIRED IN LINE WITH POWER TO BOILER.
 - SMOKE DETECTORS SHALL BE MOUNTED ON THE WALL NO LESS THAN 3' FROM THE CEILING.
 - FURNISH AND INSTALL 4" SQUARE DEVICE BOX WITH 3/4" CONDUIT TO THE CRAWL SPACE FOR FLUSH MOUNTED SPEAKERS, PROVIDED BY THE OWNER. COORDINATE LOCATION IN THE FIELD WITH THE OWNER.
 - FURNISH AND INSTALL 4" SQUARE DEVICE BOX WITH 1-1/4" CONDUIT TO CRAWL SPACE FOR SIGNAL AND CONTROL CABLING TO MONITOR, VCR AND JOYSTICK. COORDINATE LOCATION IN THE FIELD WITH ARCHITECT.
 - FURNISH AND INSTALL RECEPTACLE FOR PEOPLE COUNTING EQUIPMENT. PEOPLE COUNTING EQUIPMENT SHALL BE PROVIDED BY GENERAL CONTRACTOR.
 - COORDINATE LOCATION AND MOUNTING HEIGHT OF RECEPTACLES IN THE FIELD WITH ARCHITECT.
 - PROVIDE 3/4" CONDUIT AND WIRING FROM ELECTRICAL STRIKE ON DOOR INTO CRAWL SPACE AND TO TIME CLOCKS LOCATED IN OFFICE. PROVIDE (2) TIME CLOCKS TO CONTROL ELECTRIC STRIKES. USE TORK MODEL 1101 OR EQUAL. POWER TIME CLOCKS AND ELECTRIC STRIKES FROM PANEL LP-1, CIRCUIT 30.
 - PROVIDE 3/4" CONDUIT AND WIRING BETWEEN CARD READER AND ELECTRIC DOOR STRIKE. CARD READER TO BE INSTALLED BY DOOR VENDOR. POWER SYSTEM FROM PANEL LP-1, CIRCUIT 31.

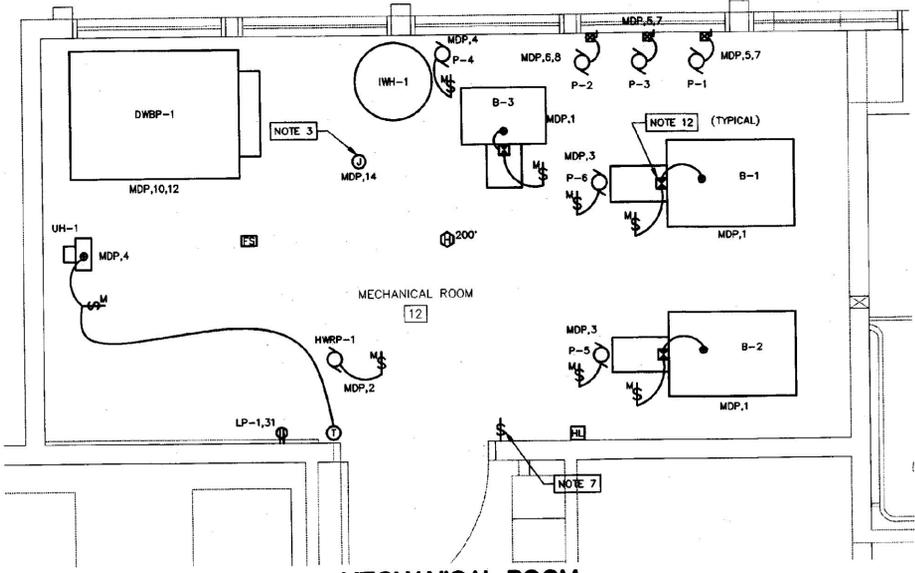

MECHANICAL ROOM
SCALE: 1/2"=1'-0"

C:\Drawings\10215000\North_Bound\E-4nb.dwg Tuesday, January 16, 2001 4:23:22 pm bpb

DUNCAN • WISNIEWSKI ARCHITECTURE
265 SOUTH CHAMPLAIN STREET, BURLINGTON, VERMONT 05401 (802) 864-0883

Halam Associates
80 Farrell Street, Suite 300
So. Burlington, Vermont 05403
(802) 669-4691

WILLISTON INFORMATION CENTER
189 NORTHBOUND
STATE PROJECT # IM-BLDG (4)

MAIN FLOOR POWER PLAN

DRAWN: LCS
CHECKED: BPB
PROJ.No: 10215
DATE: JAN 15, 2001

E-4nb