CODE	TIME	BY

GENERAL NOTES:

RIGID INSULATION IS TO BE 2 OR MORE LAYERS OF "THERMAX" SHEATHING MANUFACTURED BY THE CELOTEX CORP. OR OTHER MATERIAL OF EQUIVALENT FIRE RATING AND R-VALUE PER INCH. INSULATION PROVIDED BY OTHERS.

TOTAL THICKNESS TO BE 4" OR AS REQUIRED TO COMPLY WITH LOCAL ENERGY CODES. 1st LAYER OF INSULATION TO HAVE ALL SEAMS SEALED WITH ALUMINUM FOIL TAPE, OR INSTALL A VAPOR BARRIER UNDER FIRST LAYER OF INSULATION.

INSULATION STOPS, RIDGE NAILERS, ROOF FILLERS, AND FLY RAFTERS ARE SIZED BASED ON THE USE OF 4" OF RIGID INSULATION IN THE DOUBLE ROOF. SIZES SHOWN ON THIS AND OTHER DETAILS MAY NOT BE ADEQUATE IF MORE THAN 4" OF INSULATION IS TO BE USED. NOTIFY YOUR SALES REP. WELL IN ADVANCE OF DELIVERY IF YOU PLAN TO INSTALL MORE THAN 4" THICKNESS OF INSULATION IN THE DOUBLE ROOF SYSTEM.

REFER TO SHEETS C, C-1, & C-2 (C-4 IF APPLICABLE) FOR MORE INFORMATION ON ROOF CONSTRUCTION.

DETAILS ON THIS SHEET ARE GENERAL AND MAY NOT APPLY TO ALL BUILDINGS.

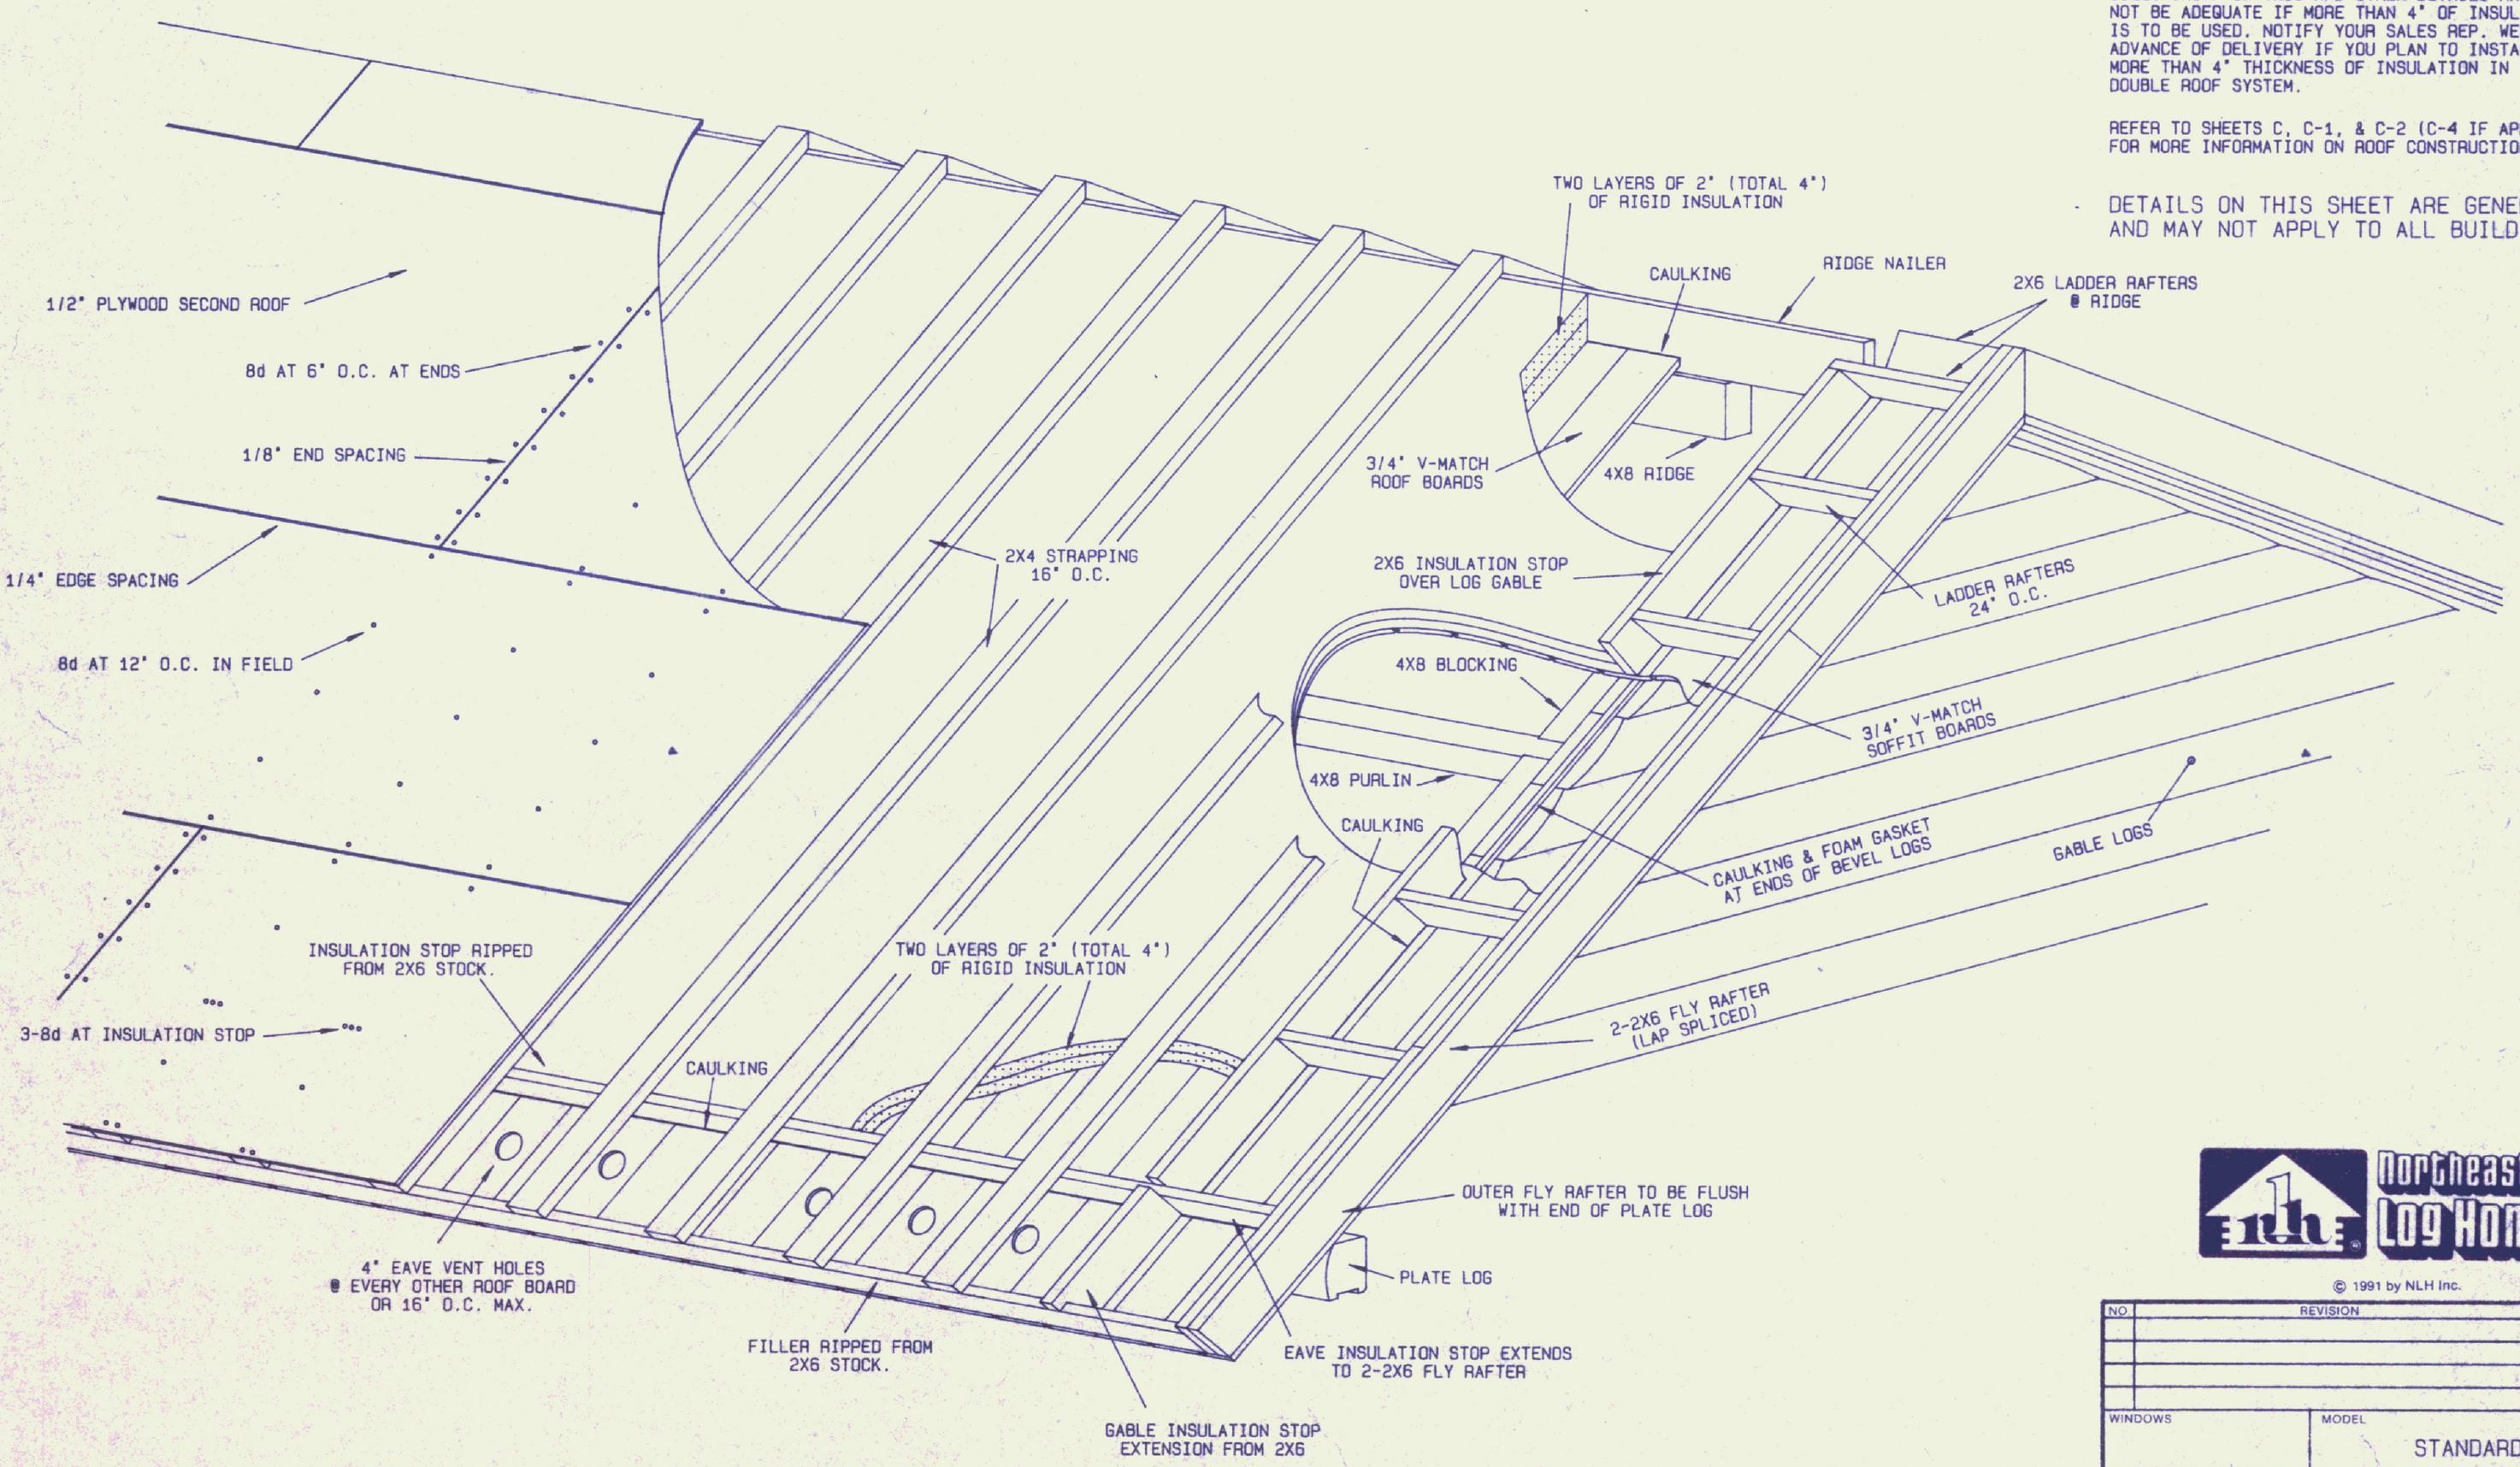

TYPICAL DOUBLE ROOF DETAIL (1 / C-3)

Northeastern Log Homes

© 1991 by NLH Inc.

NO.	REVISION	DATE	BY	CKD

WINDOWS	MODEL: STANDARD DETAILS D-96
DRN: ZR	CODES
CKD: SRP	
PROJECT NAME: DOUBLE ROOF CONSTRUCTION	
DATE: JAN. 1, 1995	PLAN NO: NE
SCALE: NOT TO SCALE	SHT NO: C-3

BRUNING 7819 FOAM # 5286