
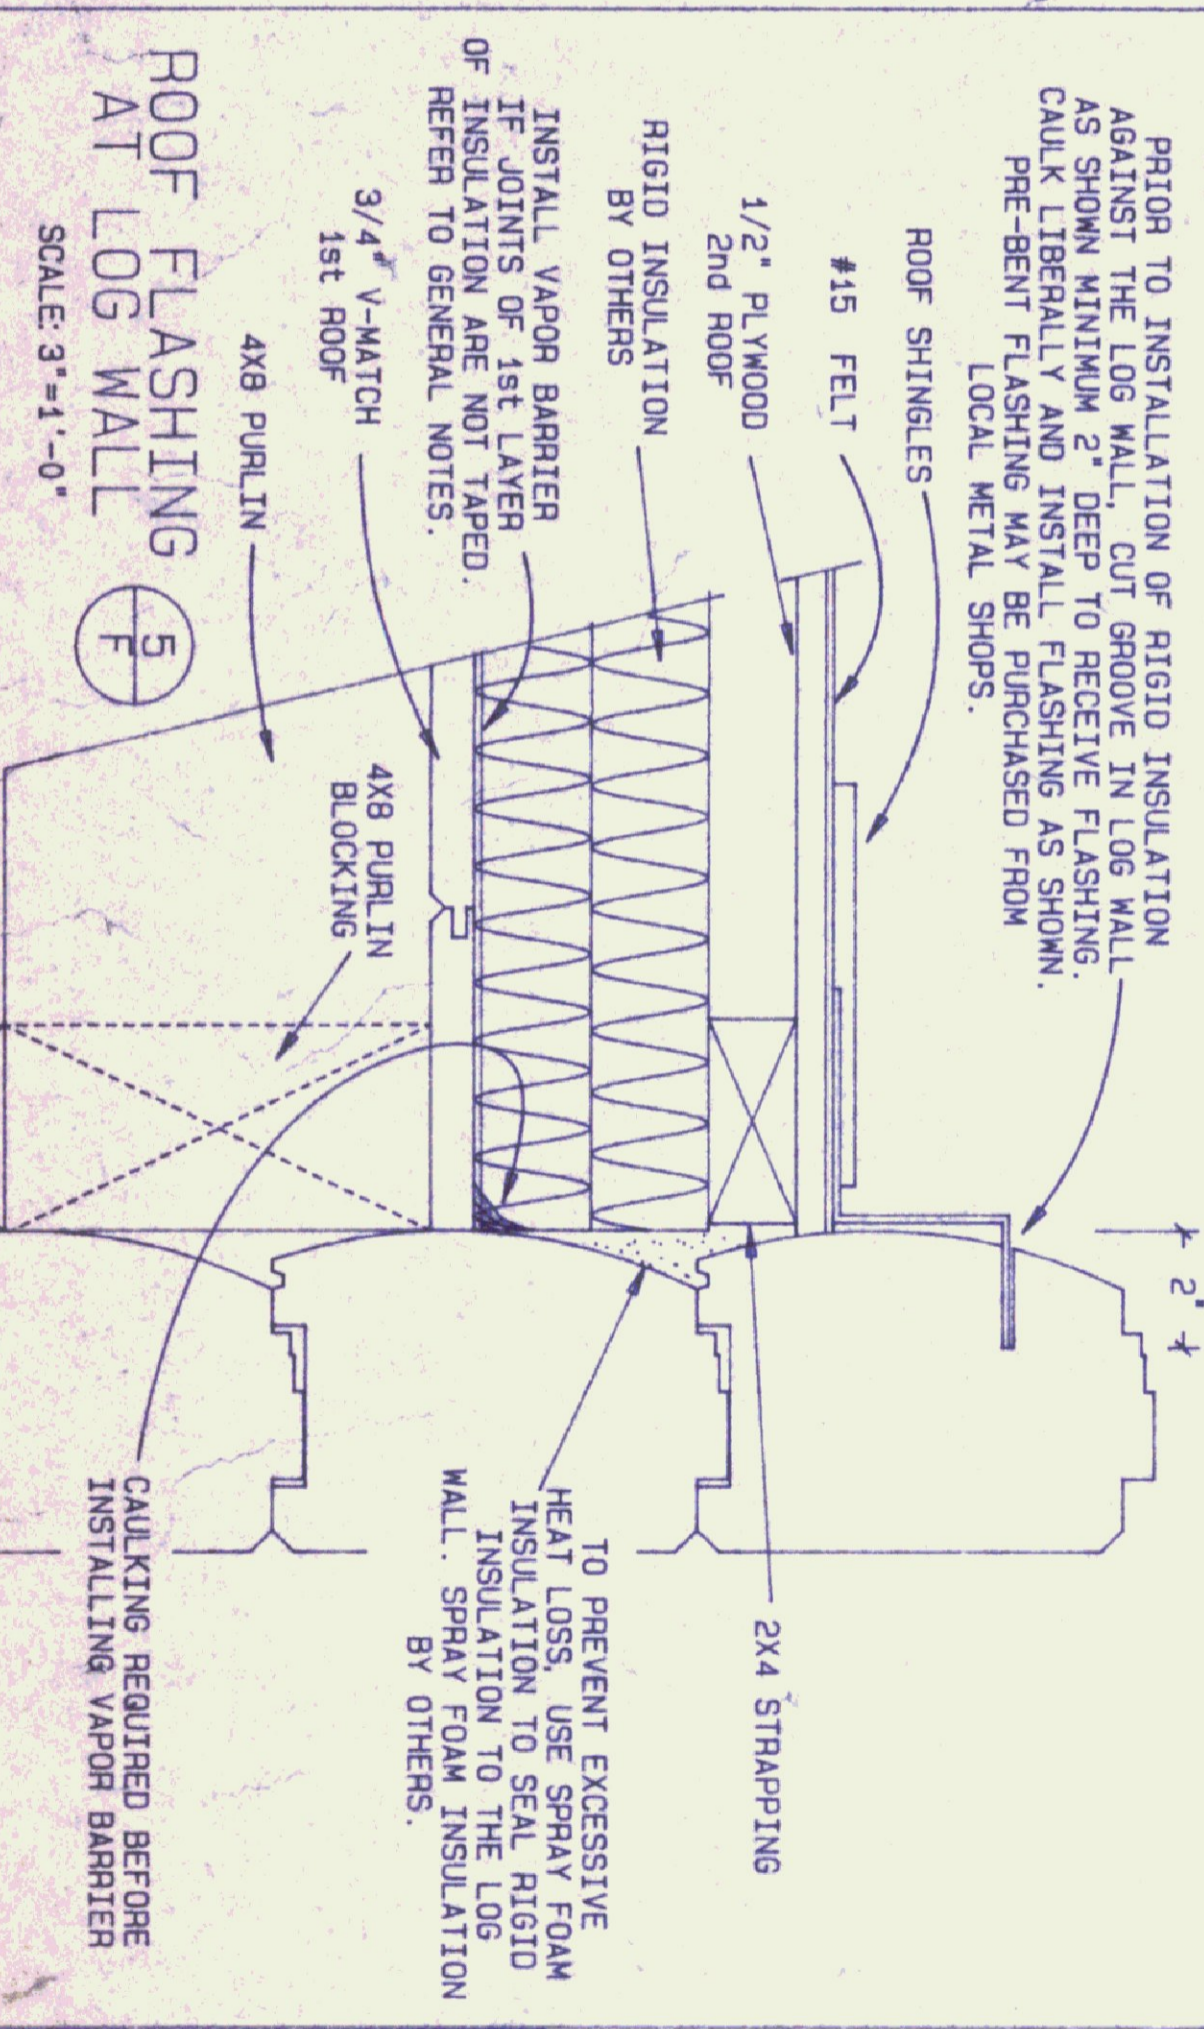


GENERAL NOTES

EXTENDED OUTER HEADERS NOT REQ'D IF 4X8 PURLIN HEADERS ARE USED ON BOTH SIDES OF OPENING

MAINTAIN A MINIMUM 4" CLEARANCE BETWEEN THE ROOF STRAPPING & DOUBLE HEADER AROUND THE ROOF OPENING. THIS WILL ALLOW FREE FLOW OF AIR AROUND THE OPENING.

IF A 4X8 ROOF PURLIN MUST BE NOTCHED OR REMOVED TO MAINTAIN A 2" CLEARANCE AROUND CHIMNEY, 4X8 PURLIN HEADERS MAY BE REQ'D FOR PROPER STRUCTURAL SUPPORT. CONSULT YOUR N.L.H. SALES REP.

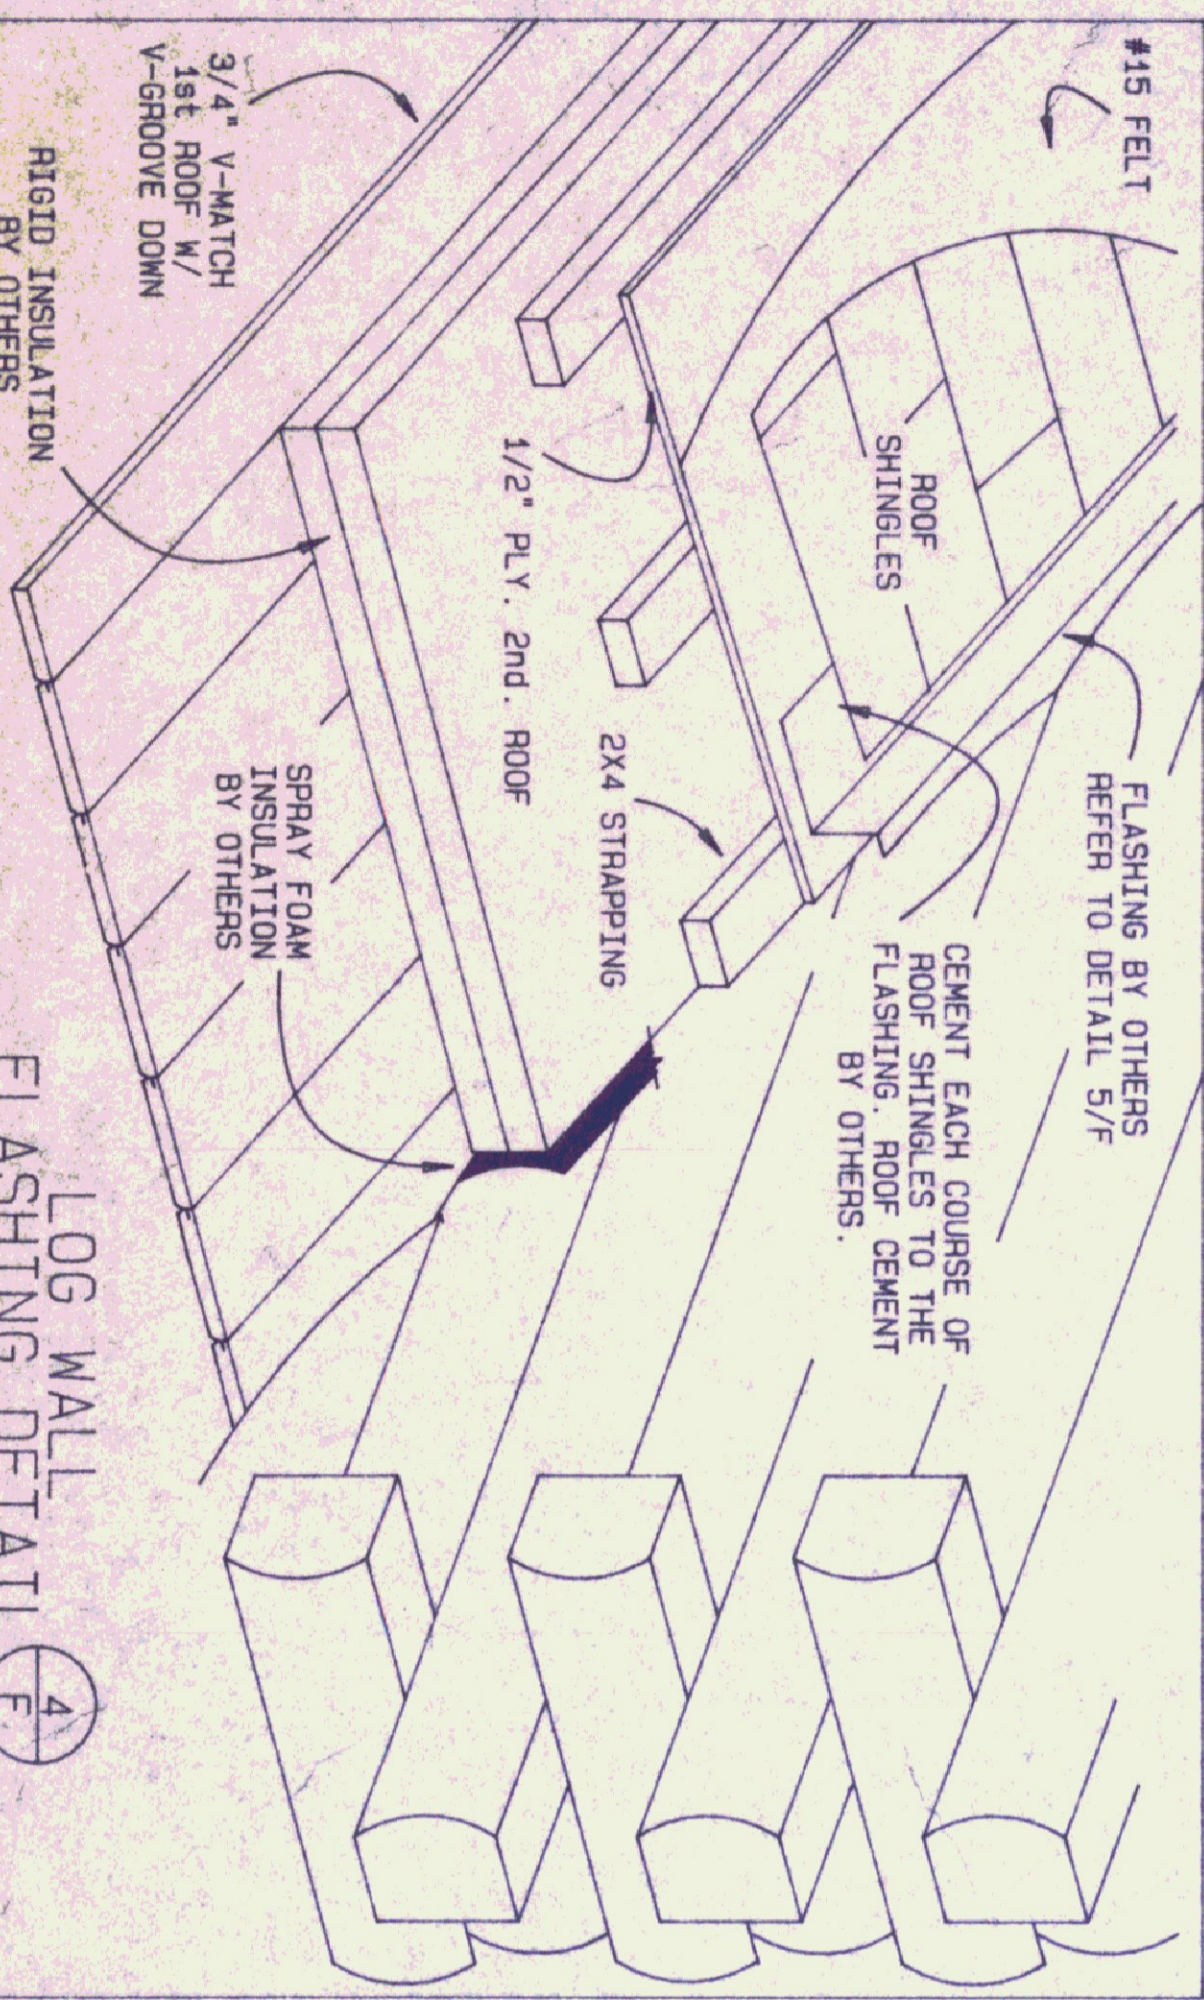

GENERAL NOTES:

PURLIN HEADERS AND HANGERS MUST BE INSTALLED BEFORE 3/4" V-MATCH 1st ROOF BOARDS. MIN. 4" AIRSPACE MUST BE MAINTAINED AROUND ANY OPENING THROUGH THE DOUBLE ROOF SYSTEM TO ALLOW FOR PROPER VENTING.

DO NOT REMOVE MORE THAN ONE PURLIN FOR ANY OPENING IN THE ROOF.

RIGID INSULATION IS TO BE TWO OR MORE LAYERS OF "THERMAX" SHEATHING MANUFACTURED BY CELOTEX CORP., OR OTHER MATERIAL OF EQUIVALENT FIRE RATING AND R-VALUE PER INCH. INSULATION PROVIDED BY OTHERS.

TOTAL THICKNESS OF INSULATION TO BE MINIMUM 4" OR AS REQUIRED TO COMPLY WITH LOCAL ENERGY CODES. 1st LAYER OF INSULATION TO HAVE ALL SEAMS SEALED WITH ALUMINUM FOIL TAPE. OR INSTALL A SEPARATE VAPOR BARRIER BEFORE FIRST LAYER OF INSULATION.

1/2" PLYWOOD WALL SHEATHING & FELT PAPER AS SHOWN IN DETAIL 2/F IS SUPPLIED FOR DORMERS AND INSULATED AREAS ONLY. THESE MATERIALS ARE NOT SUPPLIED FOR GARAGES. ALL INSULATION IS BY OTHERS. REFER TO MATERIALS LIST FOR SPECIFICATIONS.

SHINGLE MANUFACTURER'S INSTALLATION INSTRUCTIONS ARE INCLUDED WITH EACH N.L.H. CONSTRUCTION GUIDE WHEN SHINGLES ARE PROVIDED BY N.L.H. IT IS IMPORTANT TO FOLLOW THESE INSTRUCTIONS AND GENERAL INFORMATION GUIDELINES TO INSURE PROPER PERFORMANCE AND WARRANTY COVERAGE. ROLLED ROOFING AND OTHER FLASHING MATERIALS SUGGESTED FOR VALLEYS AND EAVES ARE BY OTHERS.

DETAILS ON THIS SHEET ARE GENERAL AND MAY NOT APPLY TO ALL BUILDINGS.



NO.	REVISION	DATE	BY	CHKD

DRN	MG	CODES	MODEL
			STANDARD DETAILS D-96

PROJECT NAME: **ROOF FLASHING & VENTING**

DATE: JAN. 1, 1995

SCALE: AS NOTED

PLANNED BY: **NE**

SPT. NO.: **F**