


PLAN VIEW  
SCALE: 1" = 100'

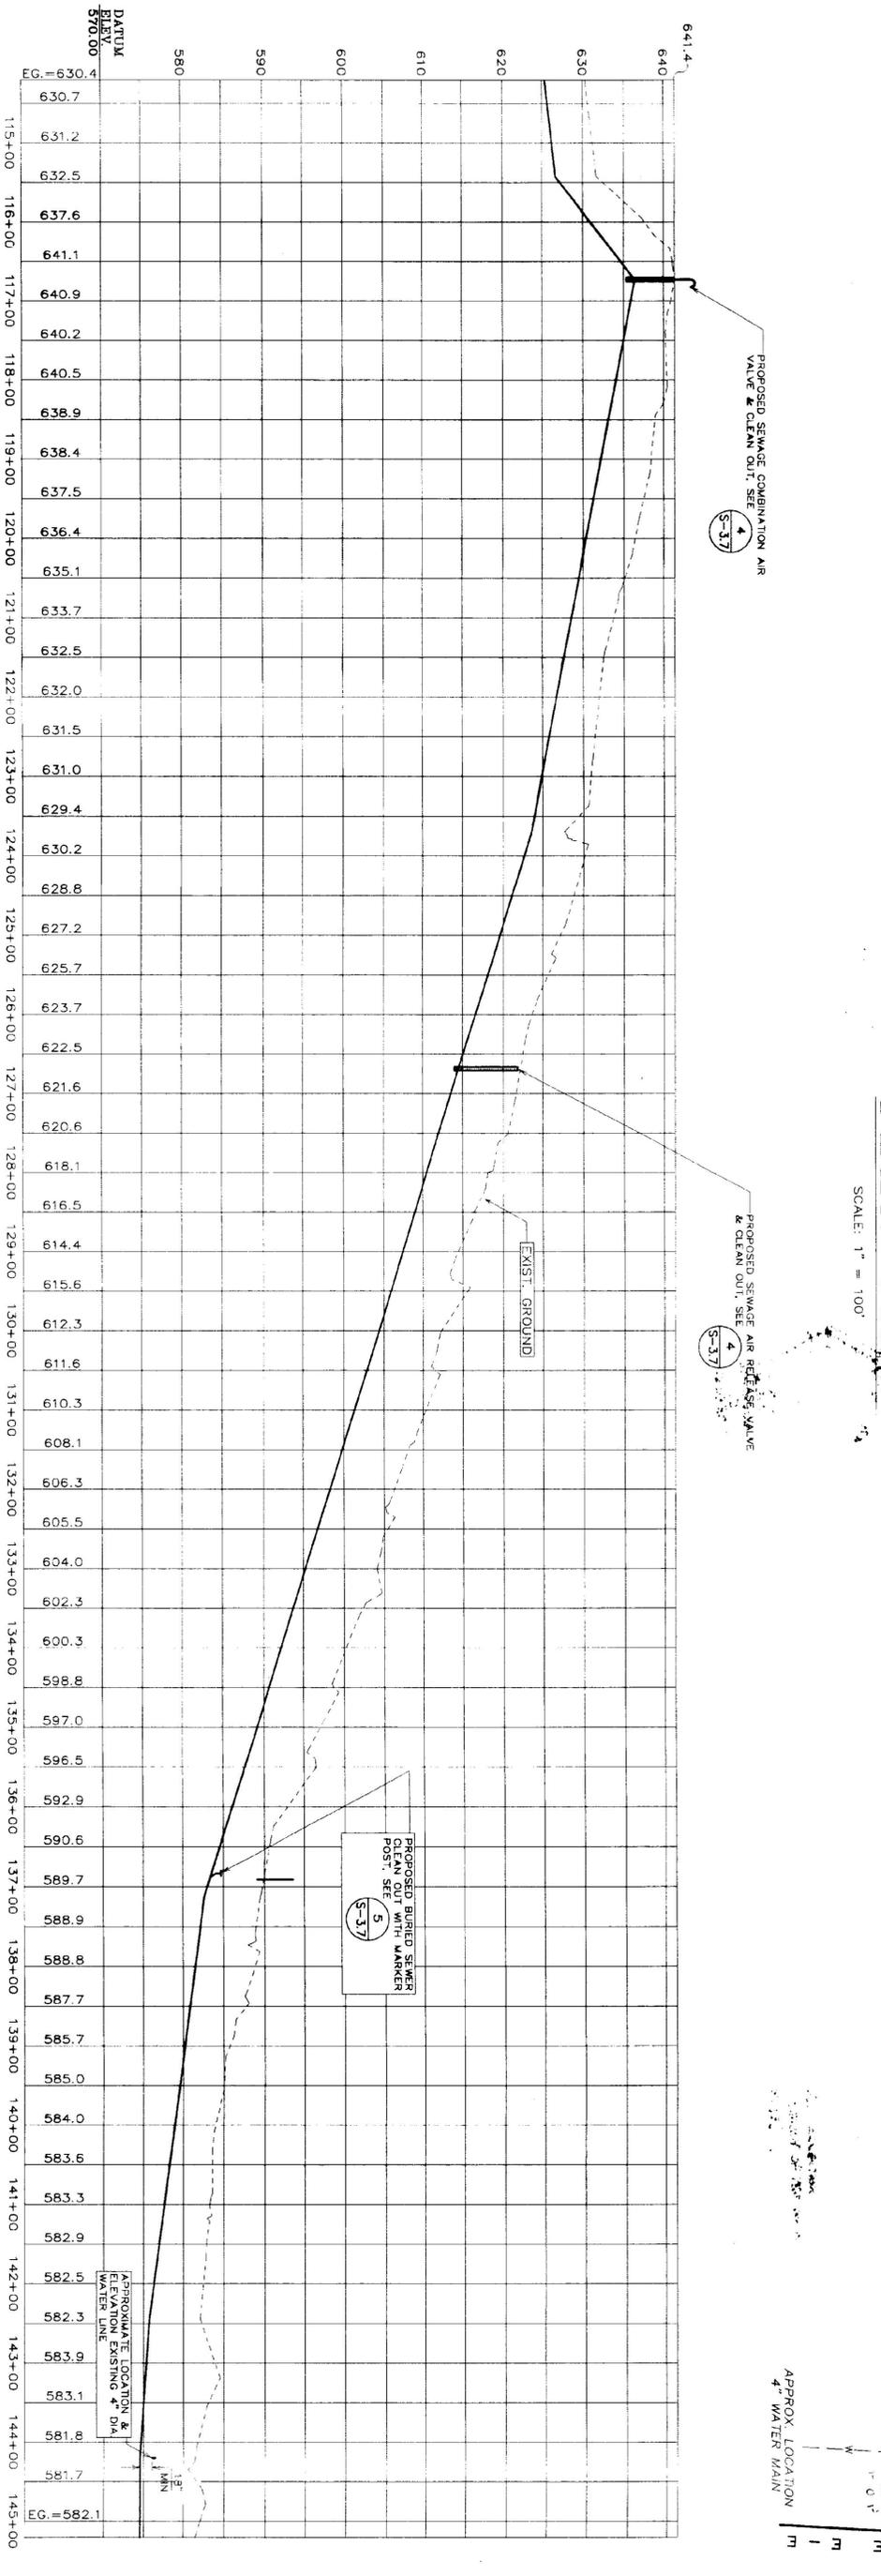


TEST PIT #	GENERAL SOIL TYPE	DEPTH TO LEDGE	GROUNDWATER
14	LOAM	NONE TO 74"	SEEP 0.14"
15	LOAM	NONE TO 75"	NONE
16	LOAM	NONE TO 72"	SEEP 0.60"
17	LOAM	NONE TO 75"	SEEP 0.70"
18	LOAM	NONE TO 78"	SEEP 0.44"
19	LOAM	NONE TO 82"	SEEP 0.60"
20	LOAM	NONE TO 78"	SEEP 0.72"
21	LOAM	NONE TO 84"	NONE
22	LOAM	NONE TO 72"	MOISTURE
23	LOAM	NONE TO 74"	SEEP 0.75"
24	LOAM & SAND	NONE TO 108"	SEEP 0.20"
25	LOAM & CLAY	NONE TO 108"	SEEP 0.20"
26	LOAM & CLAY	NONE TO 30"	SEEP 0.20"

PROFILE  
SCALE: 1" = 100' HORIZ.  
1" = 10' VERT.

VALVE SCHEDULE

VALVE NO.	STATION	TYPE
9	116+75	SEWAGE COMBO AIR VALVE
10	126+70	SEWAGE AIR RELEASE VALVE

- NOTES:  
1) TEST PIT DATA GATHERED IN THE SPRING OF 1998. GROUNDWATER CONDITIONS WILL VARY.  
2) PROVIDE A MINIMUM OF 48" OF COVER WHEN CROSSING SVALES AND 60" WHERE STONE LINED DITCHES ARE DISTURBED. SALVAGE AND REPLACE EXISTING STONE AND REPAIR DITCH TO MATCH EXISTING.  
3) USE 4" INSULATION OVER FORCE MAIN AT ALL WATERWAY CROSSINGS. SEE DETAIL 12, SHEET 3.7



STATE OF VERMONT  
DEPARTMENT OF BUILDINGS  
AND GENERAL SERVICES  
AGENCY OF ADMINISTRATION  
MONTPELIER, VERMONT

GEORGIA INTERSTATE 89 REST AREAS  
NORTHBOUND AND SOUTHBOUND

DATE: 21 AUGUST 1995  
SCALE: 1"=100'  
DRAWN BY: WPT/MD  
CHECKED BY: PJC  
PROJECT NO.: 8704  
DRAWING NO.: S-3.4

REVISIONS:  
DRAWING NAME: PLAN AND PROFILE

