



**SERIES 2**

ON [1 2 3 4 5 6]

SENS 4

EXTEND (SEC) 1 1 1 2 4 8  
4 2

DELAY (SEC) 1 2 4 8 16 32

MODE LONG PULSE NORM

ON [1 2 3 4 5 6]

FREQ MED HI LO

**BOSTON LIGHT**

FUSE PRESS

**SERIES 2**

**BOSTON LEFT**

LONG PULSE NORM

MED HI LO

FUSE PRESS

**SERIES 2**

**MARSETT**

SENS 5

MODE LONG PULSE NORM

FREQ MED HI LO

FUSE PRESS


FUSE 1/4 AMP

70 160

85 130

115

FAN ON TEMP DEG. F

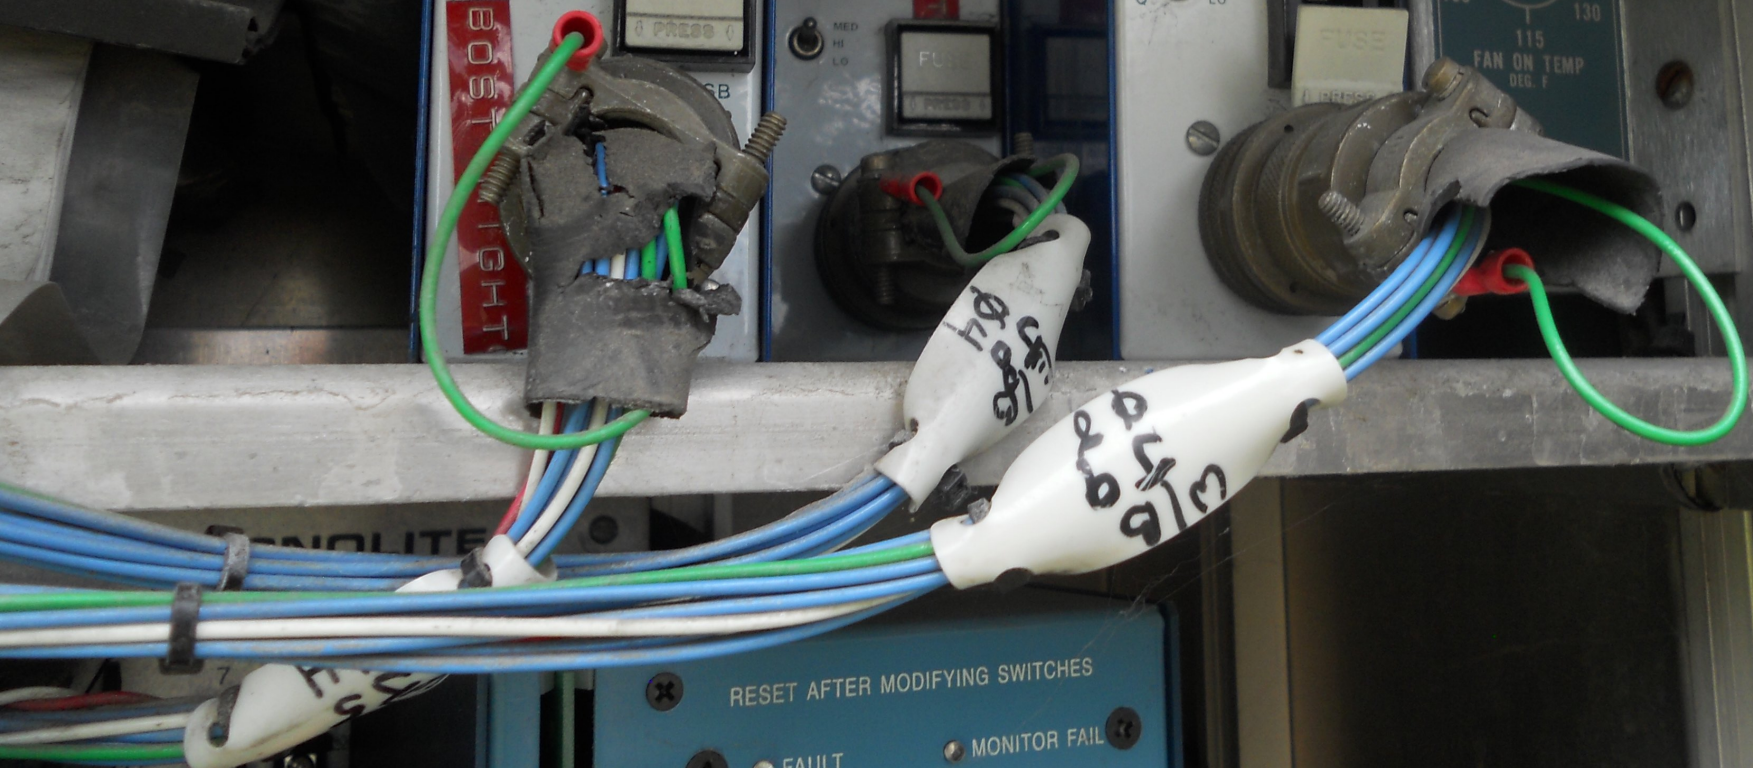

RESET AFTER MODIFYING SWITCHES

FAULT

MONITOR FAIL

RESET

POWER

MODE

2 OMIT

3 ON

4 NEXT

CHK